

GENERAL NOTES

THIS DRAWING MUST BE READ IN CONJUNCTION WITH ALL RELEVANT ENGINEERS & ARCHITECTS DRAWINGS.

DO NOT SCALE FROM THE DRAWING. THE CONTRACTOR MUST CHECK AND CONFIRM ALL DIMENSIONS AND LEVELS ON SITE.



ANY QUERIES AND/OR DISCREPANCIES MUST BE REFERRED TO ENGINEER BEFORE MATERIALS ARE ORDERED AND BEFORE WORKS COMMENCE ON SITE.

NOTES

- 1) ALL PIPEWORK TO BE COPPER WITH CAPILLARY & COMPRESSION FITTINGS TO SAZ 325.
- 2) PRESSURE TESTING OF WATER PIPES TO BE CARRIED OUT AT 150% OF THE HIGHEST EXPERIENCED WORKING PRESSURE IN THE INSTALLATION.
- 3) ALL INSTALLATIONS TO SATISFY LATEST MODEL BUILDING BY-LAWS.
- 4) ALL INTERNAL PIPEWORK TO BE CHASED IN WALL.
- 5) ALL EXPOSED HOT WATER SUPPLY PIPES TO BE INSULATED.

LEGEND

- MANUAL ISOLATING VALVE
- WATER OUTLET
- PIPE AT HIGH LEVEL
- PIPE AT LOW LEVEL
- VERTICAL DROPPER OR RISER
- H+CWS HOT & COLD WATER SUPPLY
- HWS HOT WATER SUPPLY
- CWS COLD WATER SUPPLY

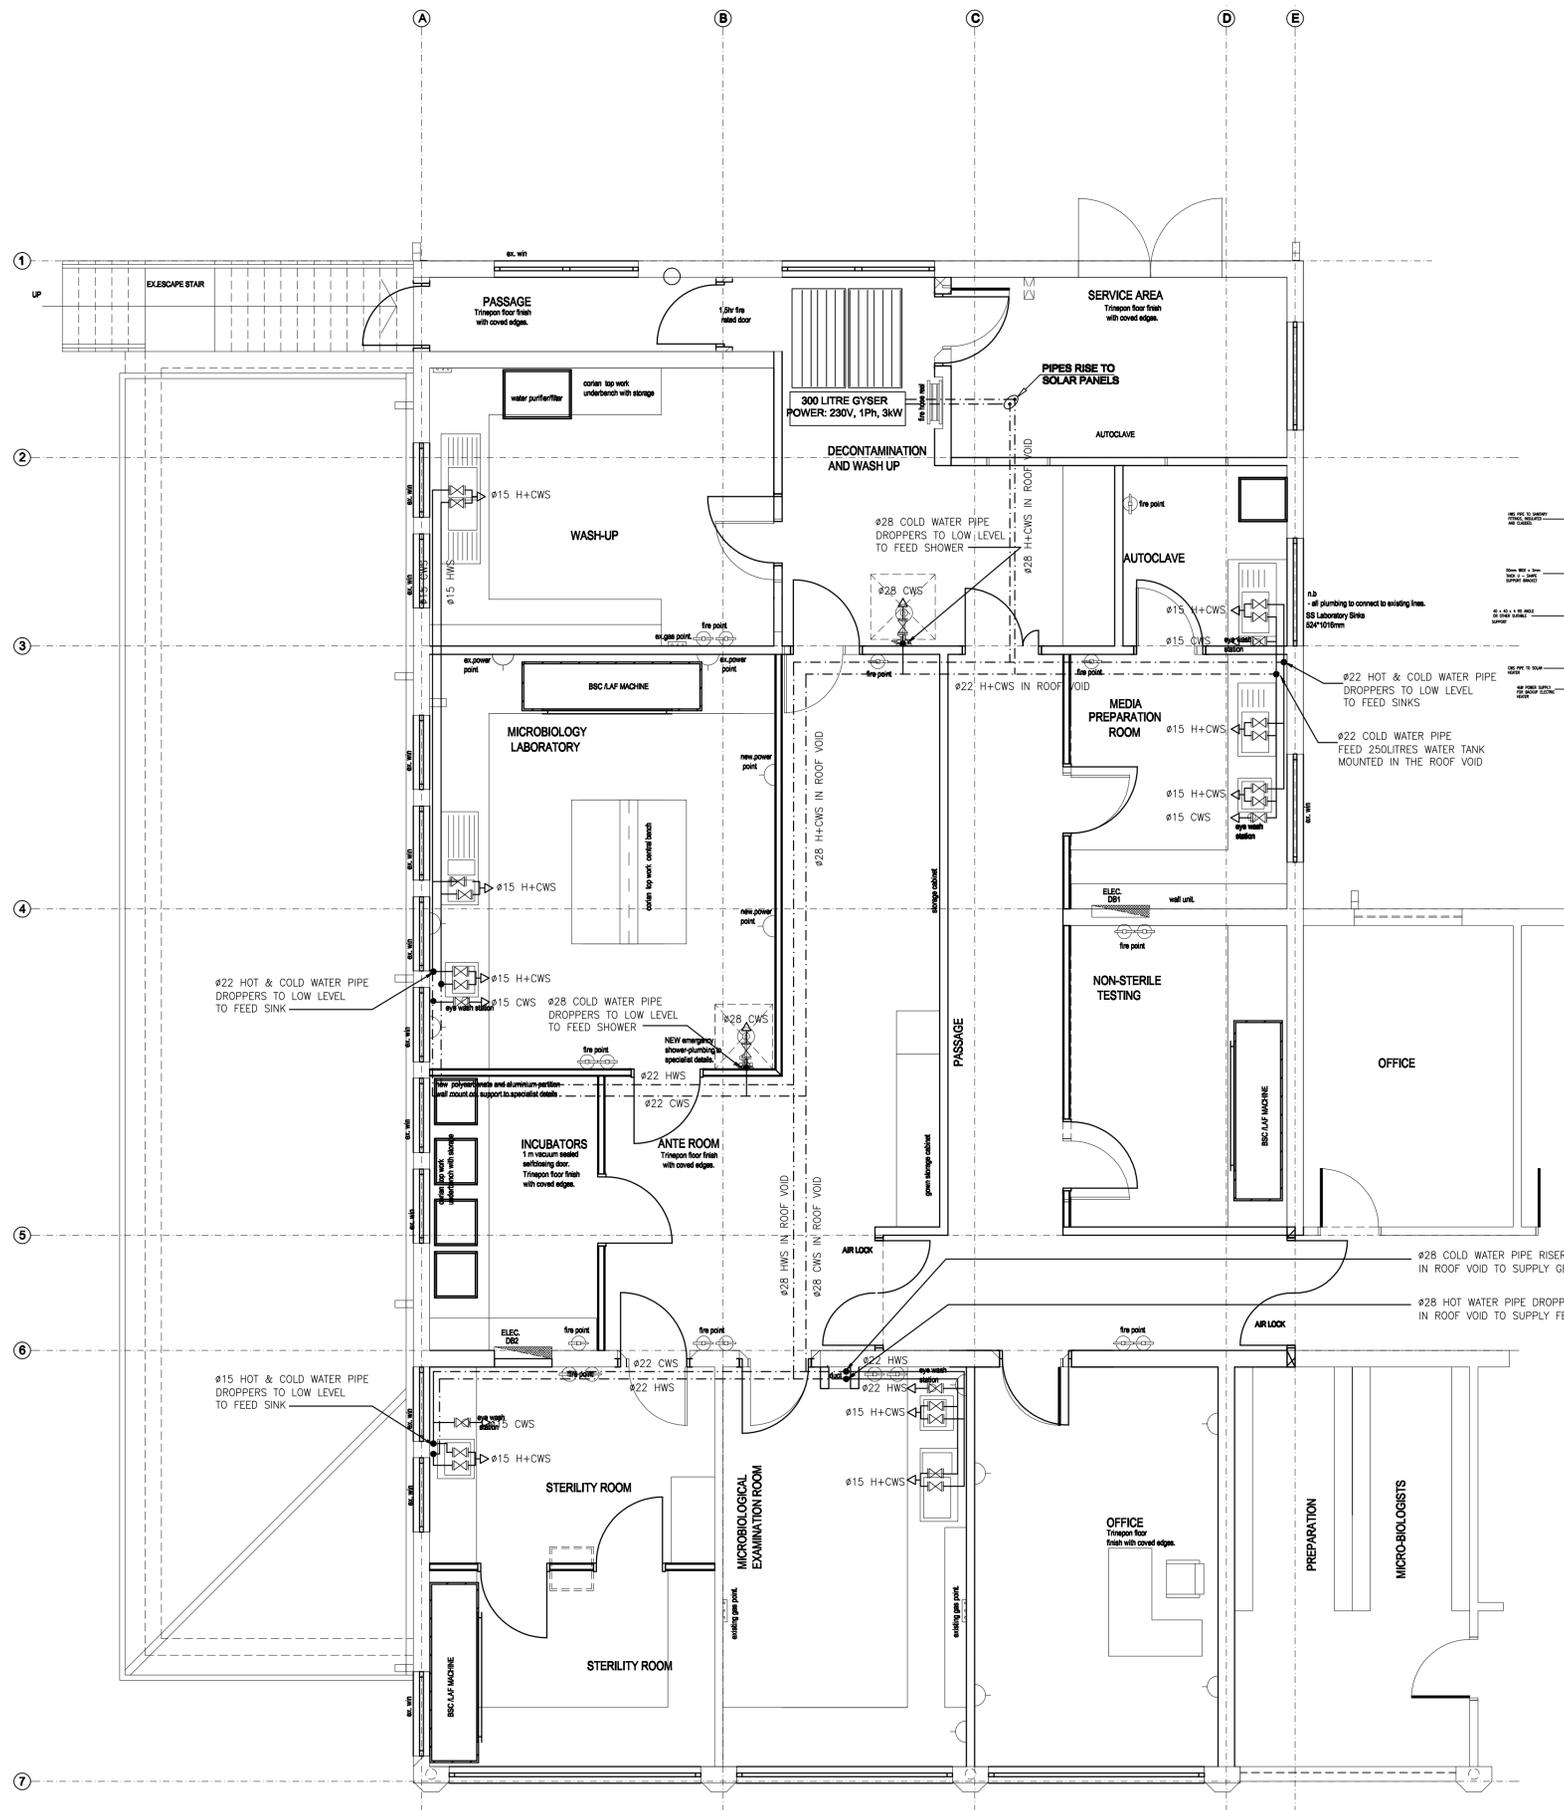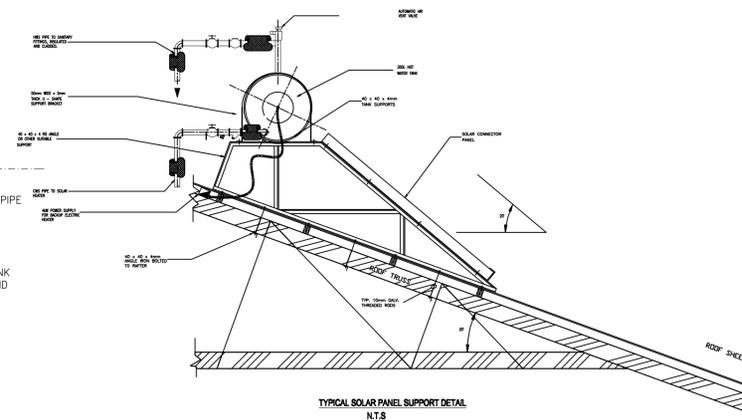

REVISION	DATE	DESCRIPTION
A	27/06/16	PRELIMINARY ISSUE

DRAWING STATUS
TENDER

QED CONSULTING ENGINEERS
POWER SYSTEMS ENGINEERING • BUILDING SERVICES ELECTRICAL ENGINEERING • BUILDING SERVICES MECHANICAL ENGINEERING
16-4th Avenue Mabelreign, P.O.Box A1689 Avondale, Harare
T +263 4 310 023, F +263 4 305 920, E admin@qedzim.com

C•P•E CHECKPOINT ENGINEERS
Consulting • Design • Project Management
cpe@checkpointengineers.com
www.checkpointengineers.com
+263 77 224 8096

ARCHITECT
MASIYANISE T.I.
REGISTERED ARCHITECT

CLIENT
MEDICINES CONTROL AUTHORITY OF ZIMBABWE (MCAZ)

PROJECT
REFURBISHMENT OF MCAZ MICROBIOLOGY LAB

DRAWING TITLE
FIRST FLOOR
DOMESTIC WATER SERVICES LAYOUT

DESIGNED	J.T.	CHECKED	J.T.
DRAWN	S.Z.	CHECKED	
DATE	23/06/2016	SCALE	1:50

PROJECT N° DRAWING N° REVISION
MCAZ/HRE/1/J018/530