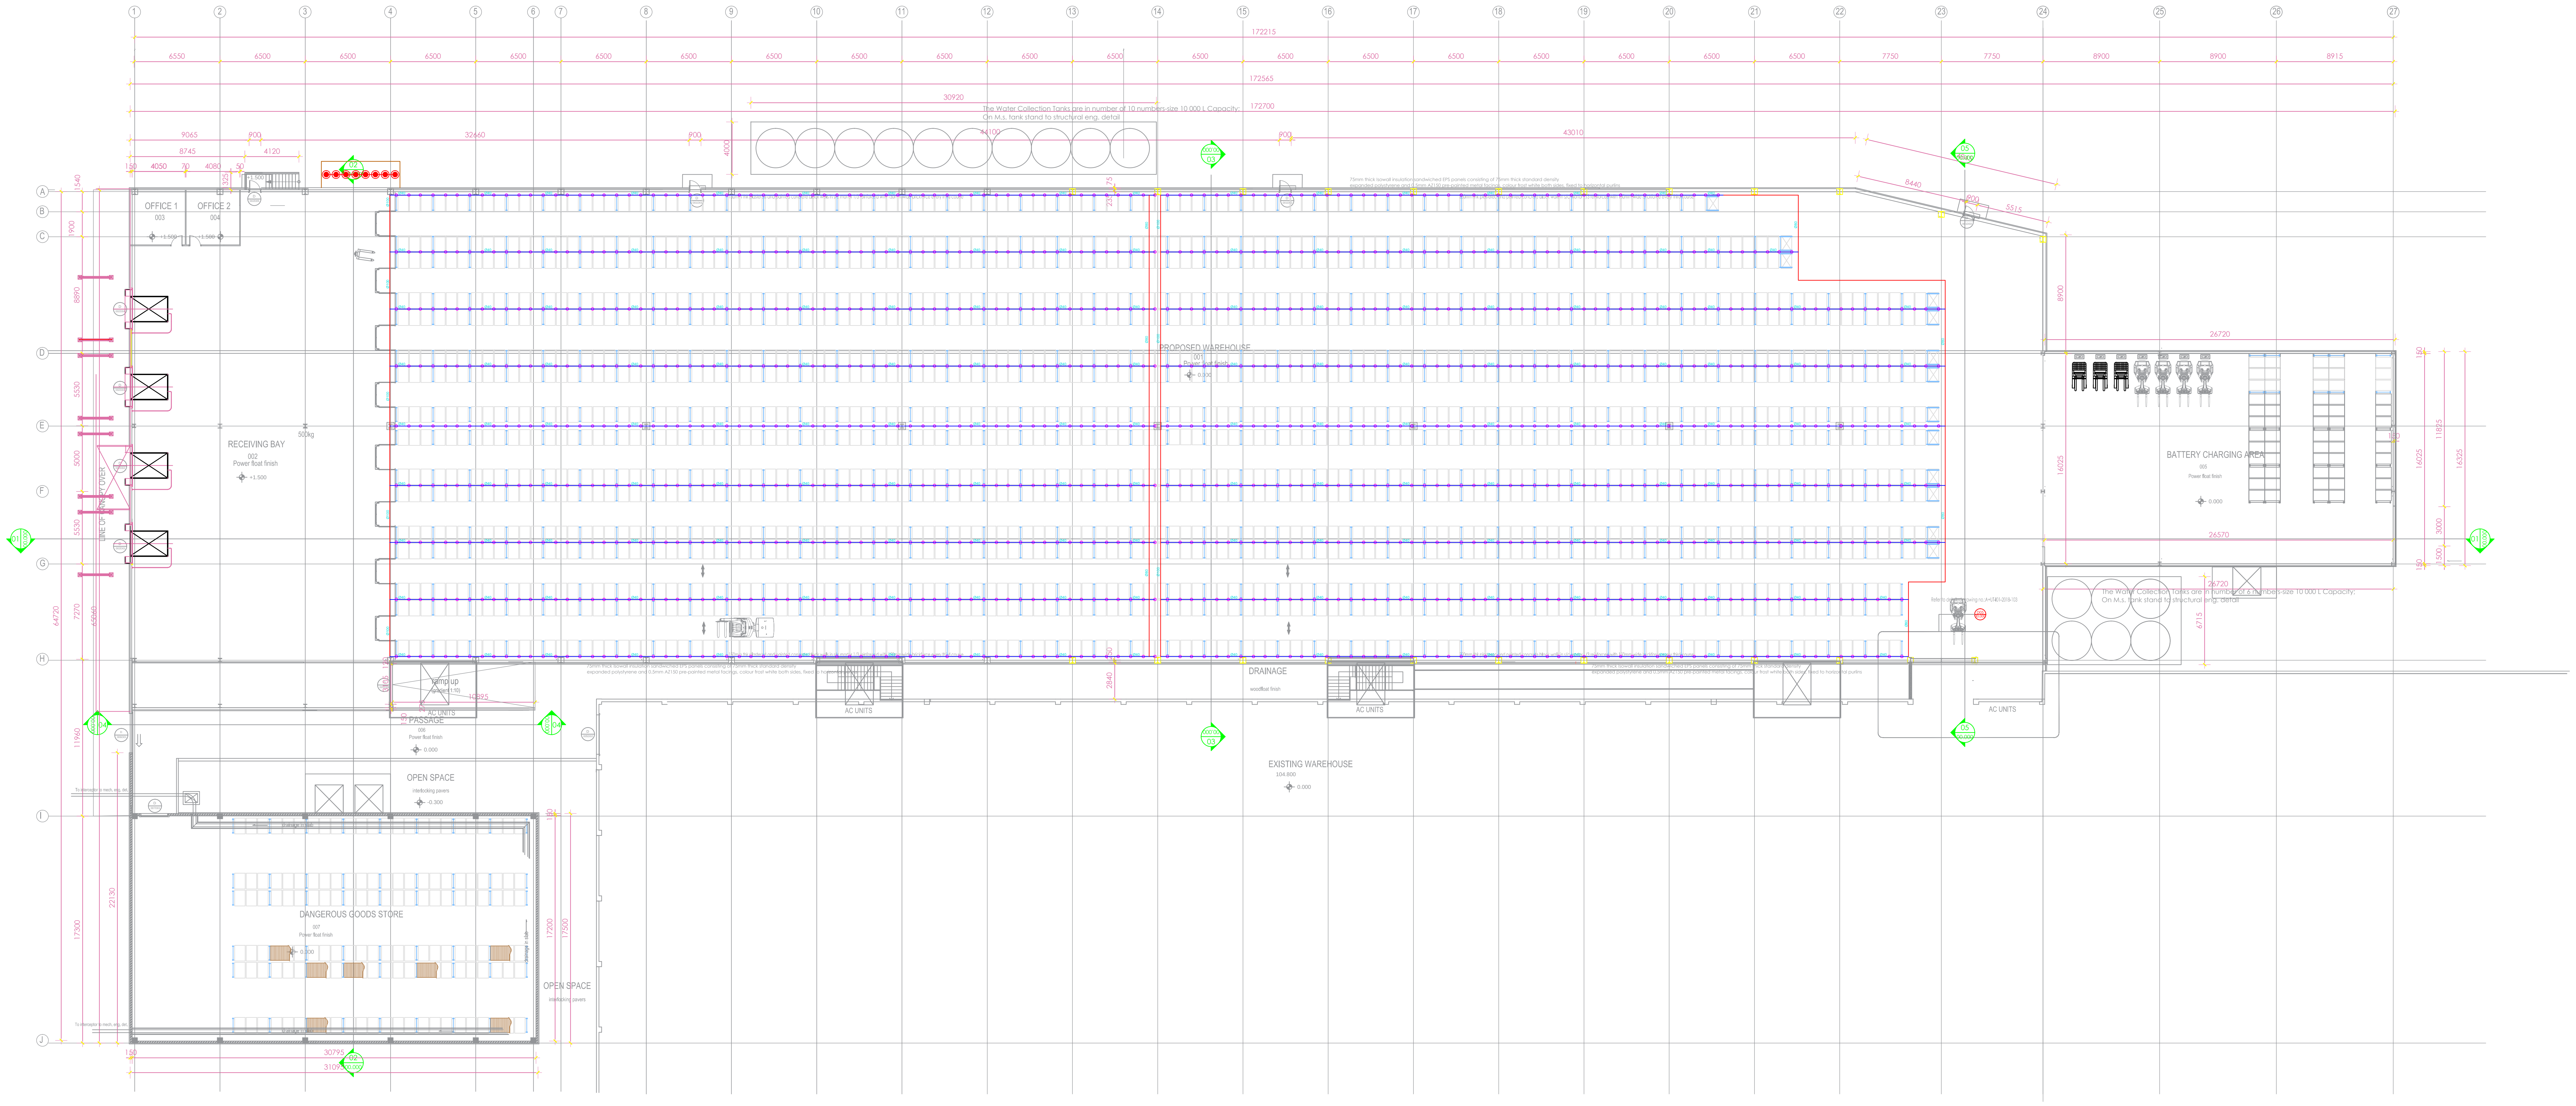

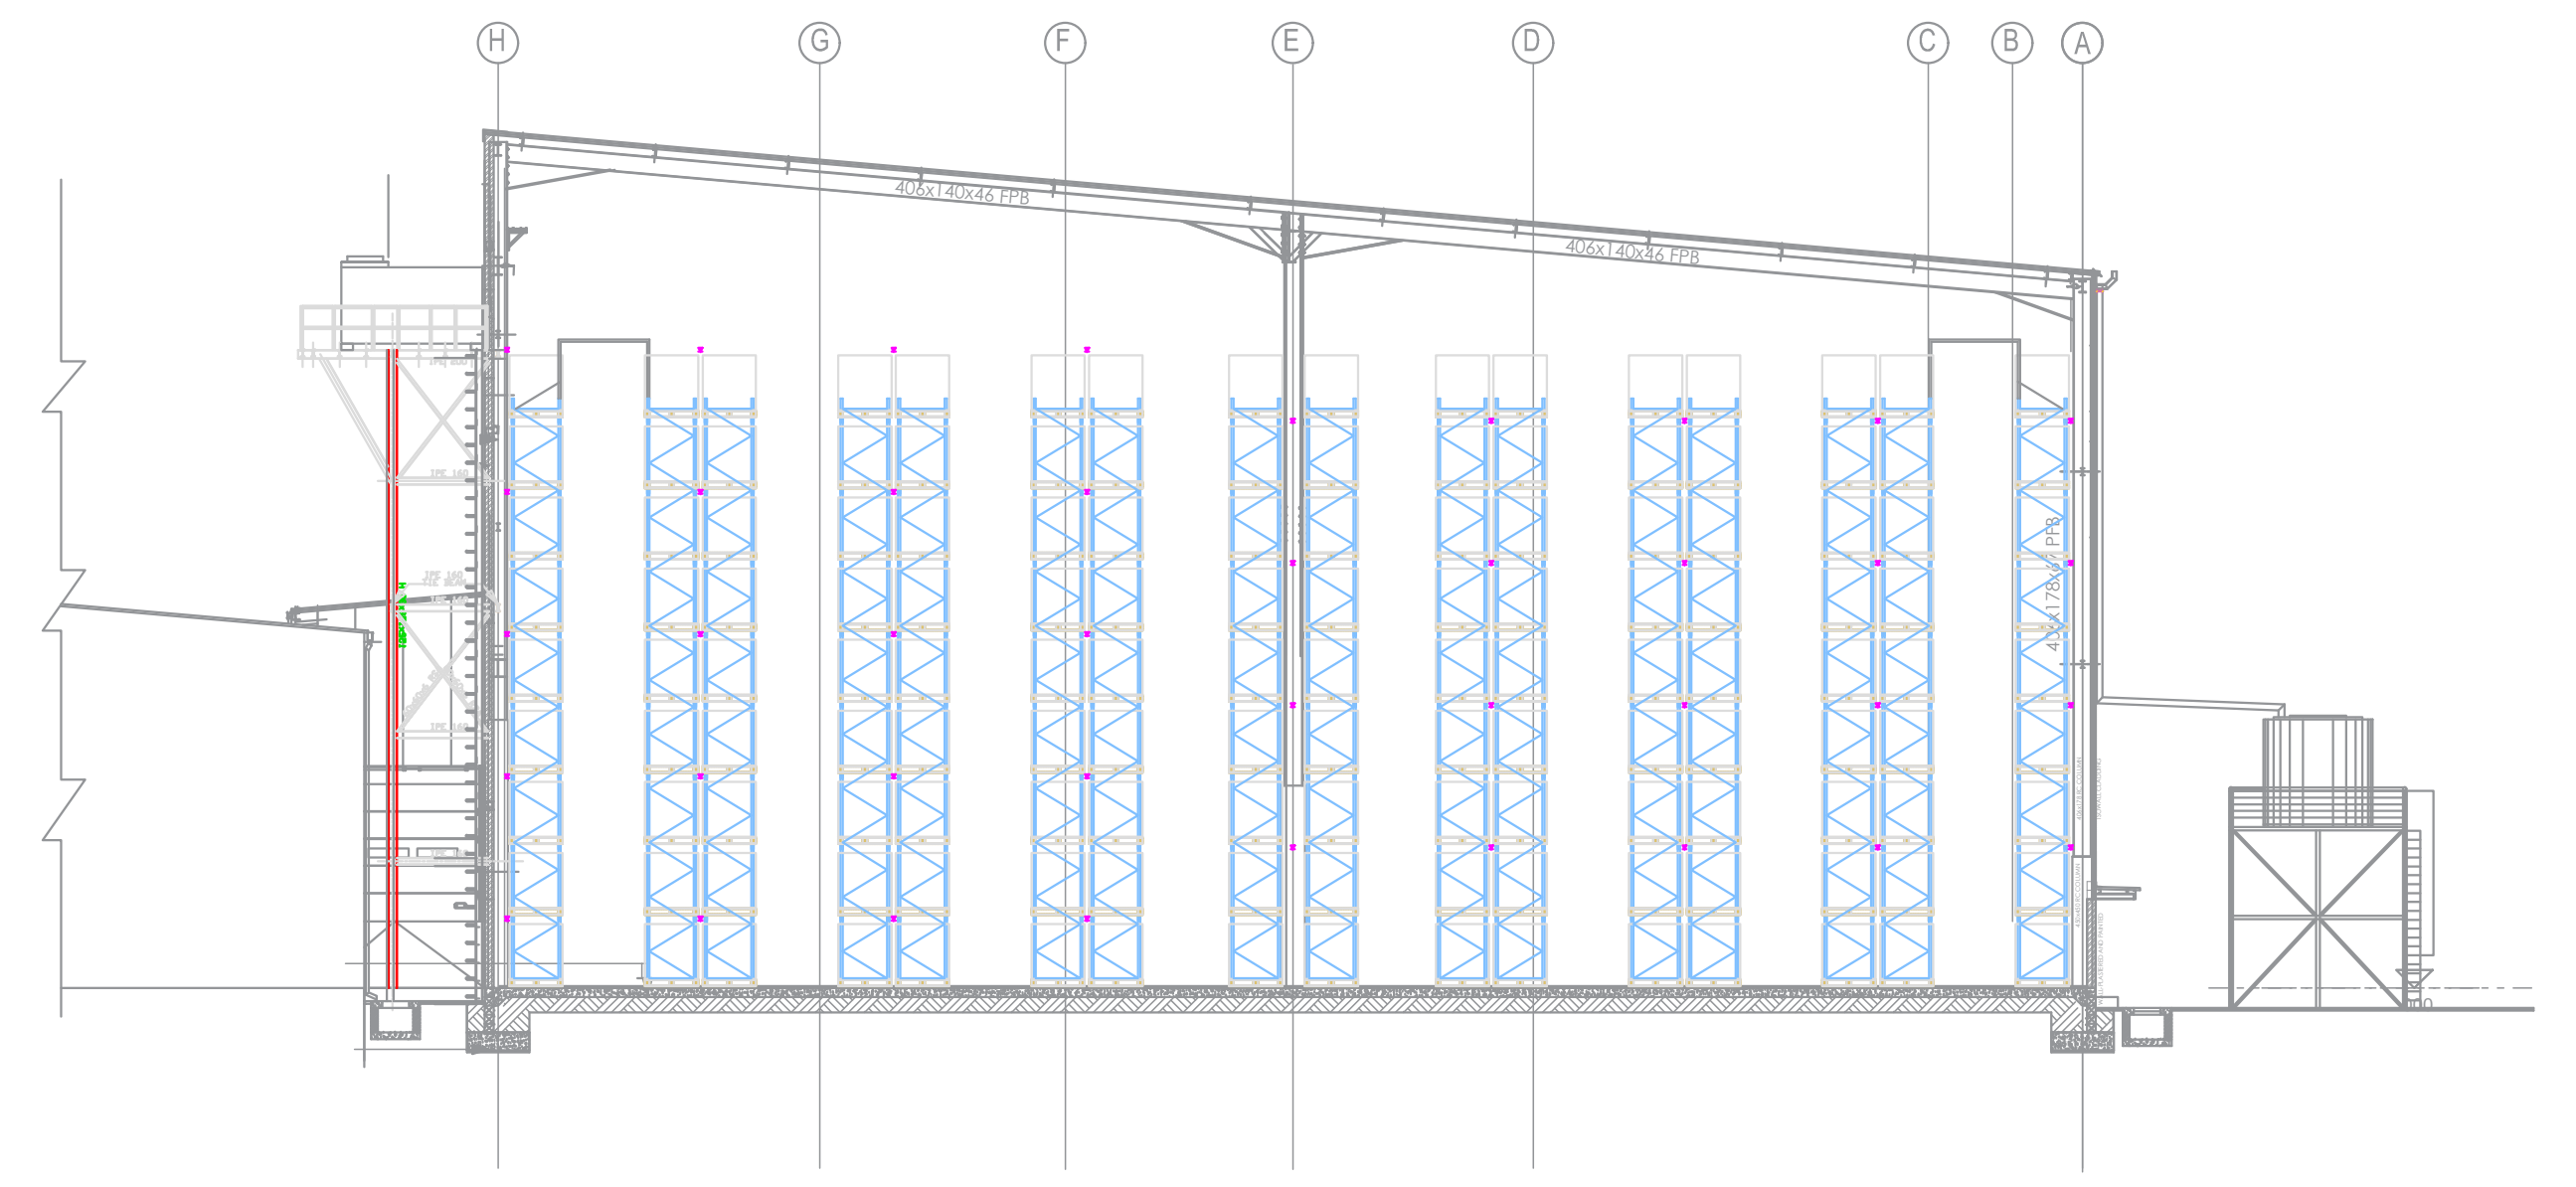

OUTLETS			AREA
No.	TYPE	TEMP	
4930	15mm Q/R pendent sprinklers	68°C	NEW WAREHOUSE

REVISIONS

REV	DATE	DESCRIPTION
A	29-08-2018	TENDER DRAWINGS
B	12-09-2018	DANGEROUS GOOD STORE SPRINKLERS REMOVED

Specialist
Warehouse
Consultant
TEL: +27 (0)82 330 9345
EMAIL: les@ontega.co.za

CLIENT

MSL
Medical Stores for life

DRAWING TITLE

NEW WAREHOUSE AND DANGEROUS GOODS RACKS

DRAWING NO.	REVISION	SCALE
MSL 013	B	1:200