


# PROPOSED JAPANESE CENTRE UNIVERSITY OF JUBA

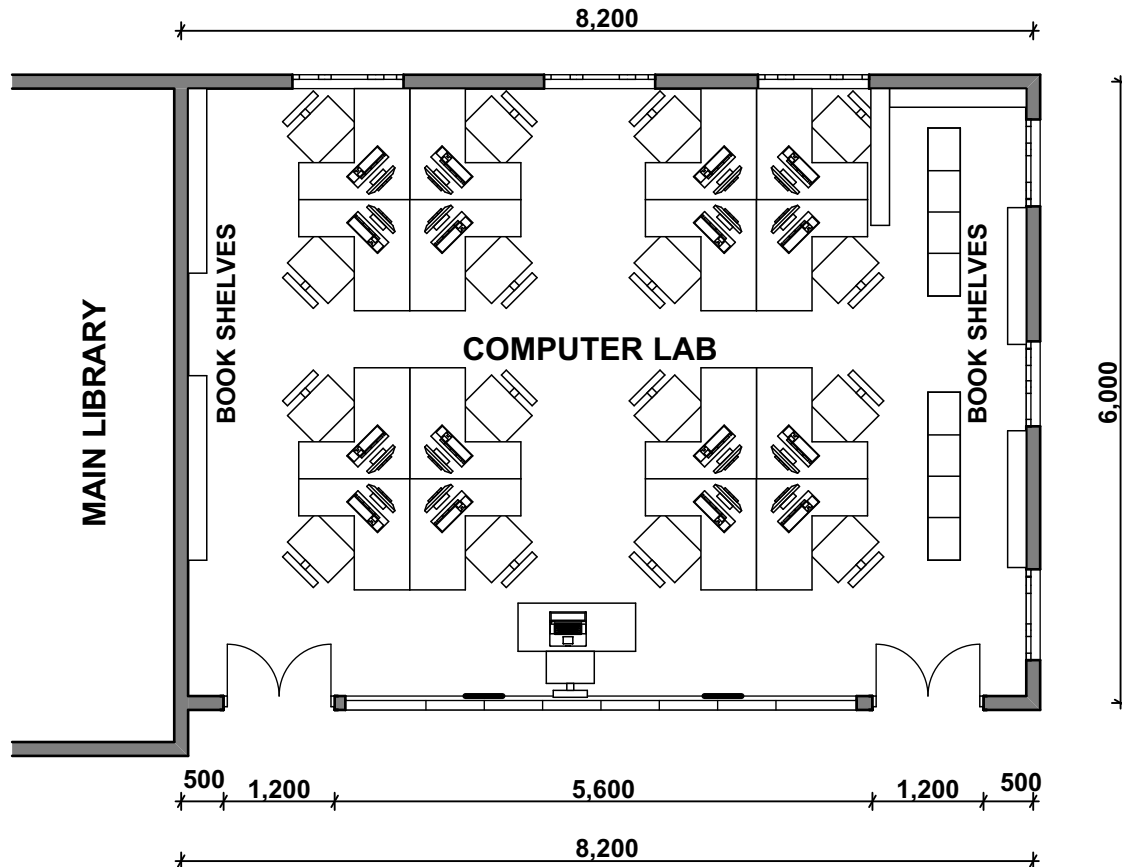

## FLOOR PLAN

No	Notes
01	All dimensions are in MM unless otherwise indicated
02	All dimensions to be checked and confirmed on site, WRITTEN dimension override SCALED dimensions. Any discrepancy must be reported to the Architect promptly before proceeding
03	Foundation depth to be determine on site, but should not be less than 1200mm. Strip Footing to be in concrete class 20
04	All structural works, roof structures, column, slabs and beams are to STRUCTURAL ENGINEER'S DETAILS
05	DPC to be 3ply Bituminus felt or any other approved Materials. Provide heavy duty polythene sheet under ground slab and anti termite Fumigants in the hardcore layer.
06	All windows and doors (except WC doors) to be provided with appropriate permanent ventilation (PV)
07	All walls less than 200mm thick to be provided with Hoop Iron reinforcements at every alternate course
08	All Plumbing works to be in regulations with M.O.H Regulations or relevant Authority. Sanitary fittings to be TWYFORD or as per specifications
09	All inspection chambers with building areas, Driveways and parkings to have covers. H/D double seal airtight. Drainage pipes passing under a buildings, driveways and parking to be encased in 150th concrete surround
10	All waste and soil pipes to be in ducts and bends to have roding eyes with external Access

REVISION		
No	DATE	DESCRIPTION

PROPOSED JAPANESE CENTRES  
TRAINING/COMPUTER CENTER  
LOCATION: JUBA - SOUTH SUDAN

SCALE: 1:100 DRAWING :

CLIENT: UNIVERSITY OF JUBA

DESIGNED BY: ARCH. AMOS ARIER



University of Juba  
Office of the Resident Engineer

© THIS DESIGN IS A PROPERTY OF UoJ.  
IT IS AN OFFENCE TO ALTER, COPY OR SELL  
WITHOUT THE CONSENT OF THE OWNER