


Plan at mark +3,400

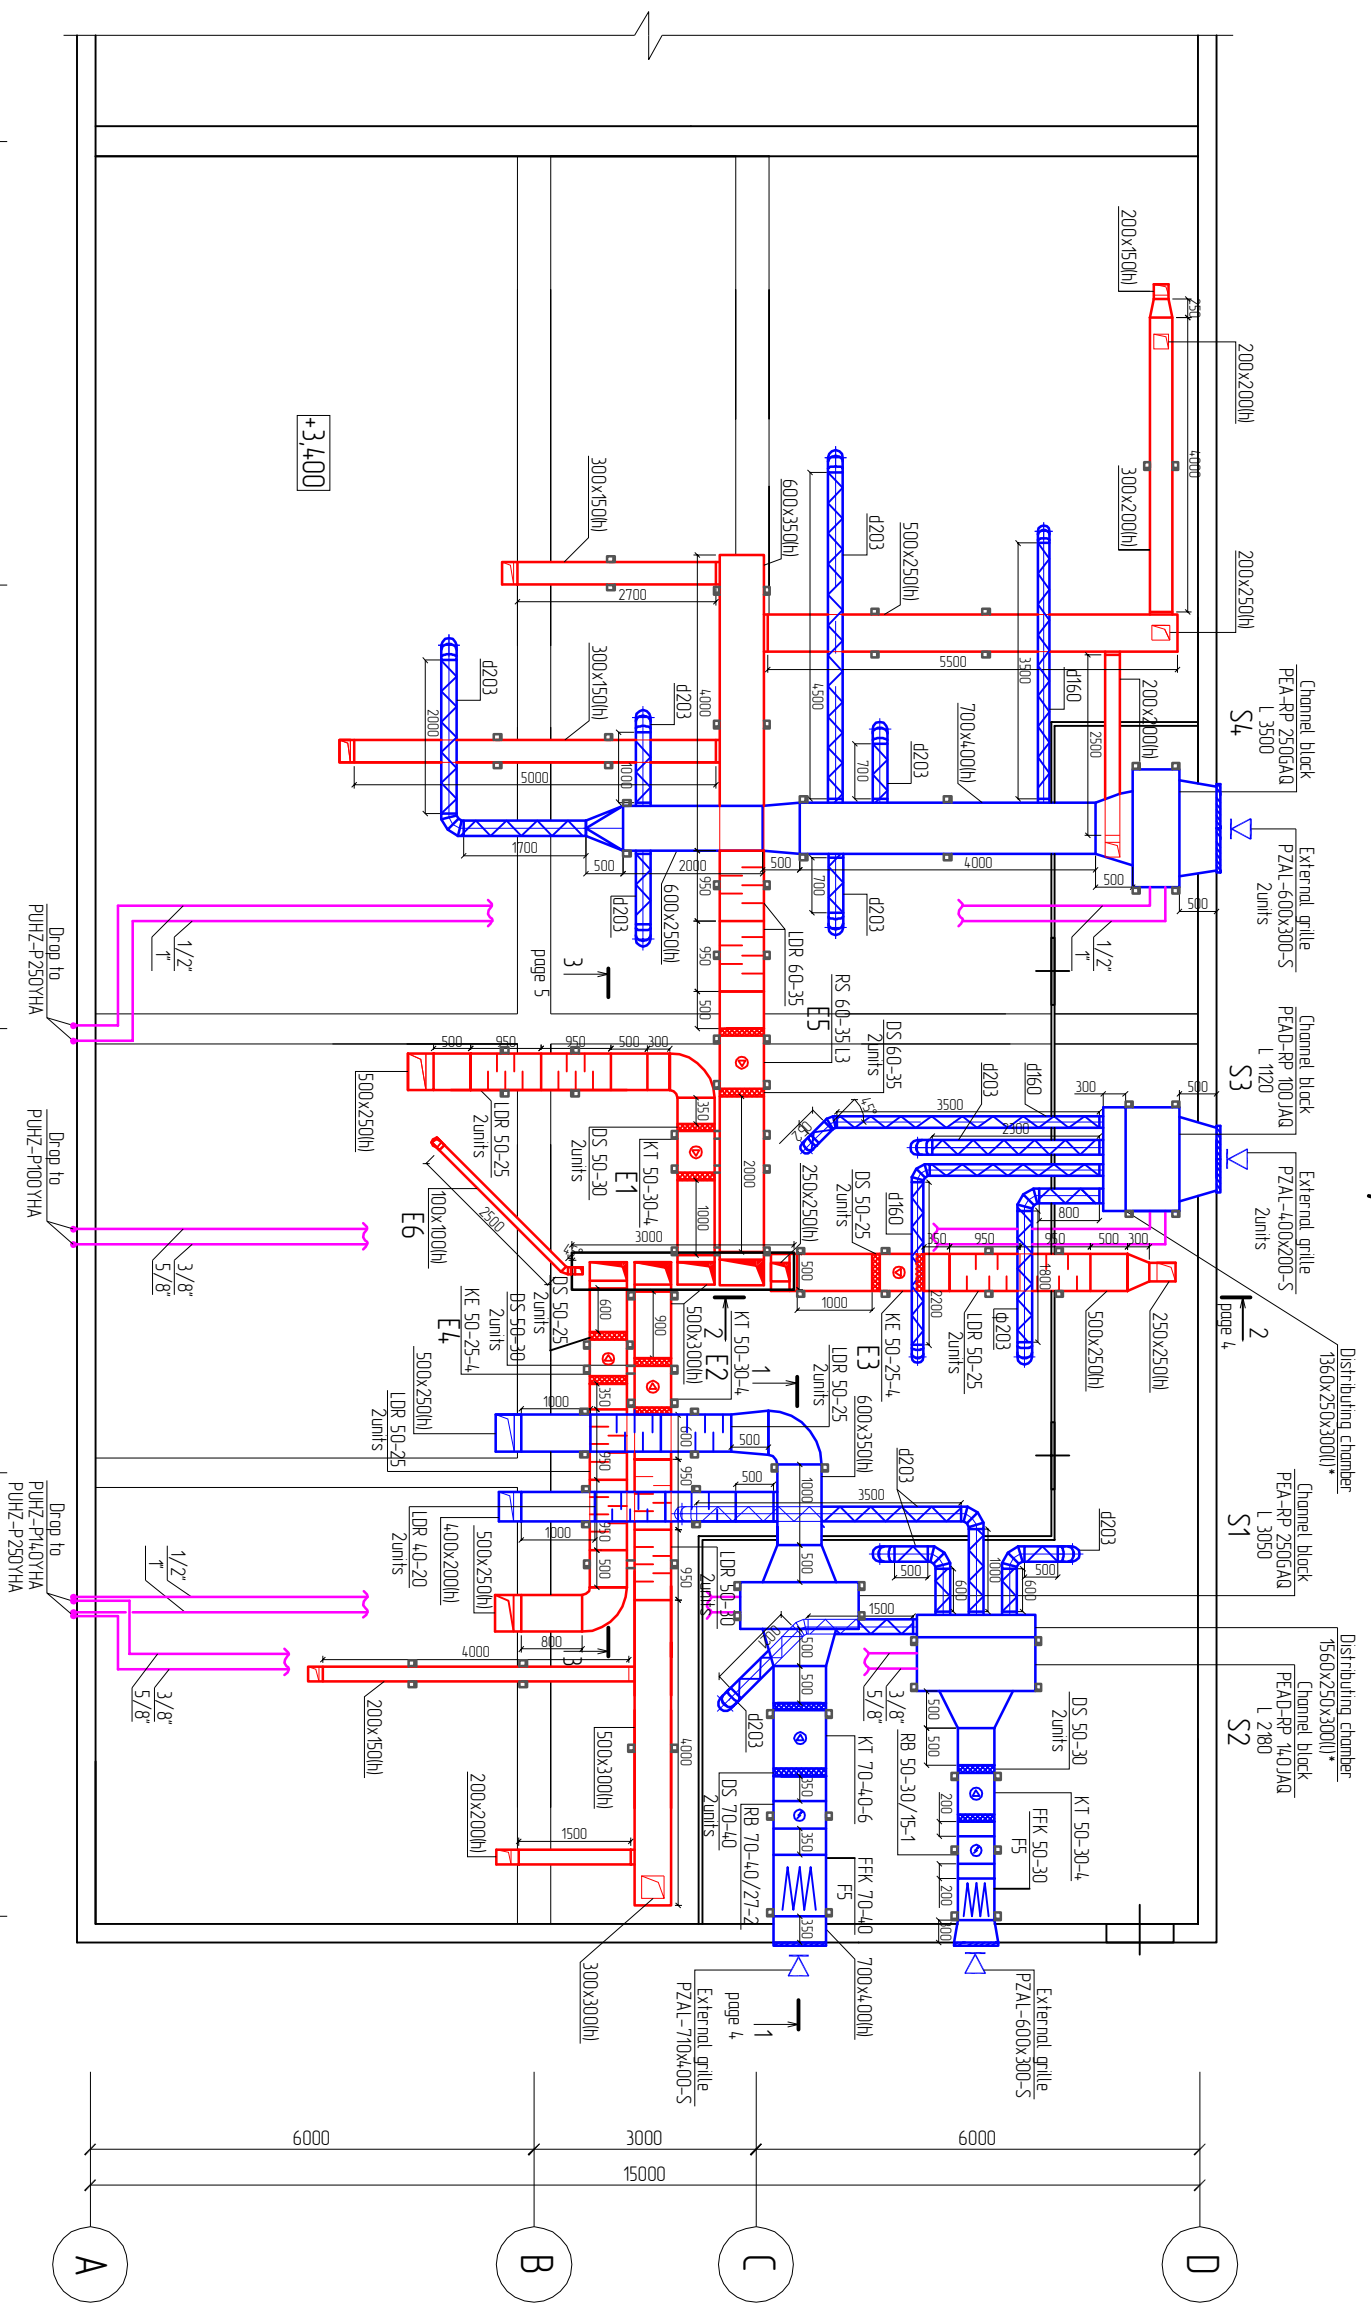

- 5
- 4
- 3
- 2
- 1

Notes

1. All the supply and exhaust air ducts going through the attic are to be heat insulated in order to prevent condensate formation on the walls of the air ducts.
2. To provide for condensed water removal into the sewerage system from air cooler for systems S1-S4.
3. To provide bearing mounts and hangers for the air ducts and equipment of supply and exhaust systems.
4. To provide vertical sections and fittings of systems S2, S3, S4 from zink galvanized air ducts, horizontal sections – from flexible sound-absorbing insulated air ducts.
5. To provide a transition piece for passing of exhaust air ducts.

2013-025-01 – HV			
Turkmenistan, Dashoguz, Niyazov's District, TB Hospital			
Reference-laboratory		Stage	Page
WP		3	7
Ventilation and air conditioning.			
Plan at mark +3,400			