
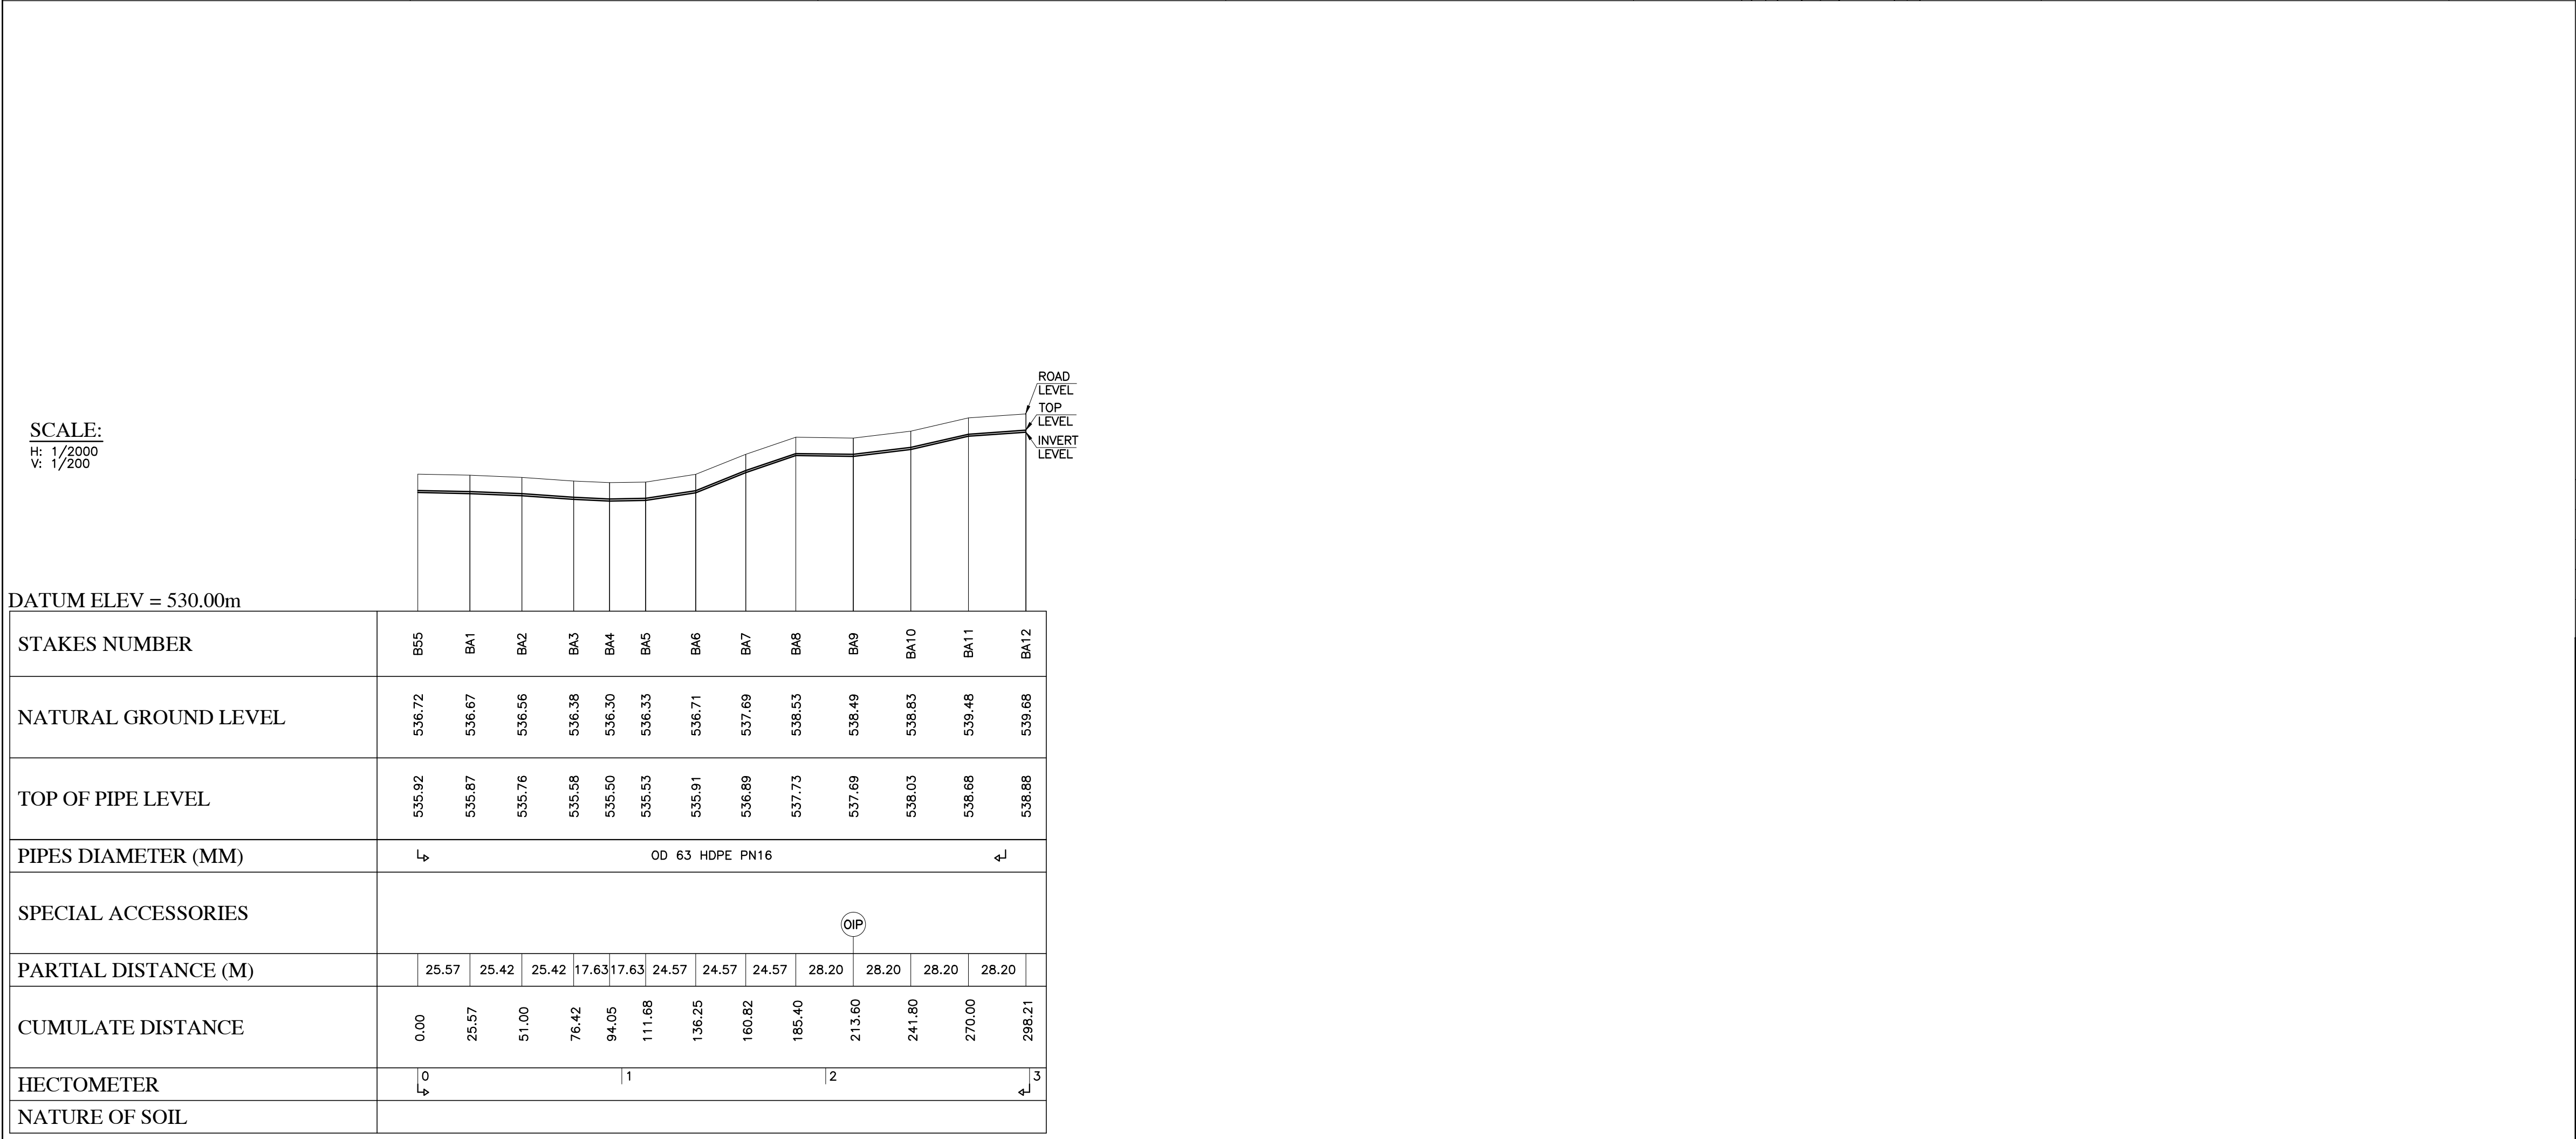


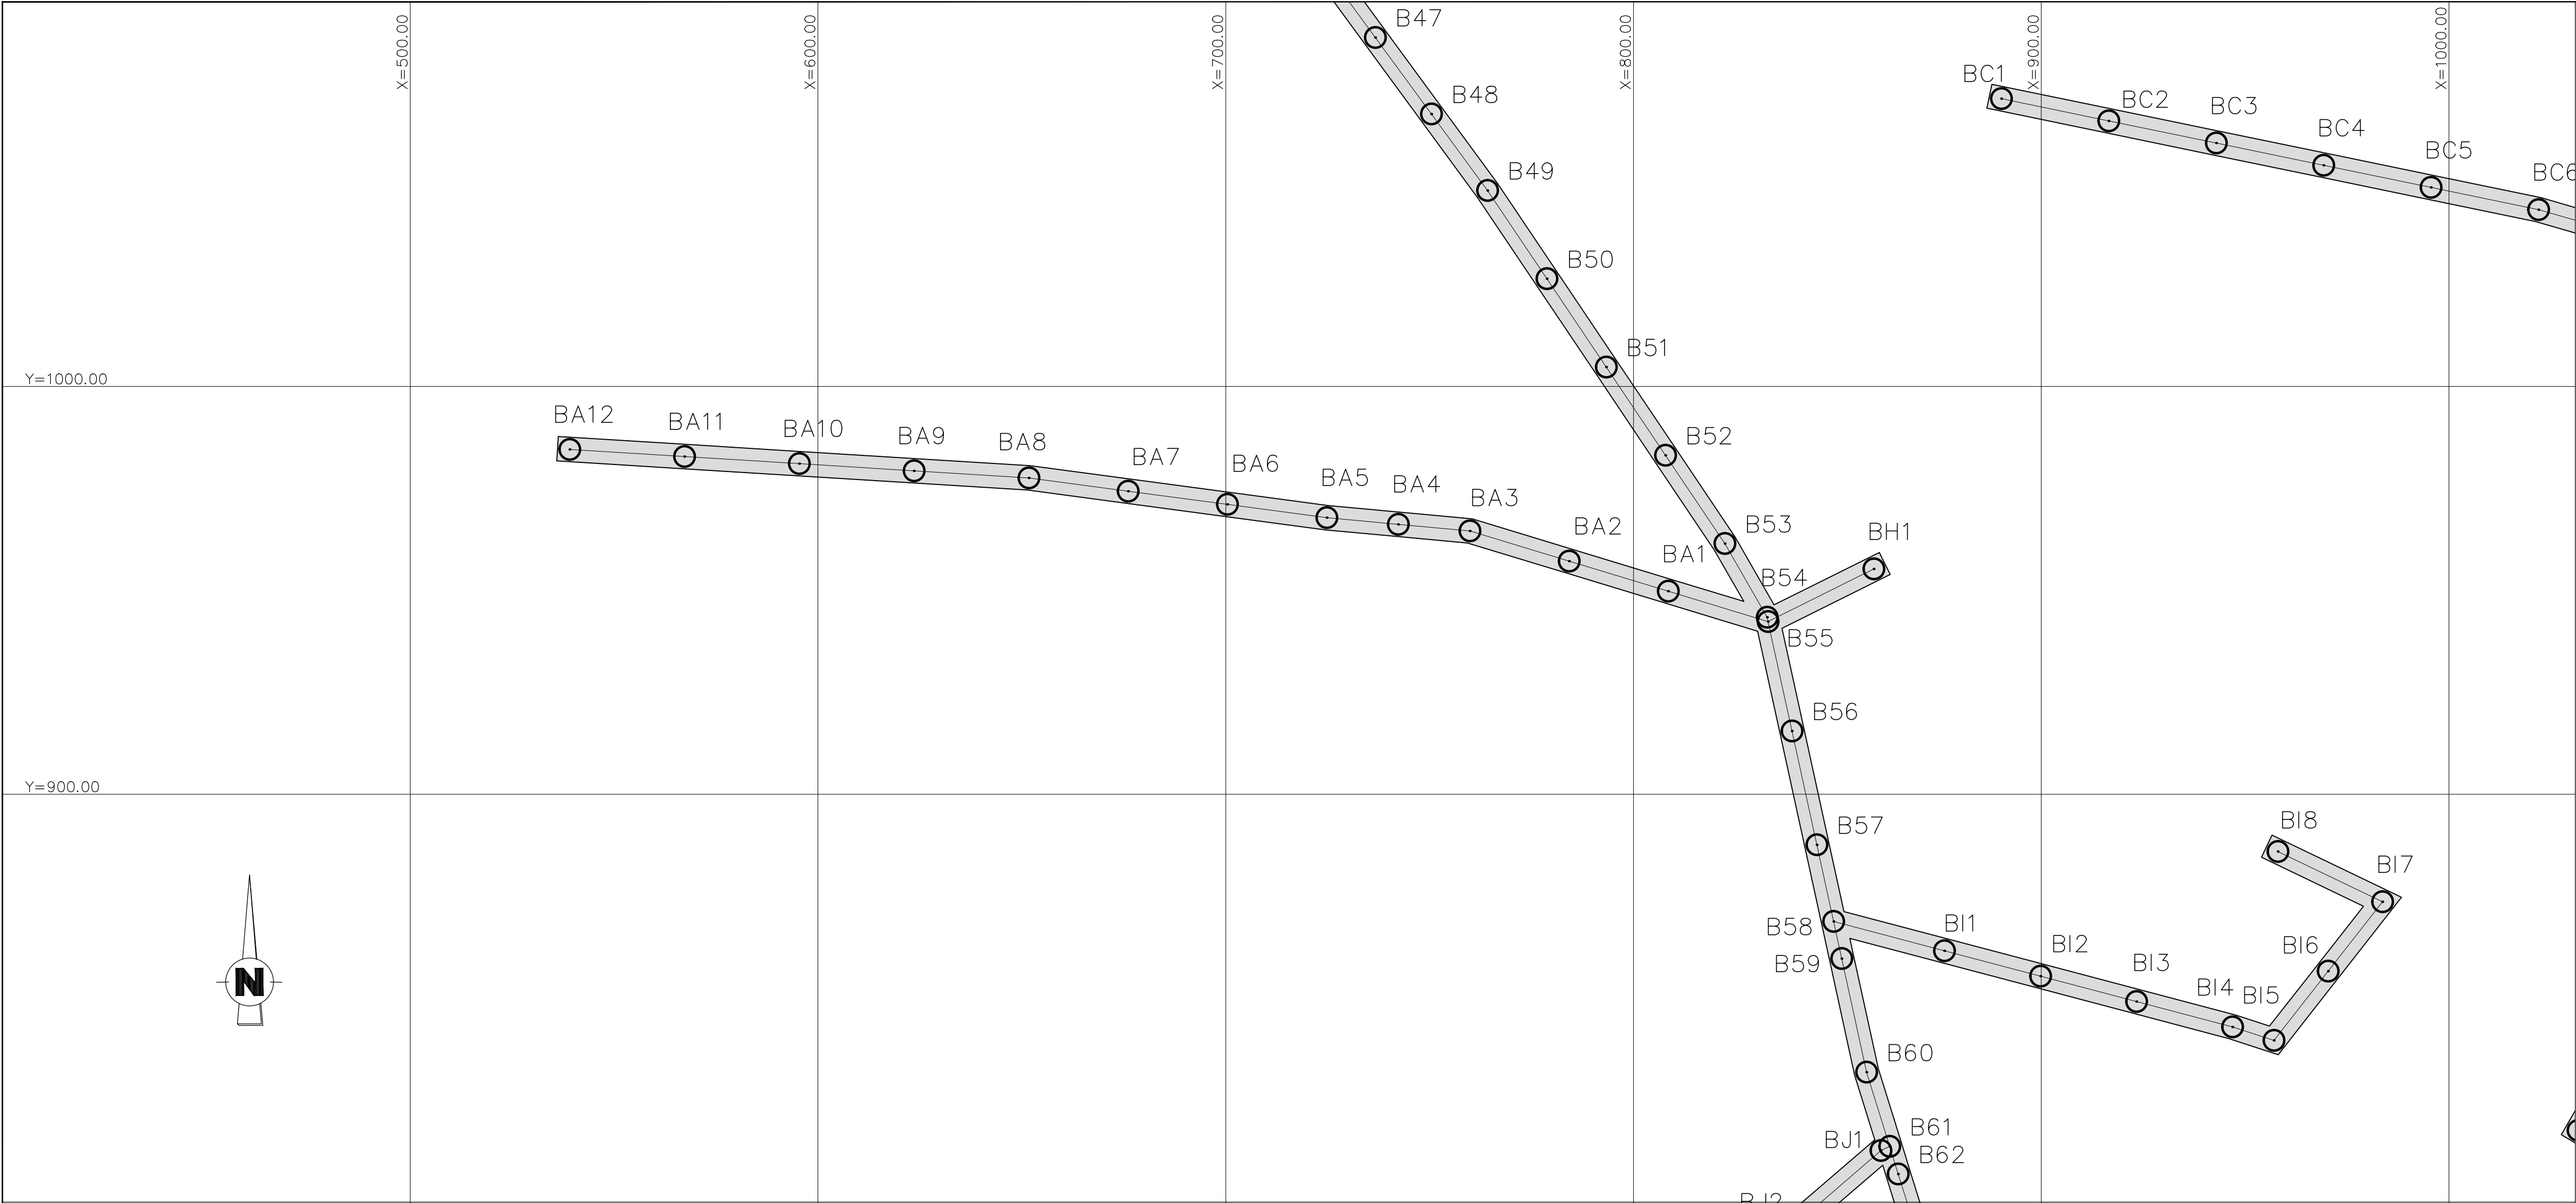

LEGEND :

 , W.O.

WASH OUT

 , D.A.V.

DOUBLE AIR VALVE

 , G.V.

GATE VALVE

 FH

FIRE HYDRANT

 OIP

OBLIGATORY INTAKE POINT

 EC

END CAP

REV.	DATE	DRAWN BY	CHECKED BY	APPROVED BY	MODIFICATION	STATUTS

UNITED NATIONS DEVELOPMENT PROGRAMME
LEBANON

NORTH LEBANON WATER SUPPLY
CONSTRUCTION OF WADI KHALED 2 WATER SUPPLY SYSTEM

KNAISSE WATER SUPPLY SYSTEM
LINE D2.21 (BA1–BA12)

SCALE : 1/1000 – 1/2000	DATE : SEPTEMBER 2014	DRAWING N° : WS-WK-217-A.dwg
LIBANCONSULT AGM Consulting Engineers		N° : W.S.W.K.2.1.7
		REV. A