
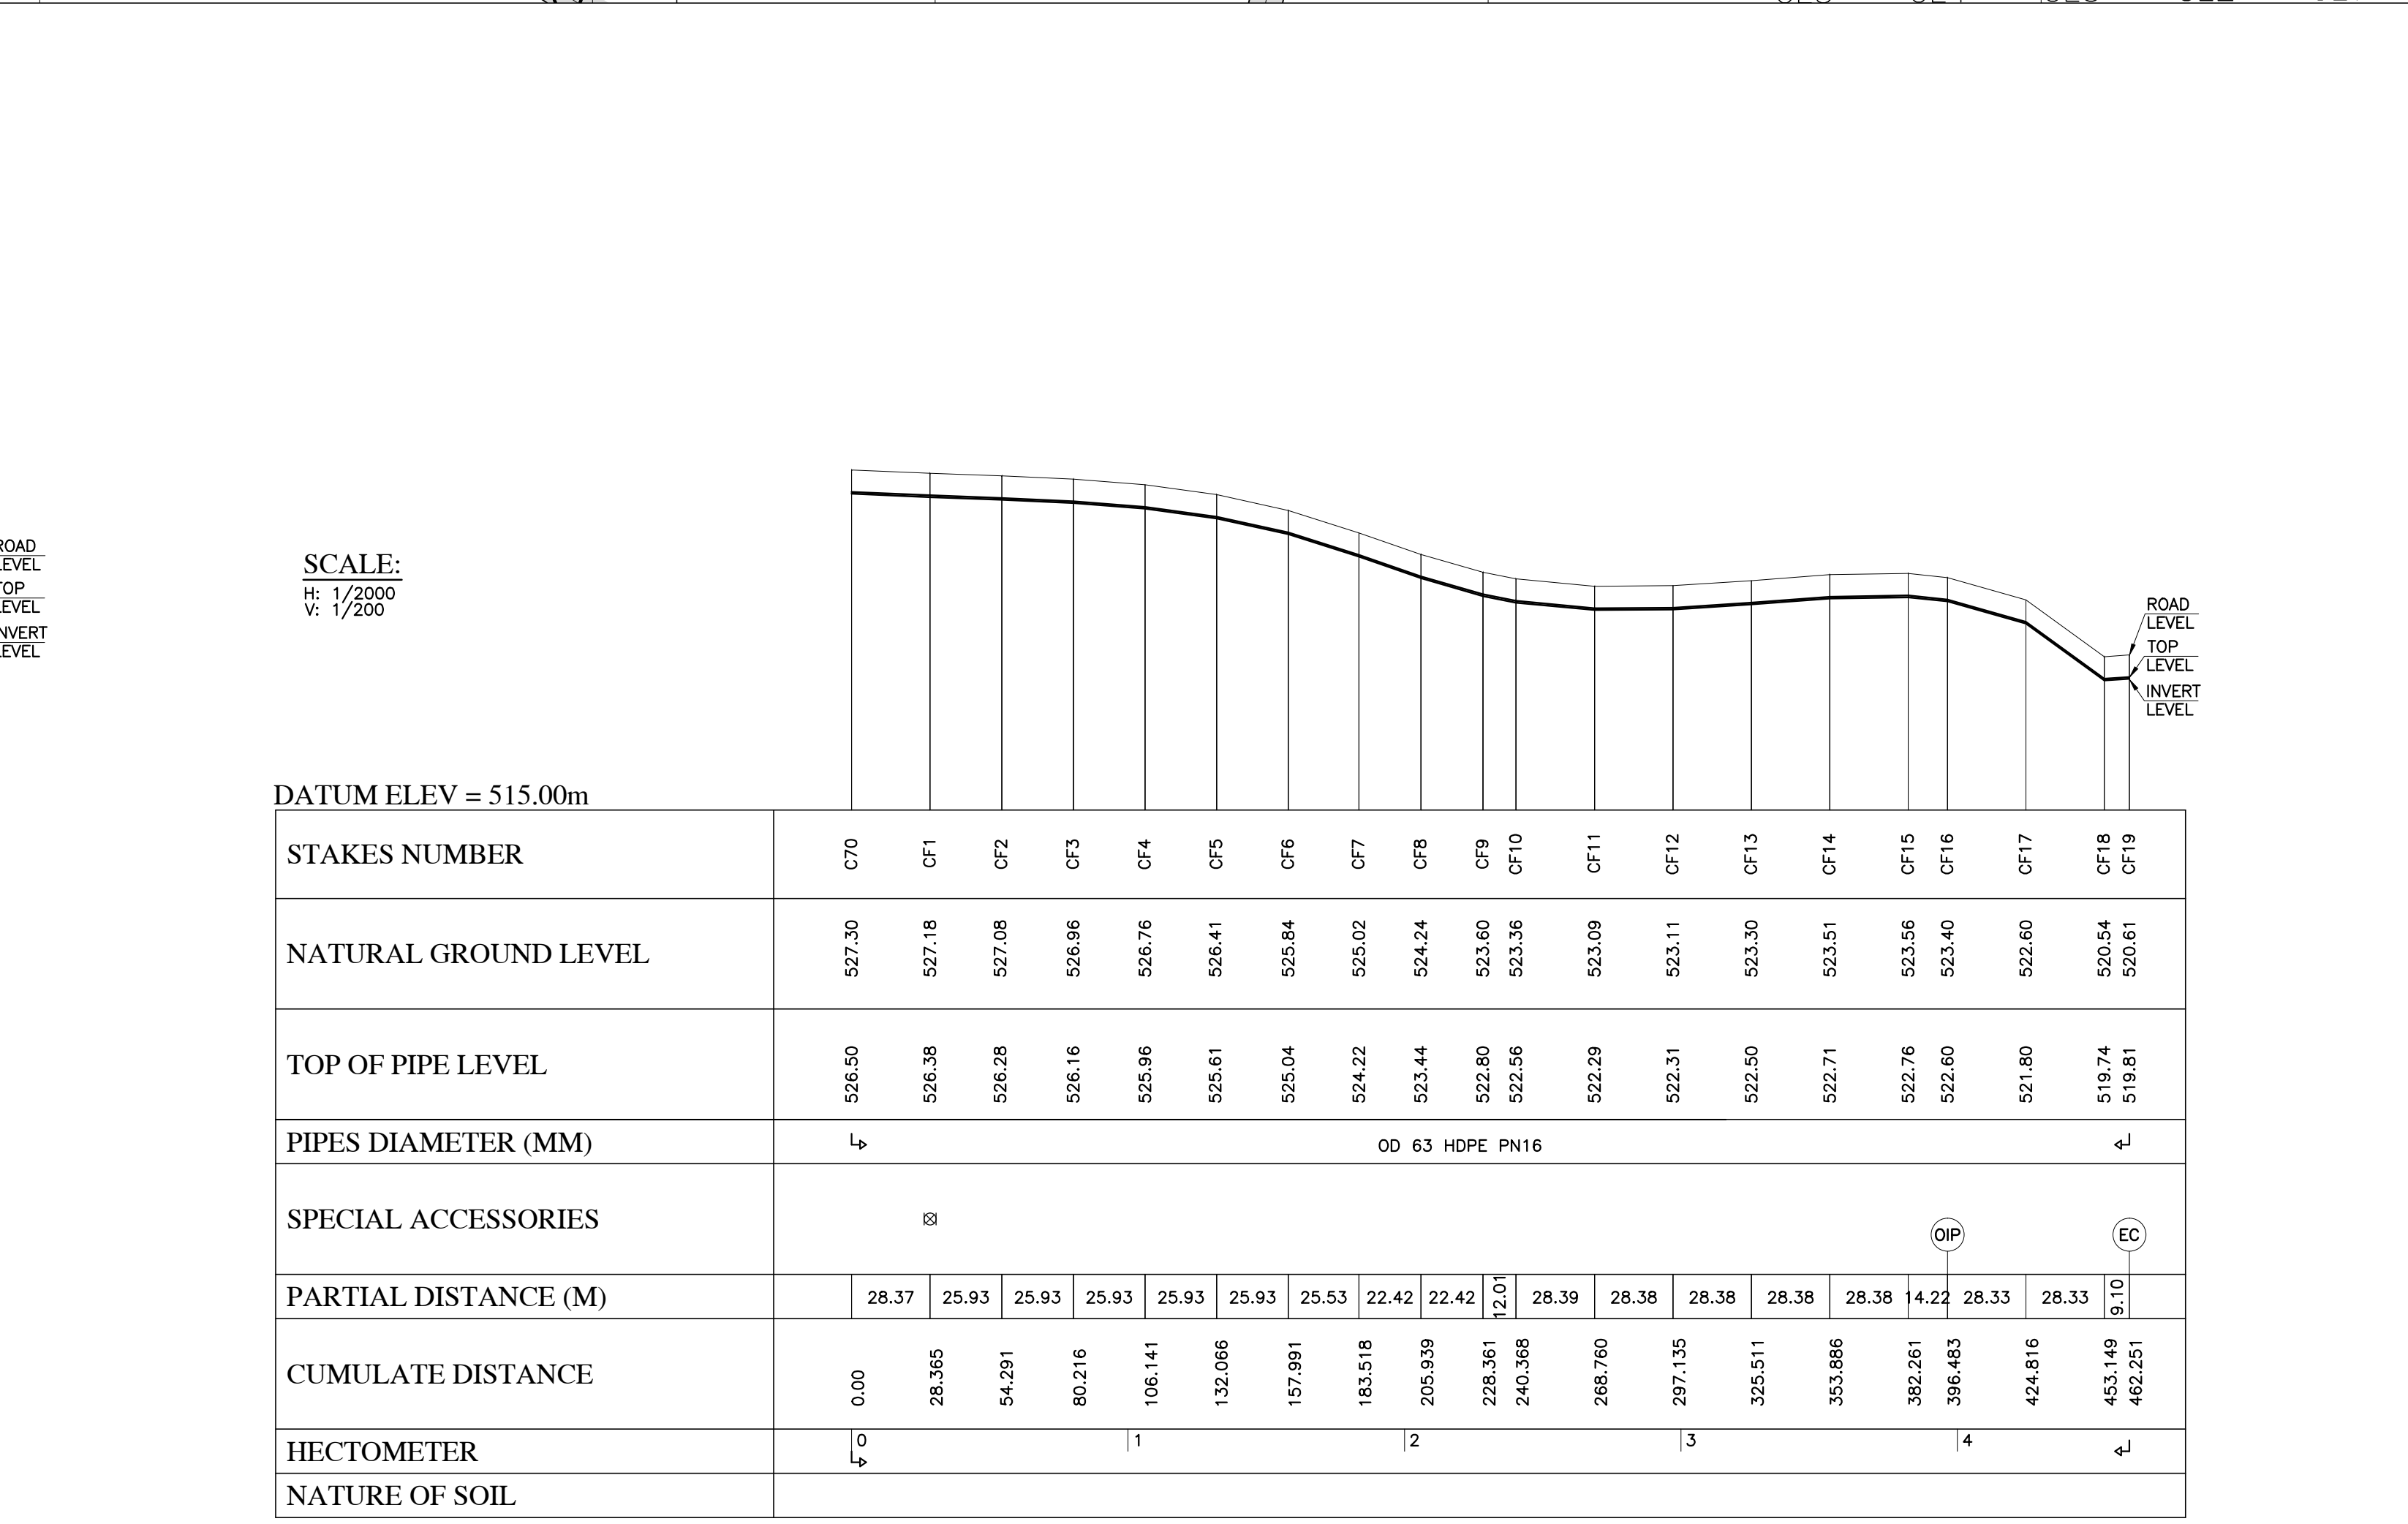
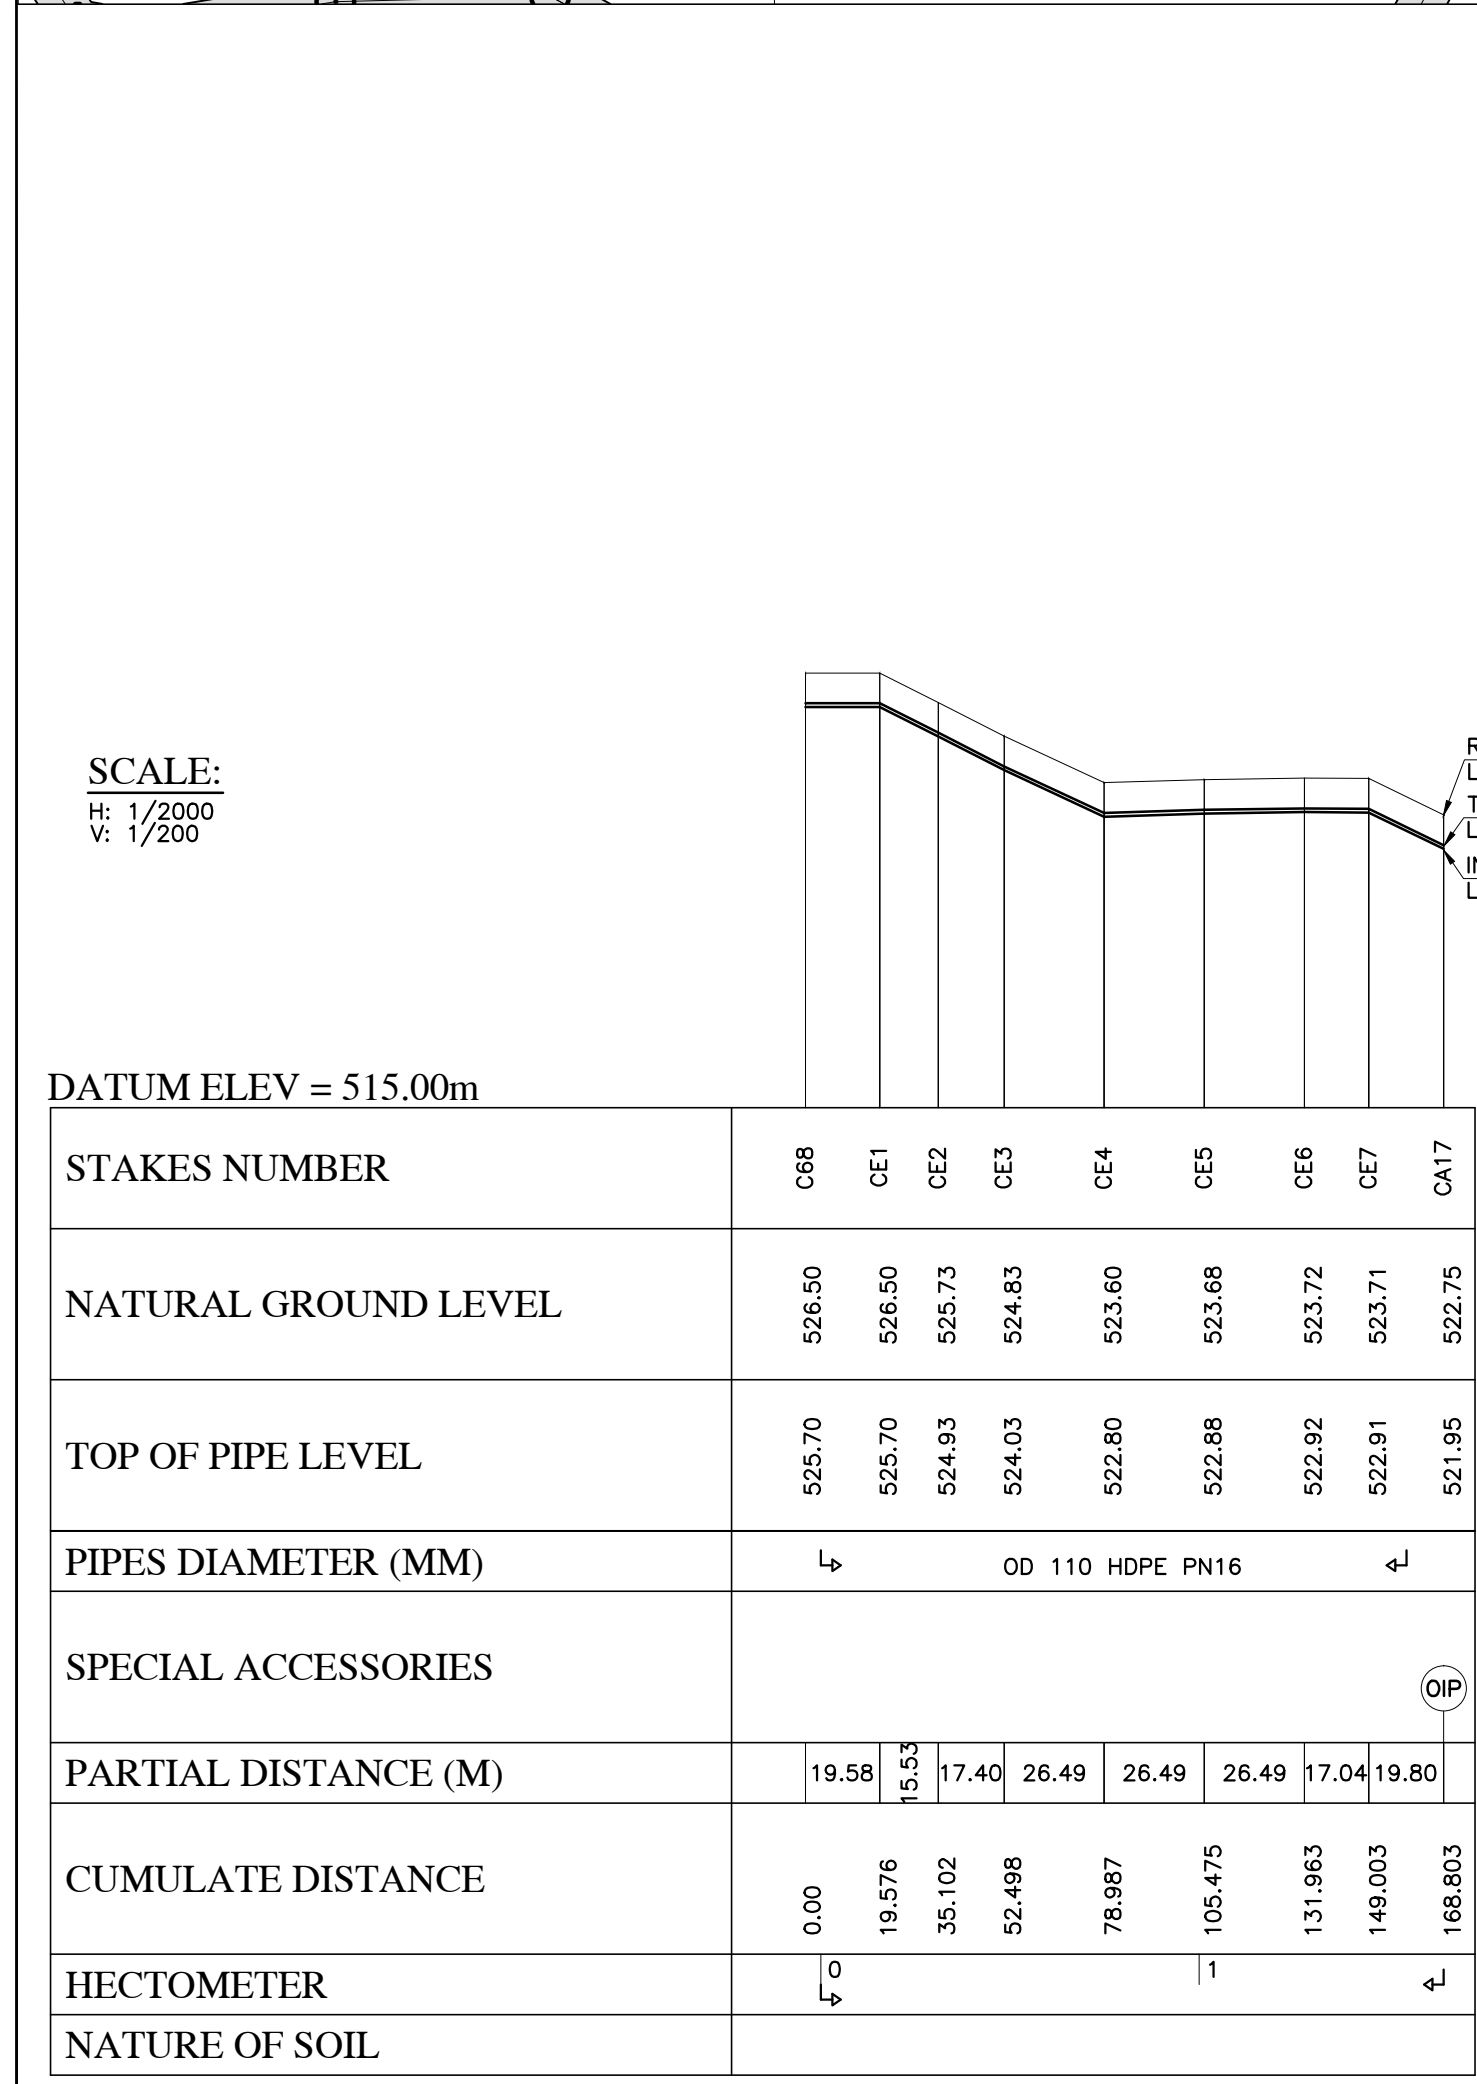

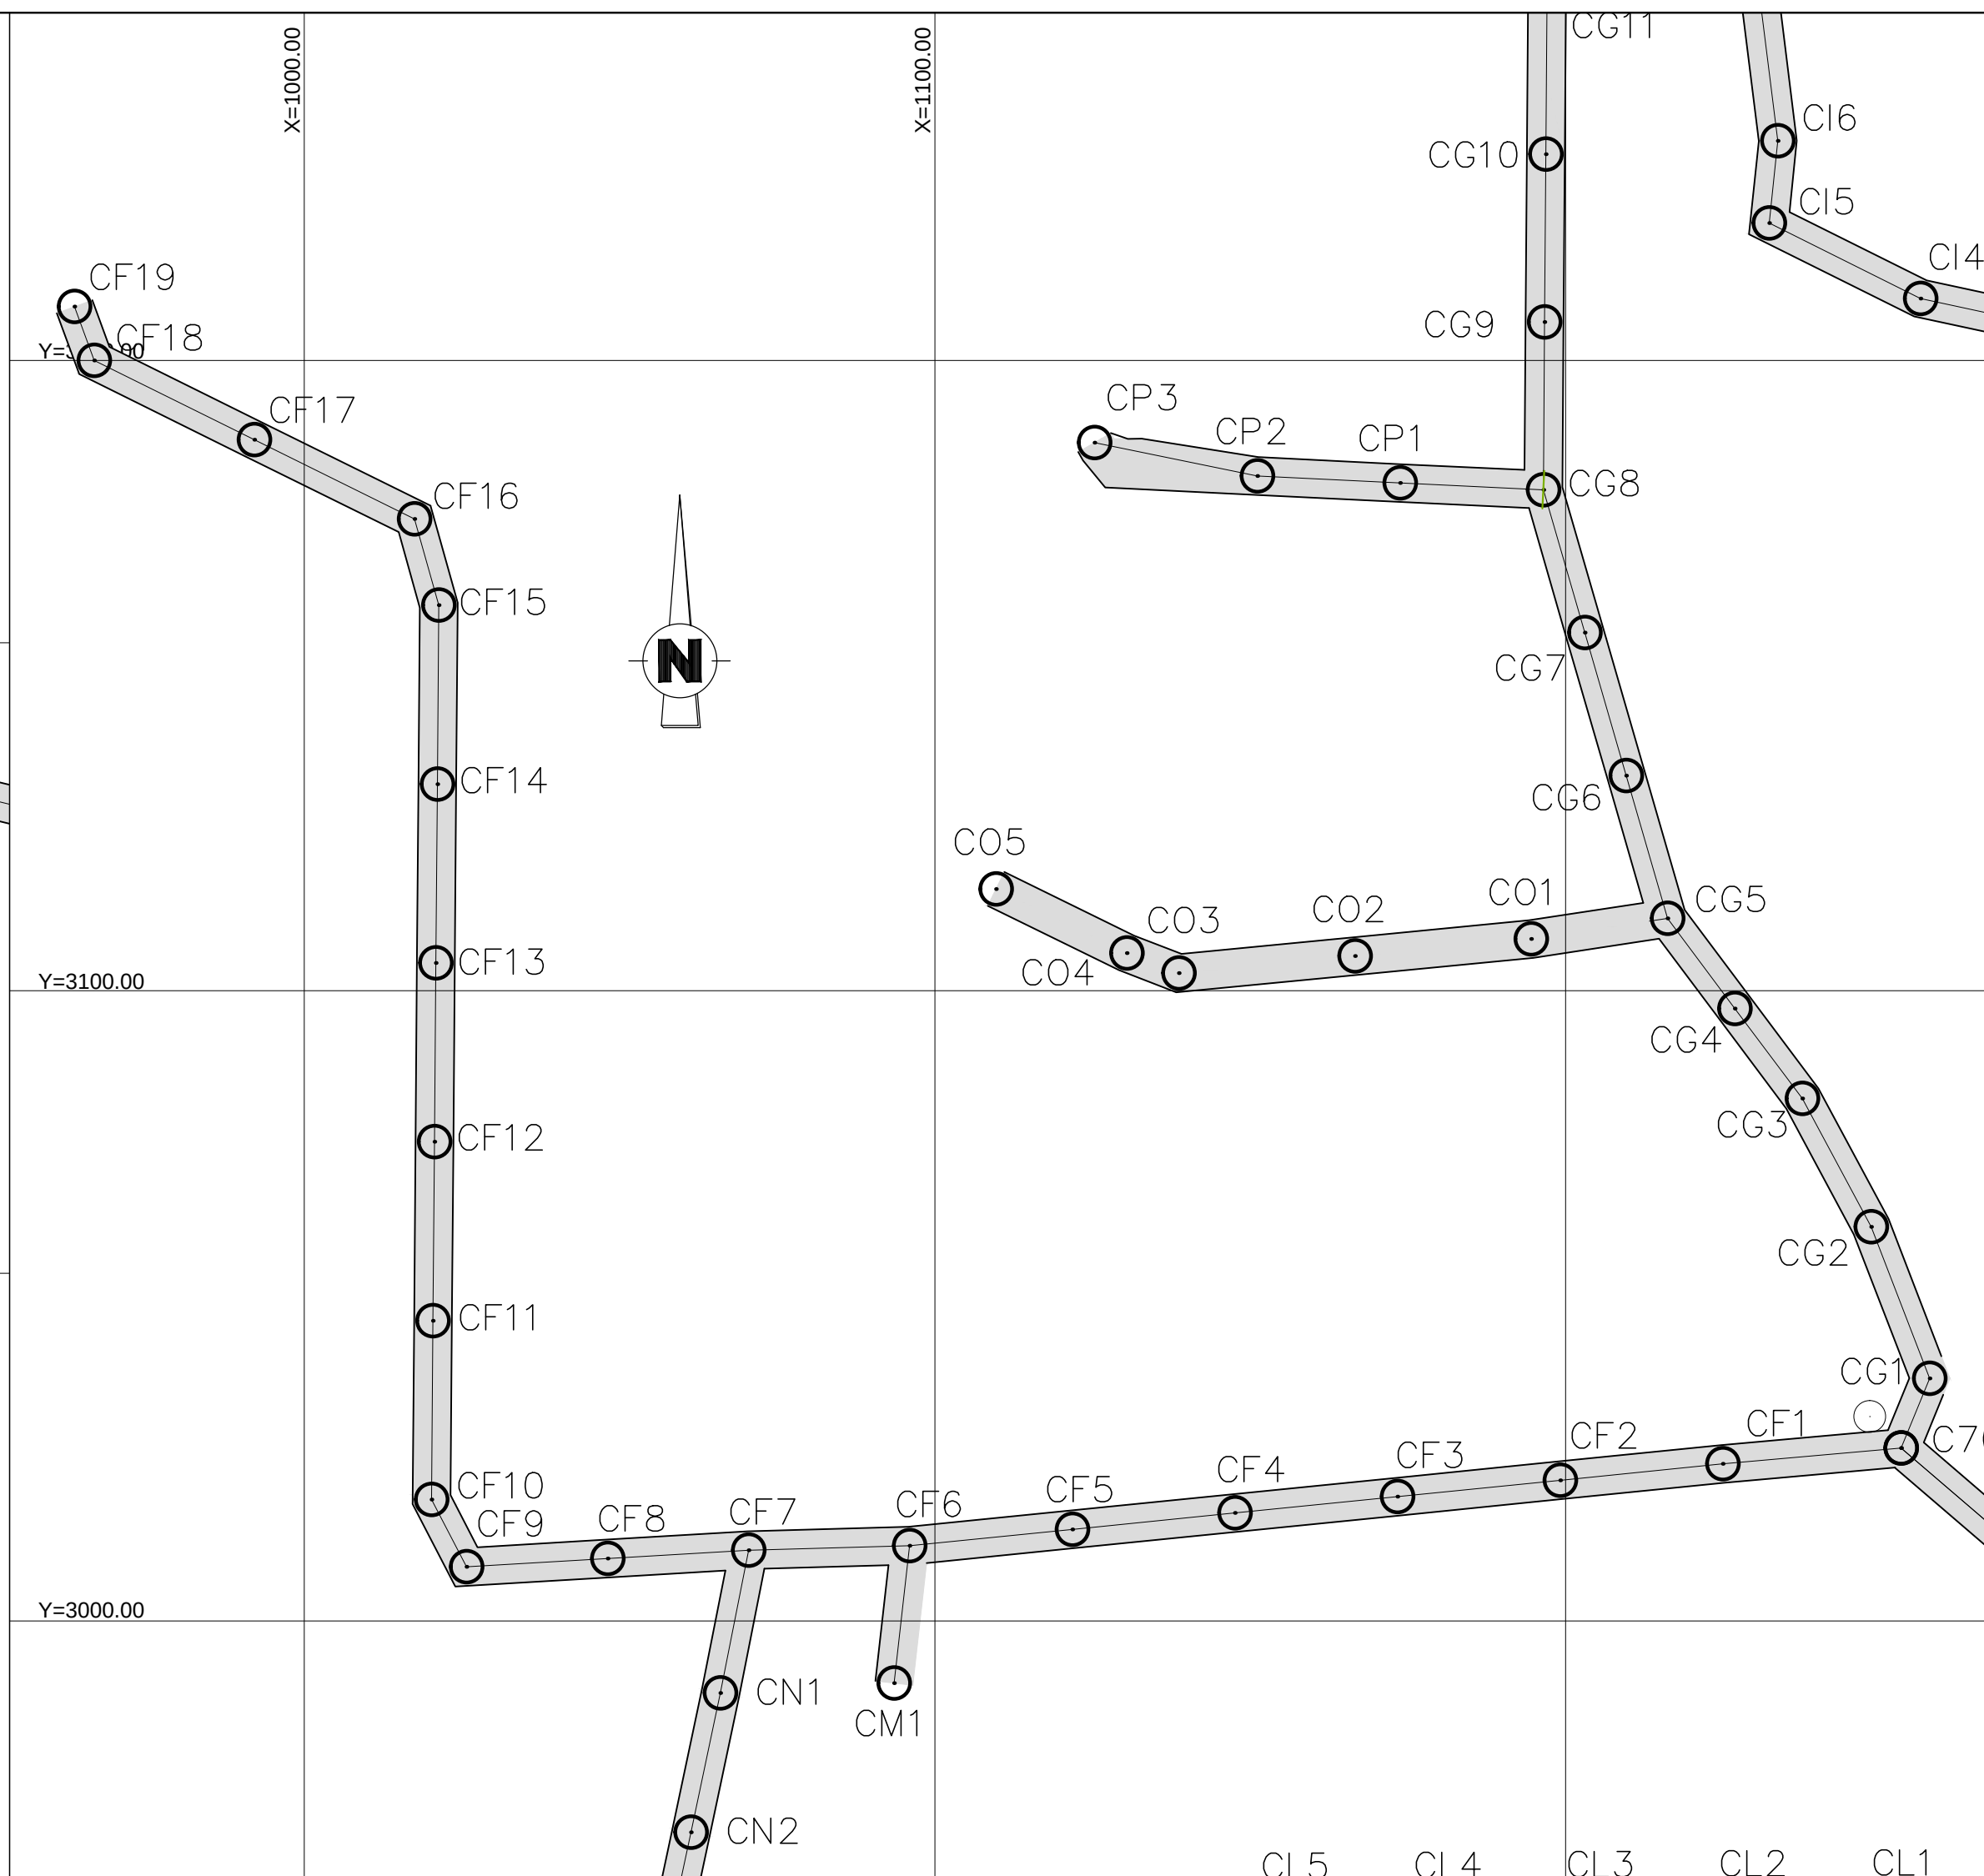


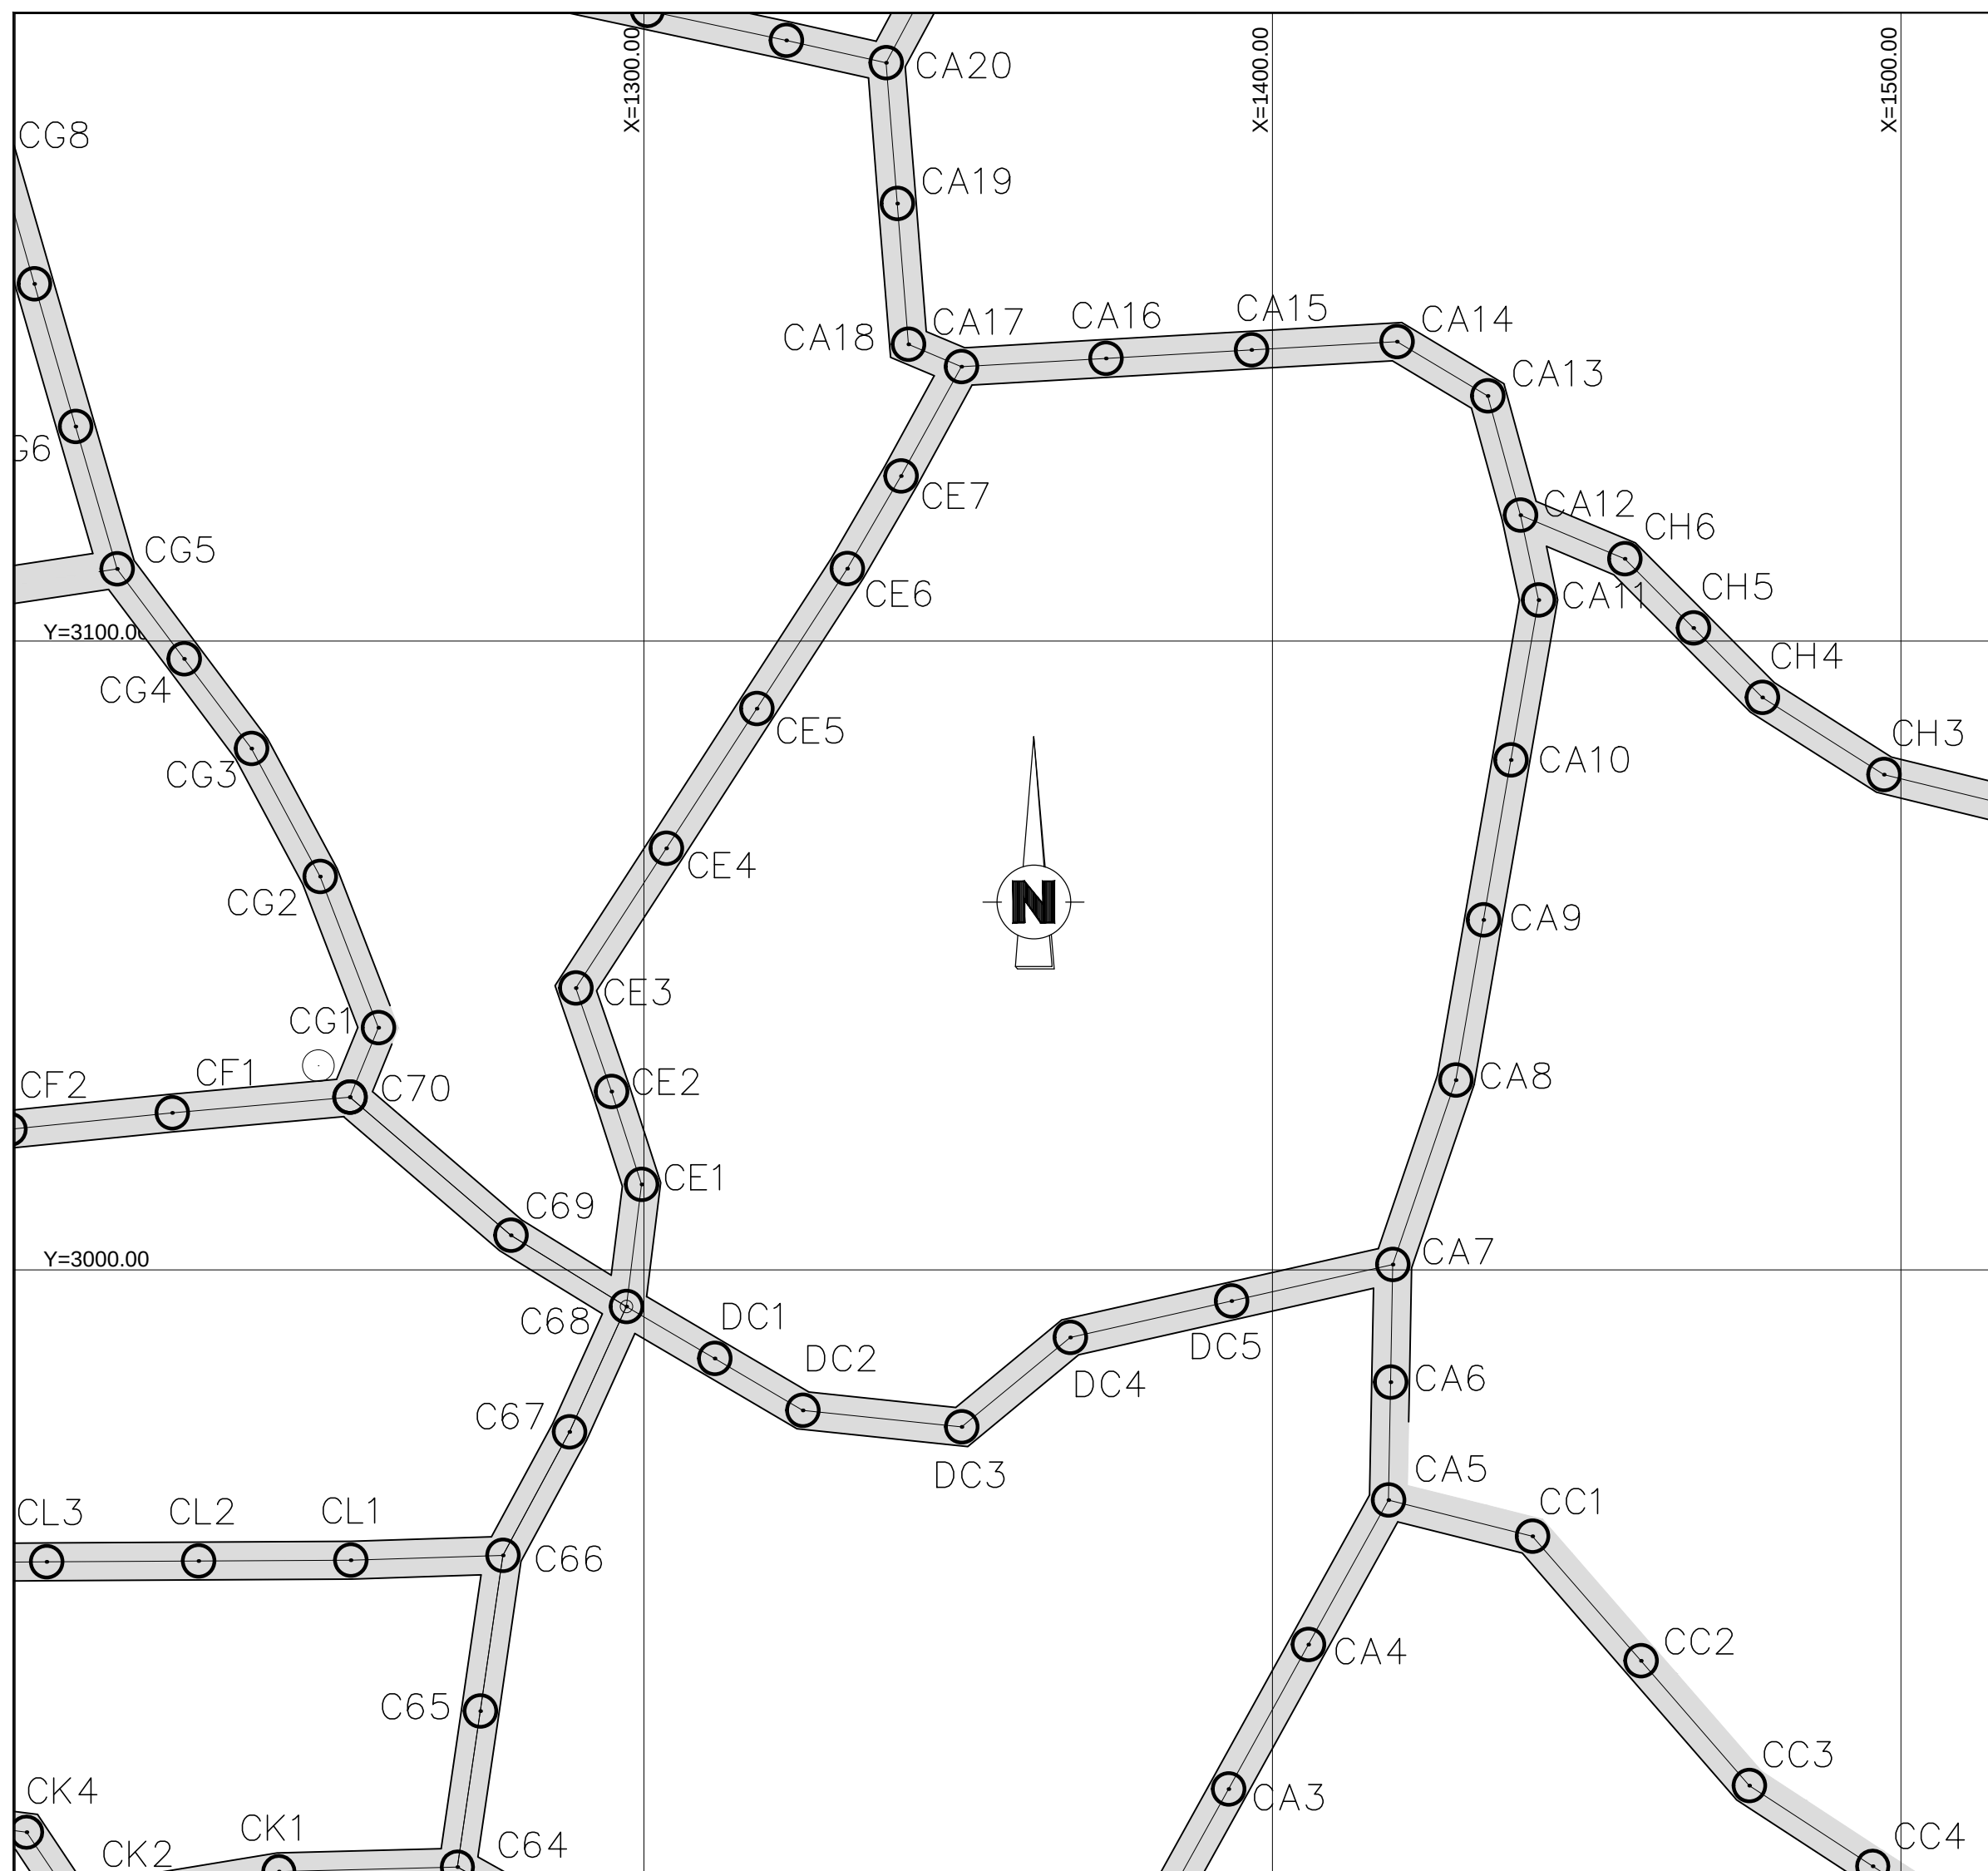

<u>LEGEND :</u>							
		WASH OUT					
		DOUBLE AIR VALVE					
		GATE VALVE					
		FIRE HYDRANT					
		OBLIGATORY INTAKE POINT					
		END CAP					

REV.	DATE	DRAWN BY	CHECKED BY	APPROVED BY	MODIFICATION	STATUTS

UNITED NATIONS DEVELOPMENT PROGRAMME

LEBANON


NORTH LEBANON WATER SUPPLY

CONSTRUCTION OF WADI KHALED 2 WATER SUPPLY SYSTEM

QARHA WATER SUPPLY SYSTEM

LINE D2.55 (CE1-CE7) & LINE D2.56 (CF1-CF19)

SCALE : 1/1000 - 1/2000	DATE : SEPTEMBER 2014	DRAWING N° : WS-WK-236-A.dwg
-------------------------	-----------------------	------------------------------



LIBANCONSULT AGM

Consulting Engineers

N° : WS.W.K.2.3.6
 REV. : A