
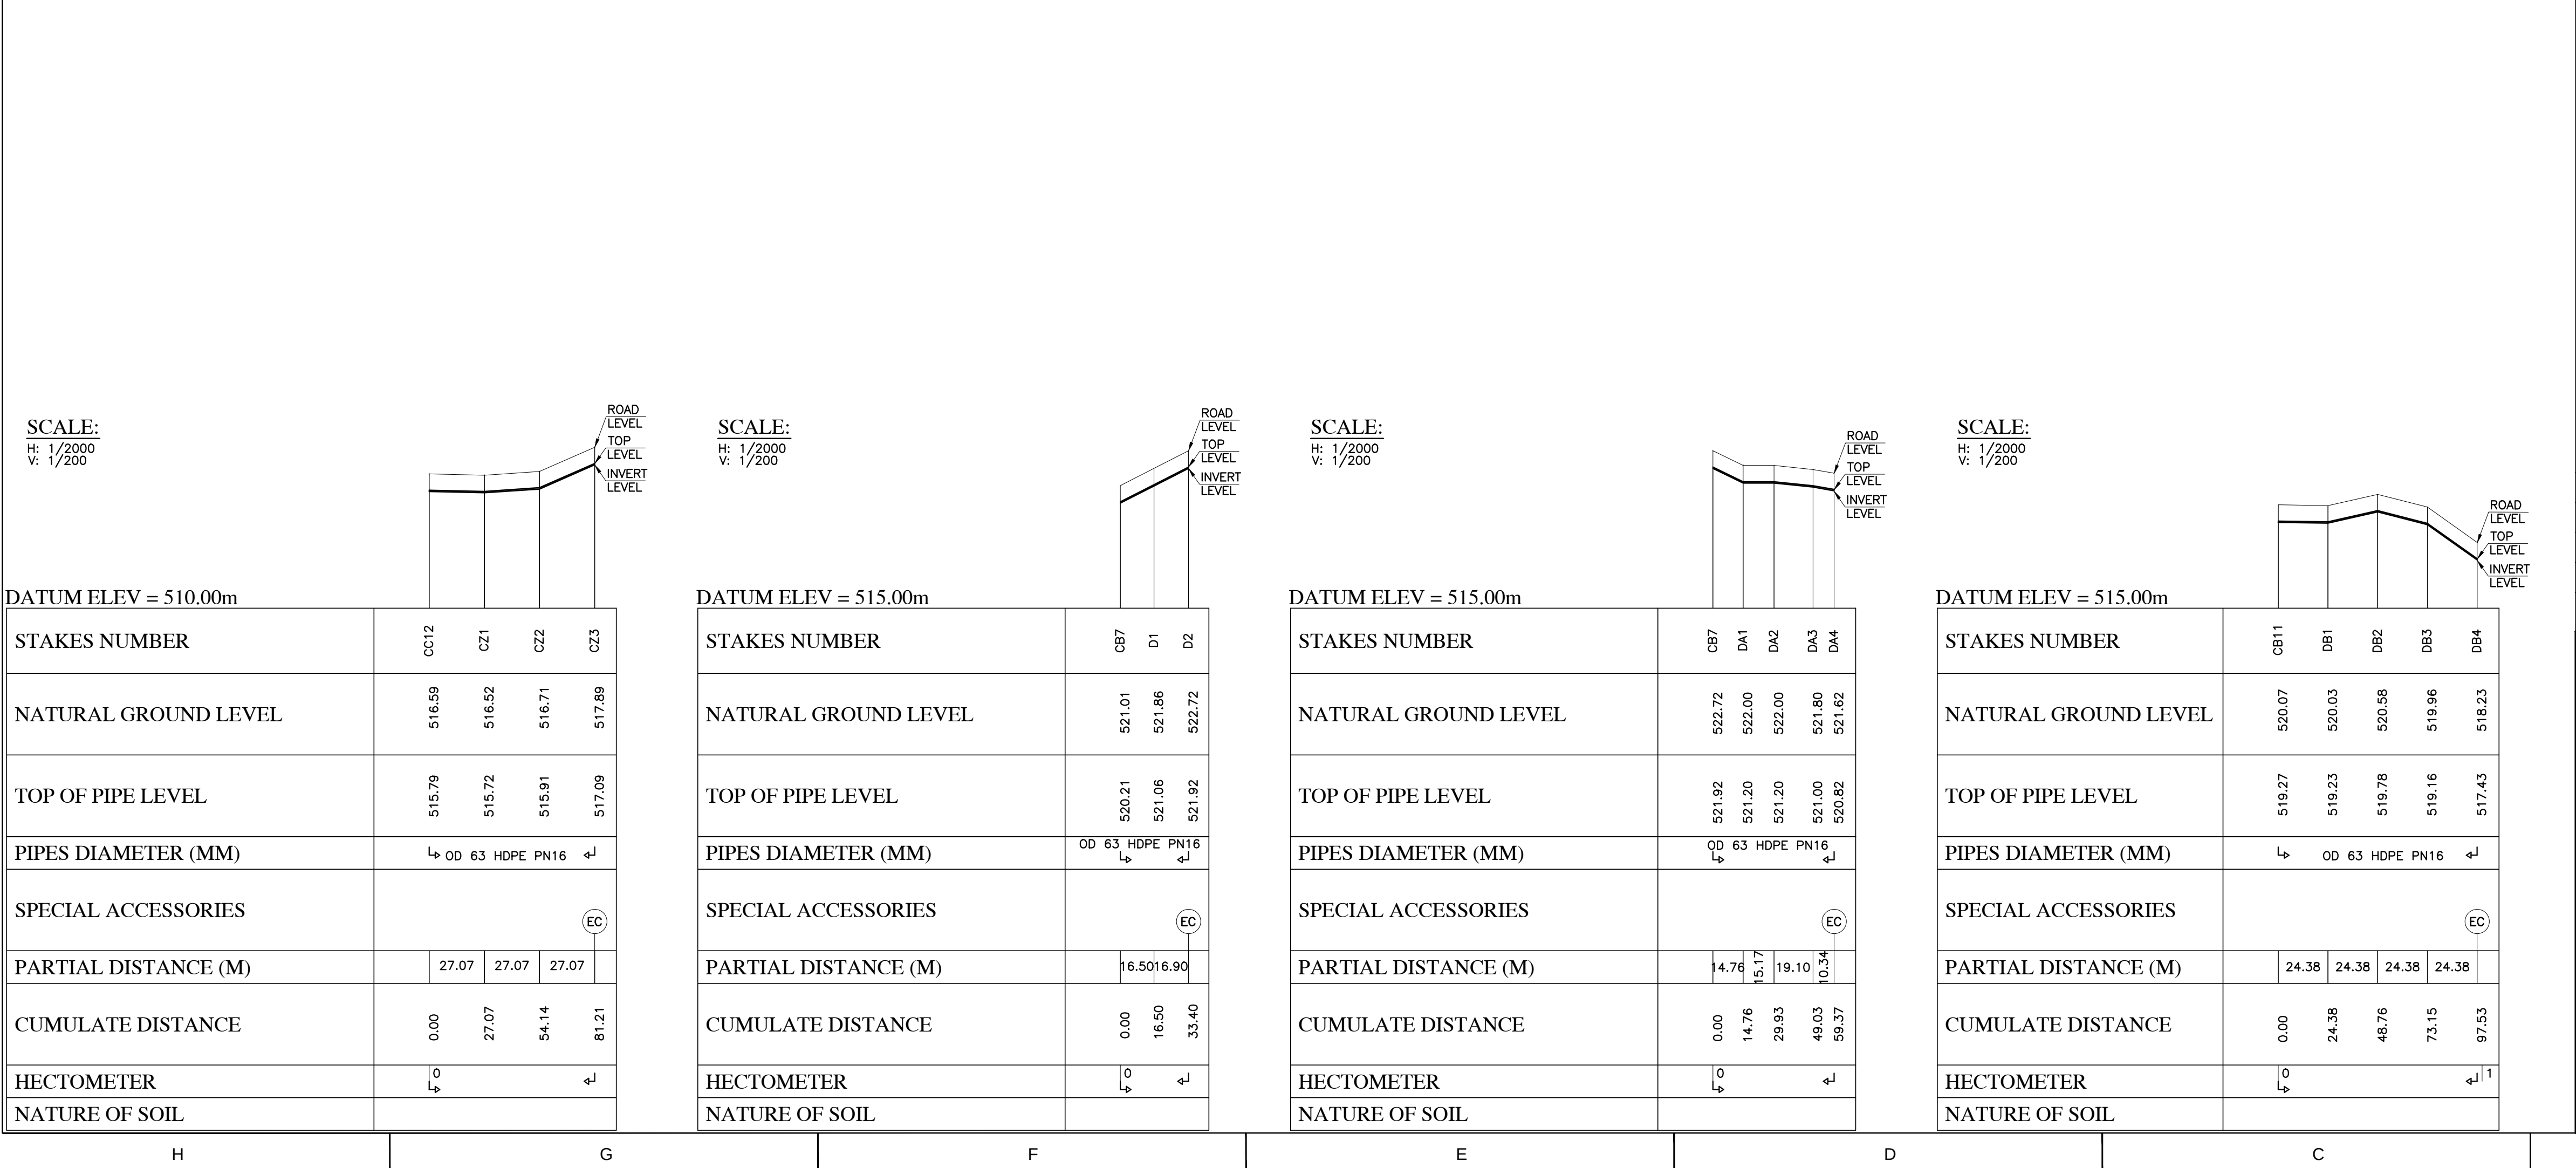


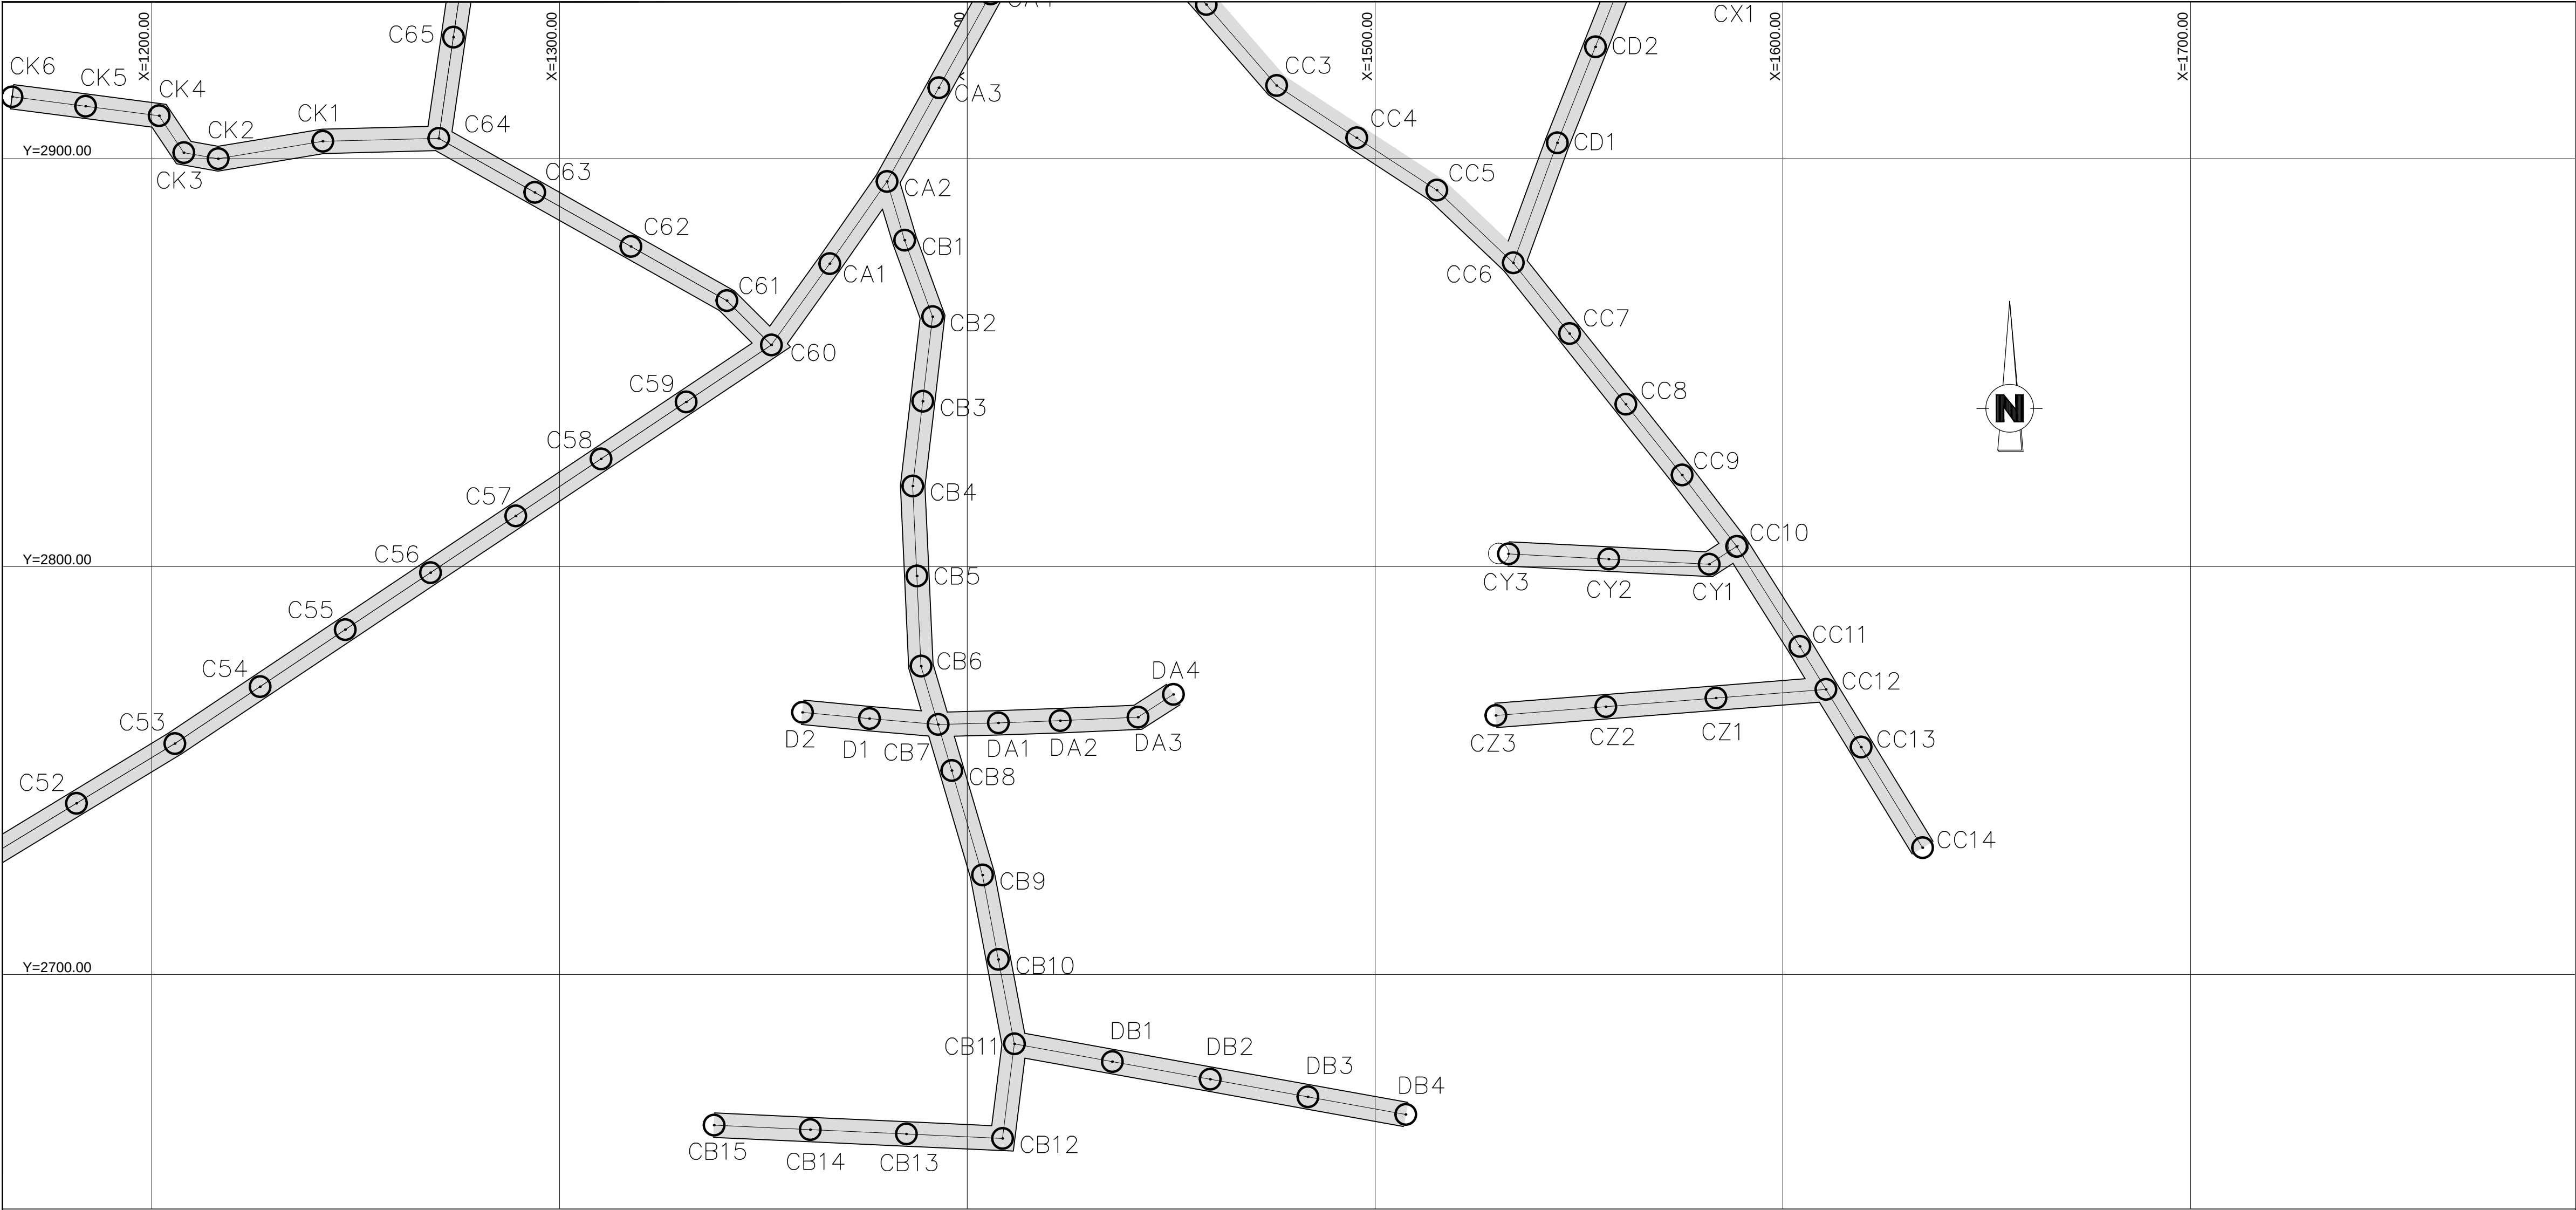

4

3

2

1

LEGEND :

W.O.

WASH OUT

D.A.V.

DOUBLE AIR VALVE

G.V.

GATE VALVE

FH

FIRE HYDRANT

OIP

OBLIGATORY INTAKE POINT

EC

END CAP

REV.	DATE	DRAWN BY	CHECKED BY	APPROVED BY	MODIFICATION	STATUTS

UNITED NATIONS DEVELOPMENT PROGRAMME

LEBANON

NORTH LEBANON WATER SUPPLY

CONSTRUCTION OF WADI KHALED 2 WATER SUPPLY SYSTEM

QARHA WATER SUPPLY SYSTEM

LINE D2.77 (CZ1-CZ3) & LINE D2.78 (D1-D2) & LINE D2.79 (DA1-DA4) & LINE D2.80 (DB1-DB.4)

SCALE : 1/1000 - 1/2000

DATE : SEPTEMBER 2014

DRAWING N° : WS-WK-244-A.dwg

LIBANCONSULT AGM
Consulting Engineers

N° : W.S.W.K.2.4.4

REV. A