



SECTION B-B

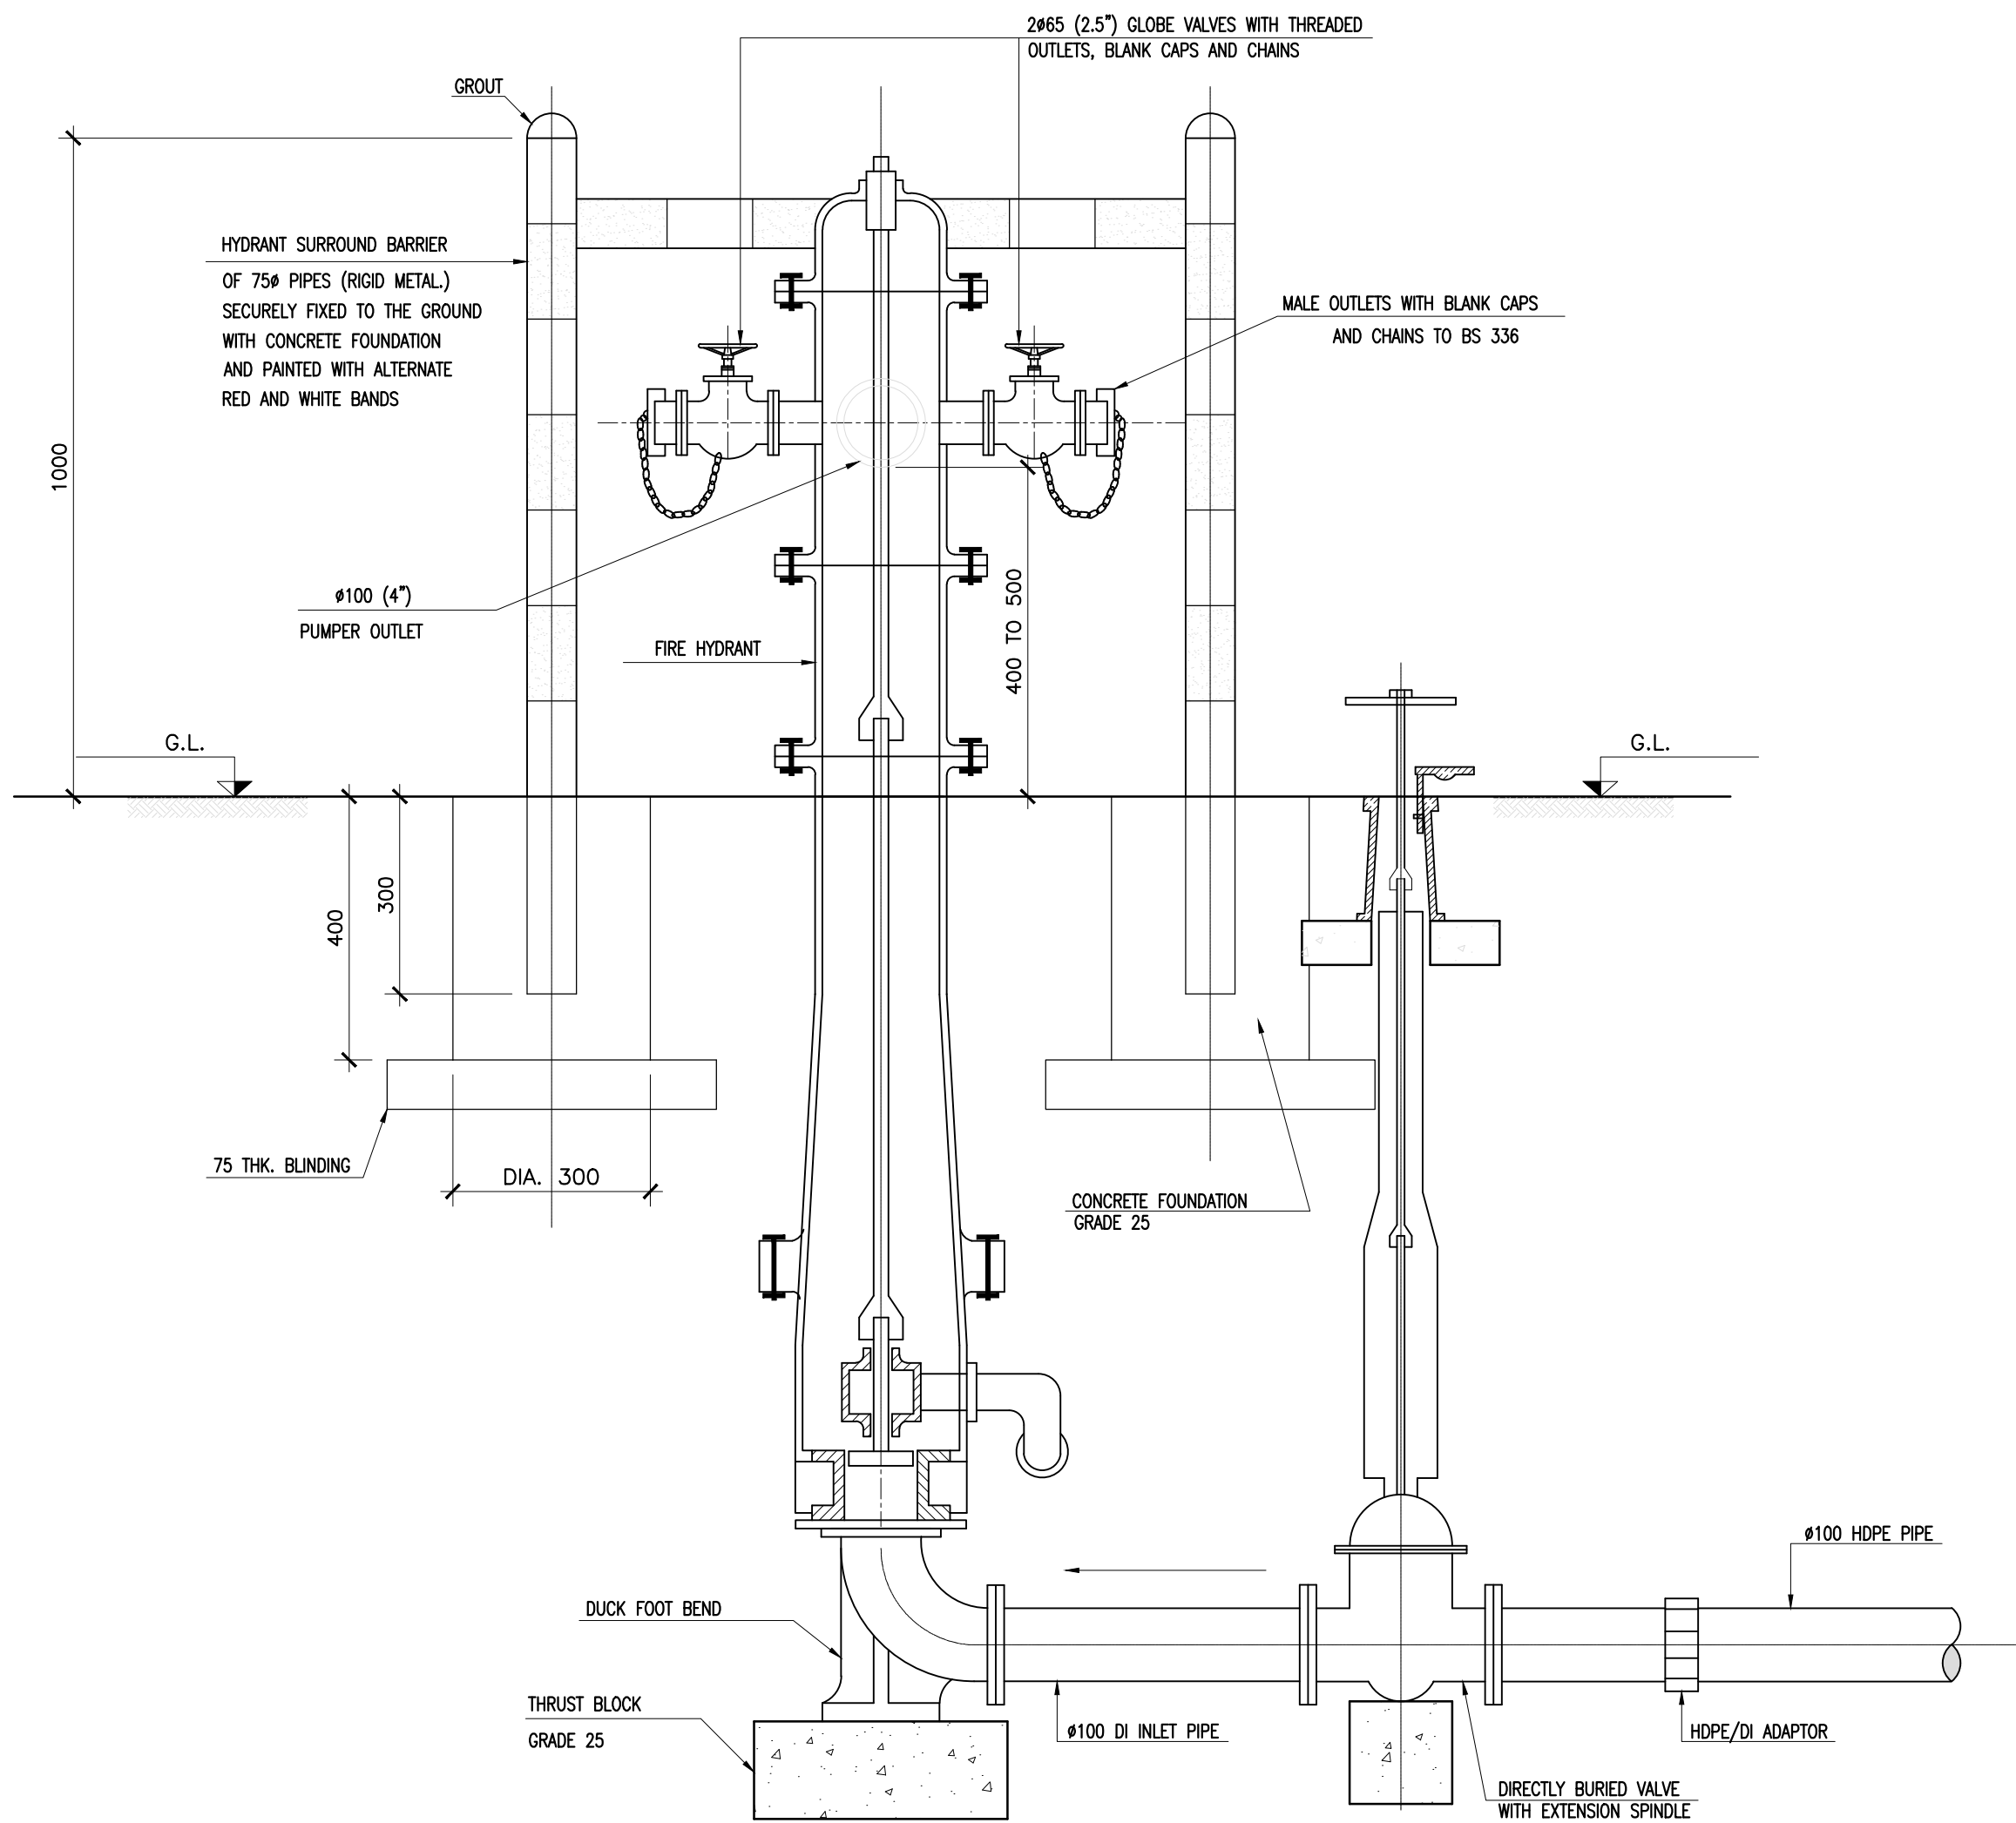

SECTION A-A

PLAN
FIRE HYDRANT

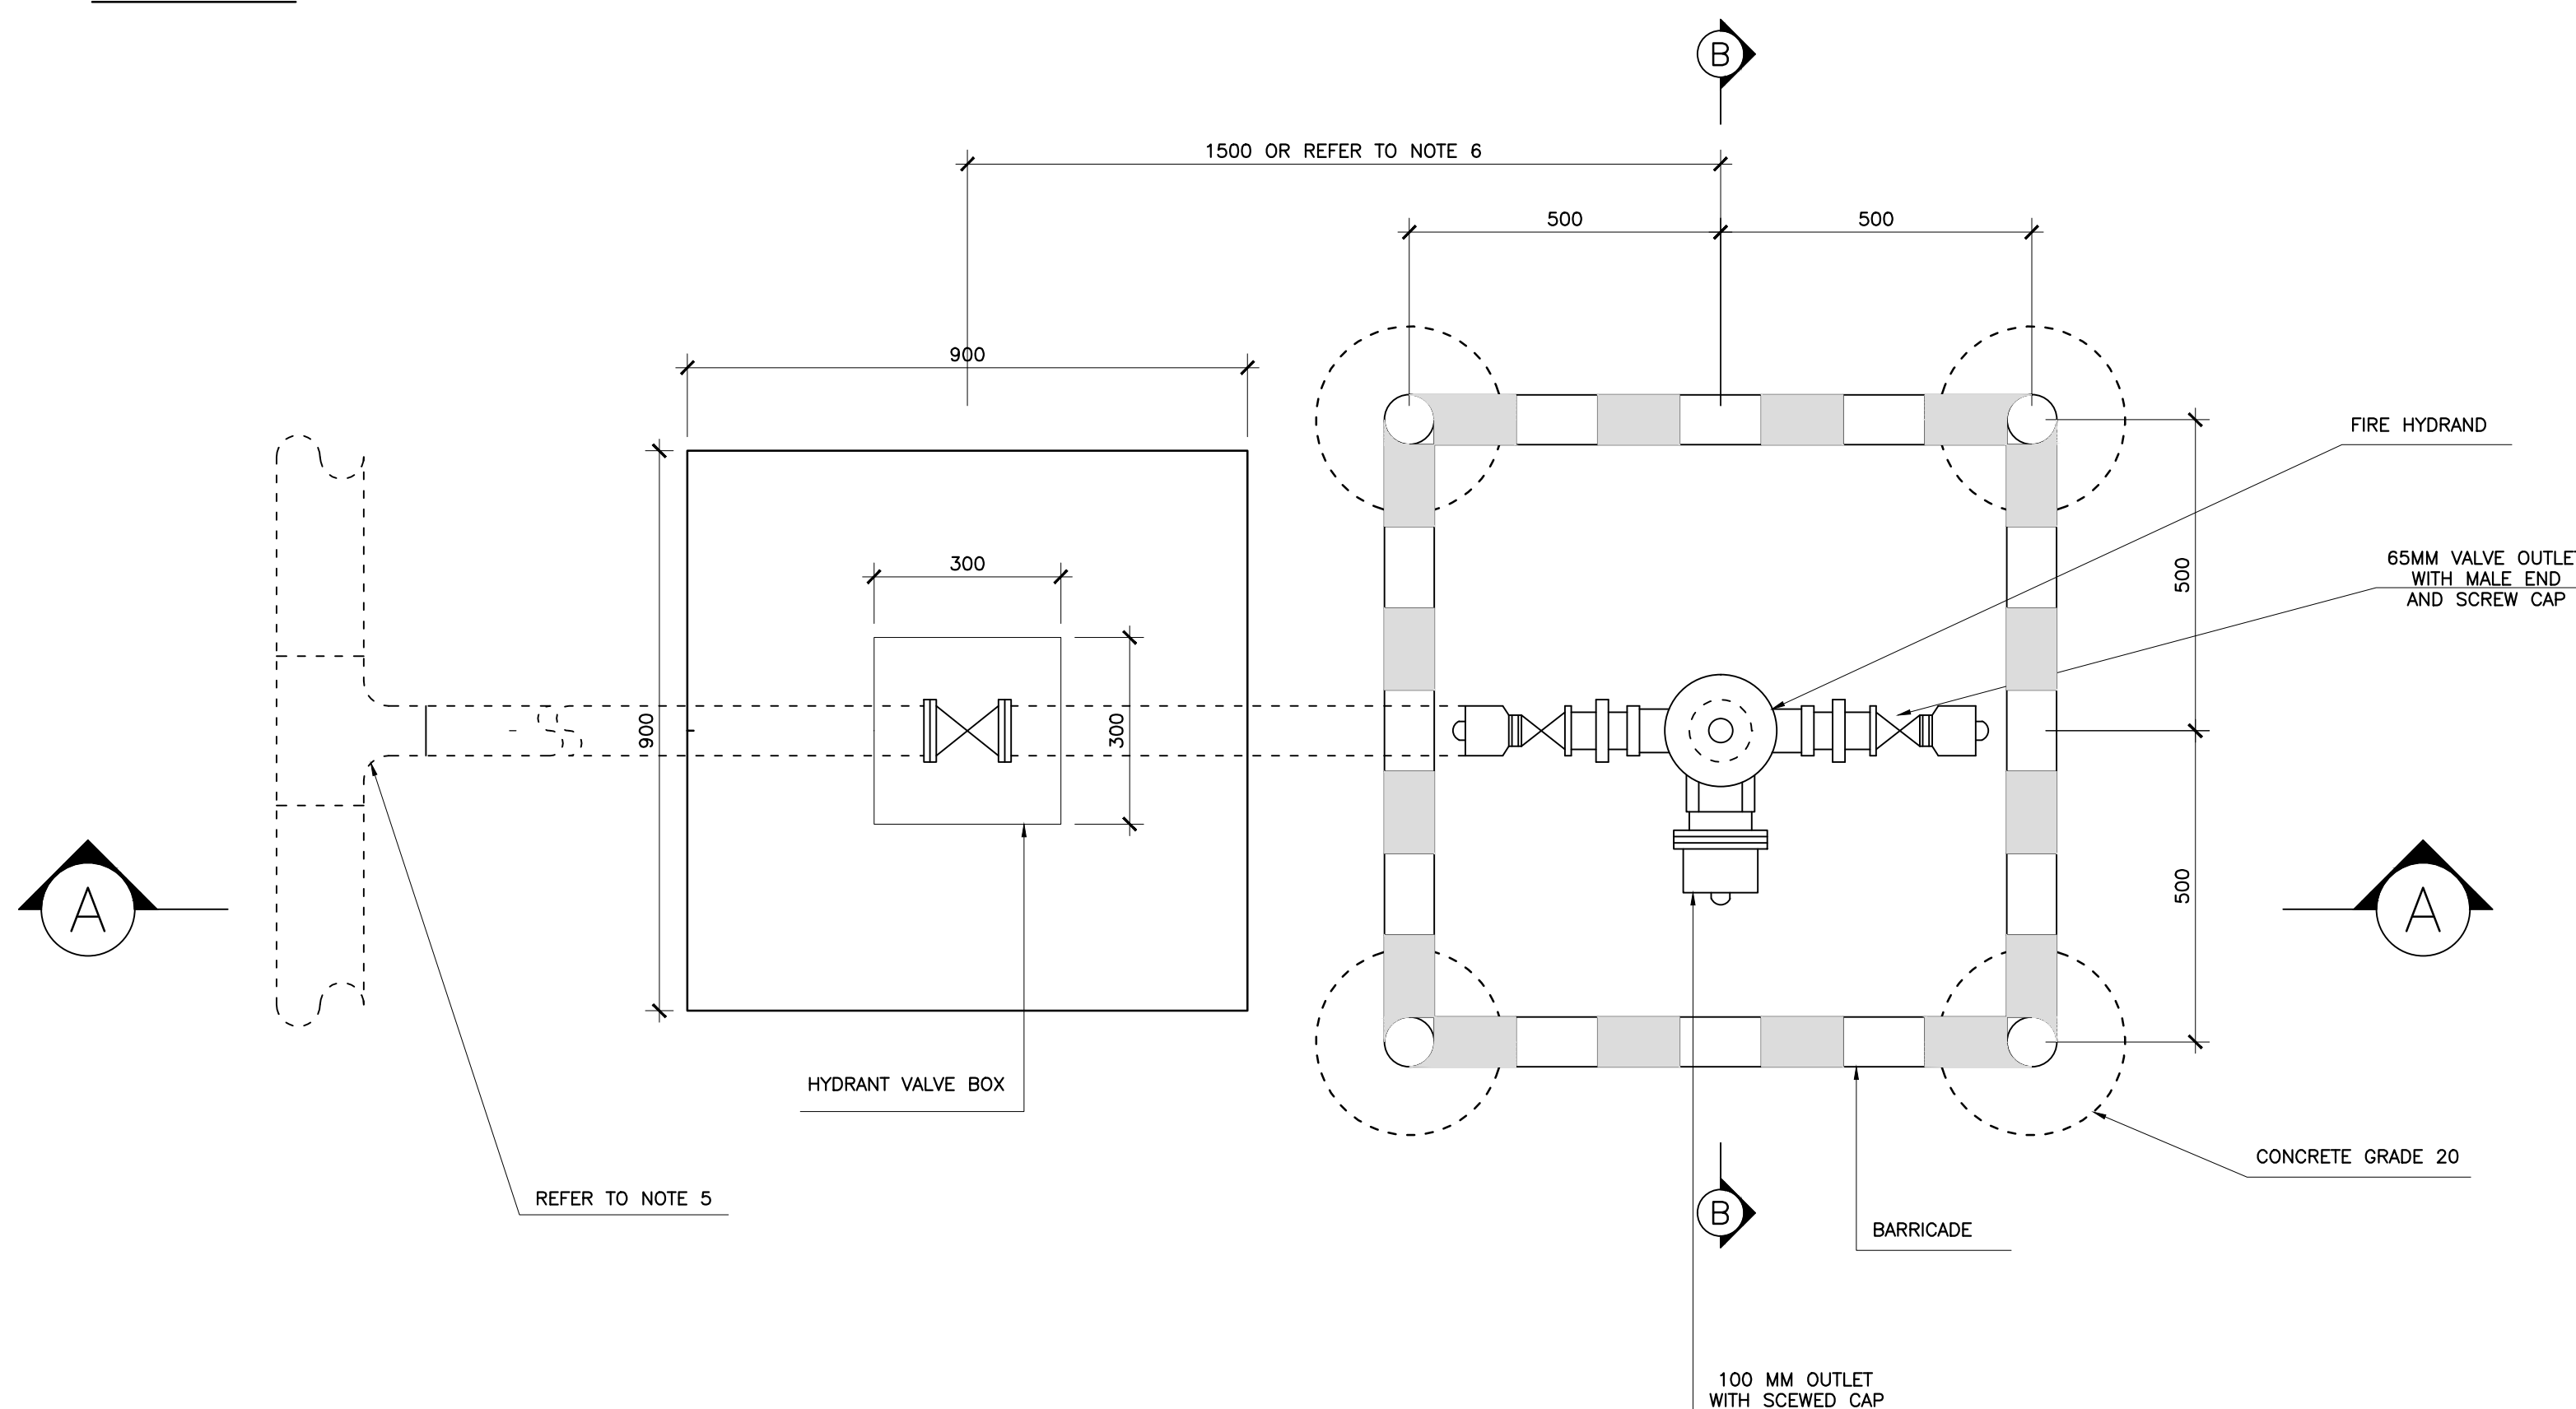

NOTES

- 1 - ALL DIMENSIONS ARE IN MM.
- 2 - CONTENT OF THIS DRAWINGS SHALL BE READ IN CONJUNCTION WITH THE RELEVANT CLAUSES OF TENDER DOCUMENTS: TECHNICAL SPECIFICATIONS.
- 3 - FOR FIRE HYDRANT, CONTRACTOR SHALL PRODUCE SHOP DRAWINGS TO BE APPROVED BY THE OMAN FIRE OFFICER.
- 4 - WHERE FIRE HYDRANT IS LOCATED AT END OF A BRANCH THE TEE SHOULD BE REPLACED BY A 90 DEGREES FLANGED BEND AND A RESTRAINED FLANGE ADAPTOR SUITABLE FOR HDPE.
- 5 - SHOP DRAWINGS IN RESPECT OF EACH LOCATION OF FIRE HYDRANT SHALL BE SUBMITTED AND APPROVED PRIOR TO PLACING ORDER FOR MATERIALS.
- 6 - EXACT LOCATION OF HYDRANT VALVE TO BE DETERMINED TO SUIT SITE CONDITIONS.

LEGEND

GL - GROUND LEVEL

REV.	DATE	DRAWN BY	CHECKED BY	APPROVED BY	MODIFICATION	STATUTS

UNITED NATIONS DEVELOPMENT PROGRAMME
LEBANON

NORTH LEBANON WATER SUPPLY
CONSTRUCTION OF WADI KHALED 2 WATER SUPPLY SYSTEM

FIRE HYDRANT
DETAILS

SCALE : -	DATE : SEPTEMBER 2014	DRAWING N° : WS-WK-261-A.dwg
-----------	-----------------------	------------------------------

LIBANCONSULT
Consulting Engineers

N° : W.S.W.K.2.6.1
REV. A