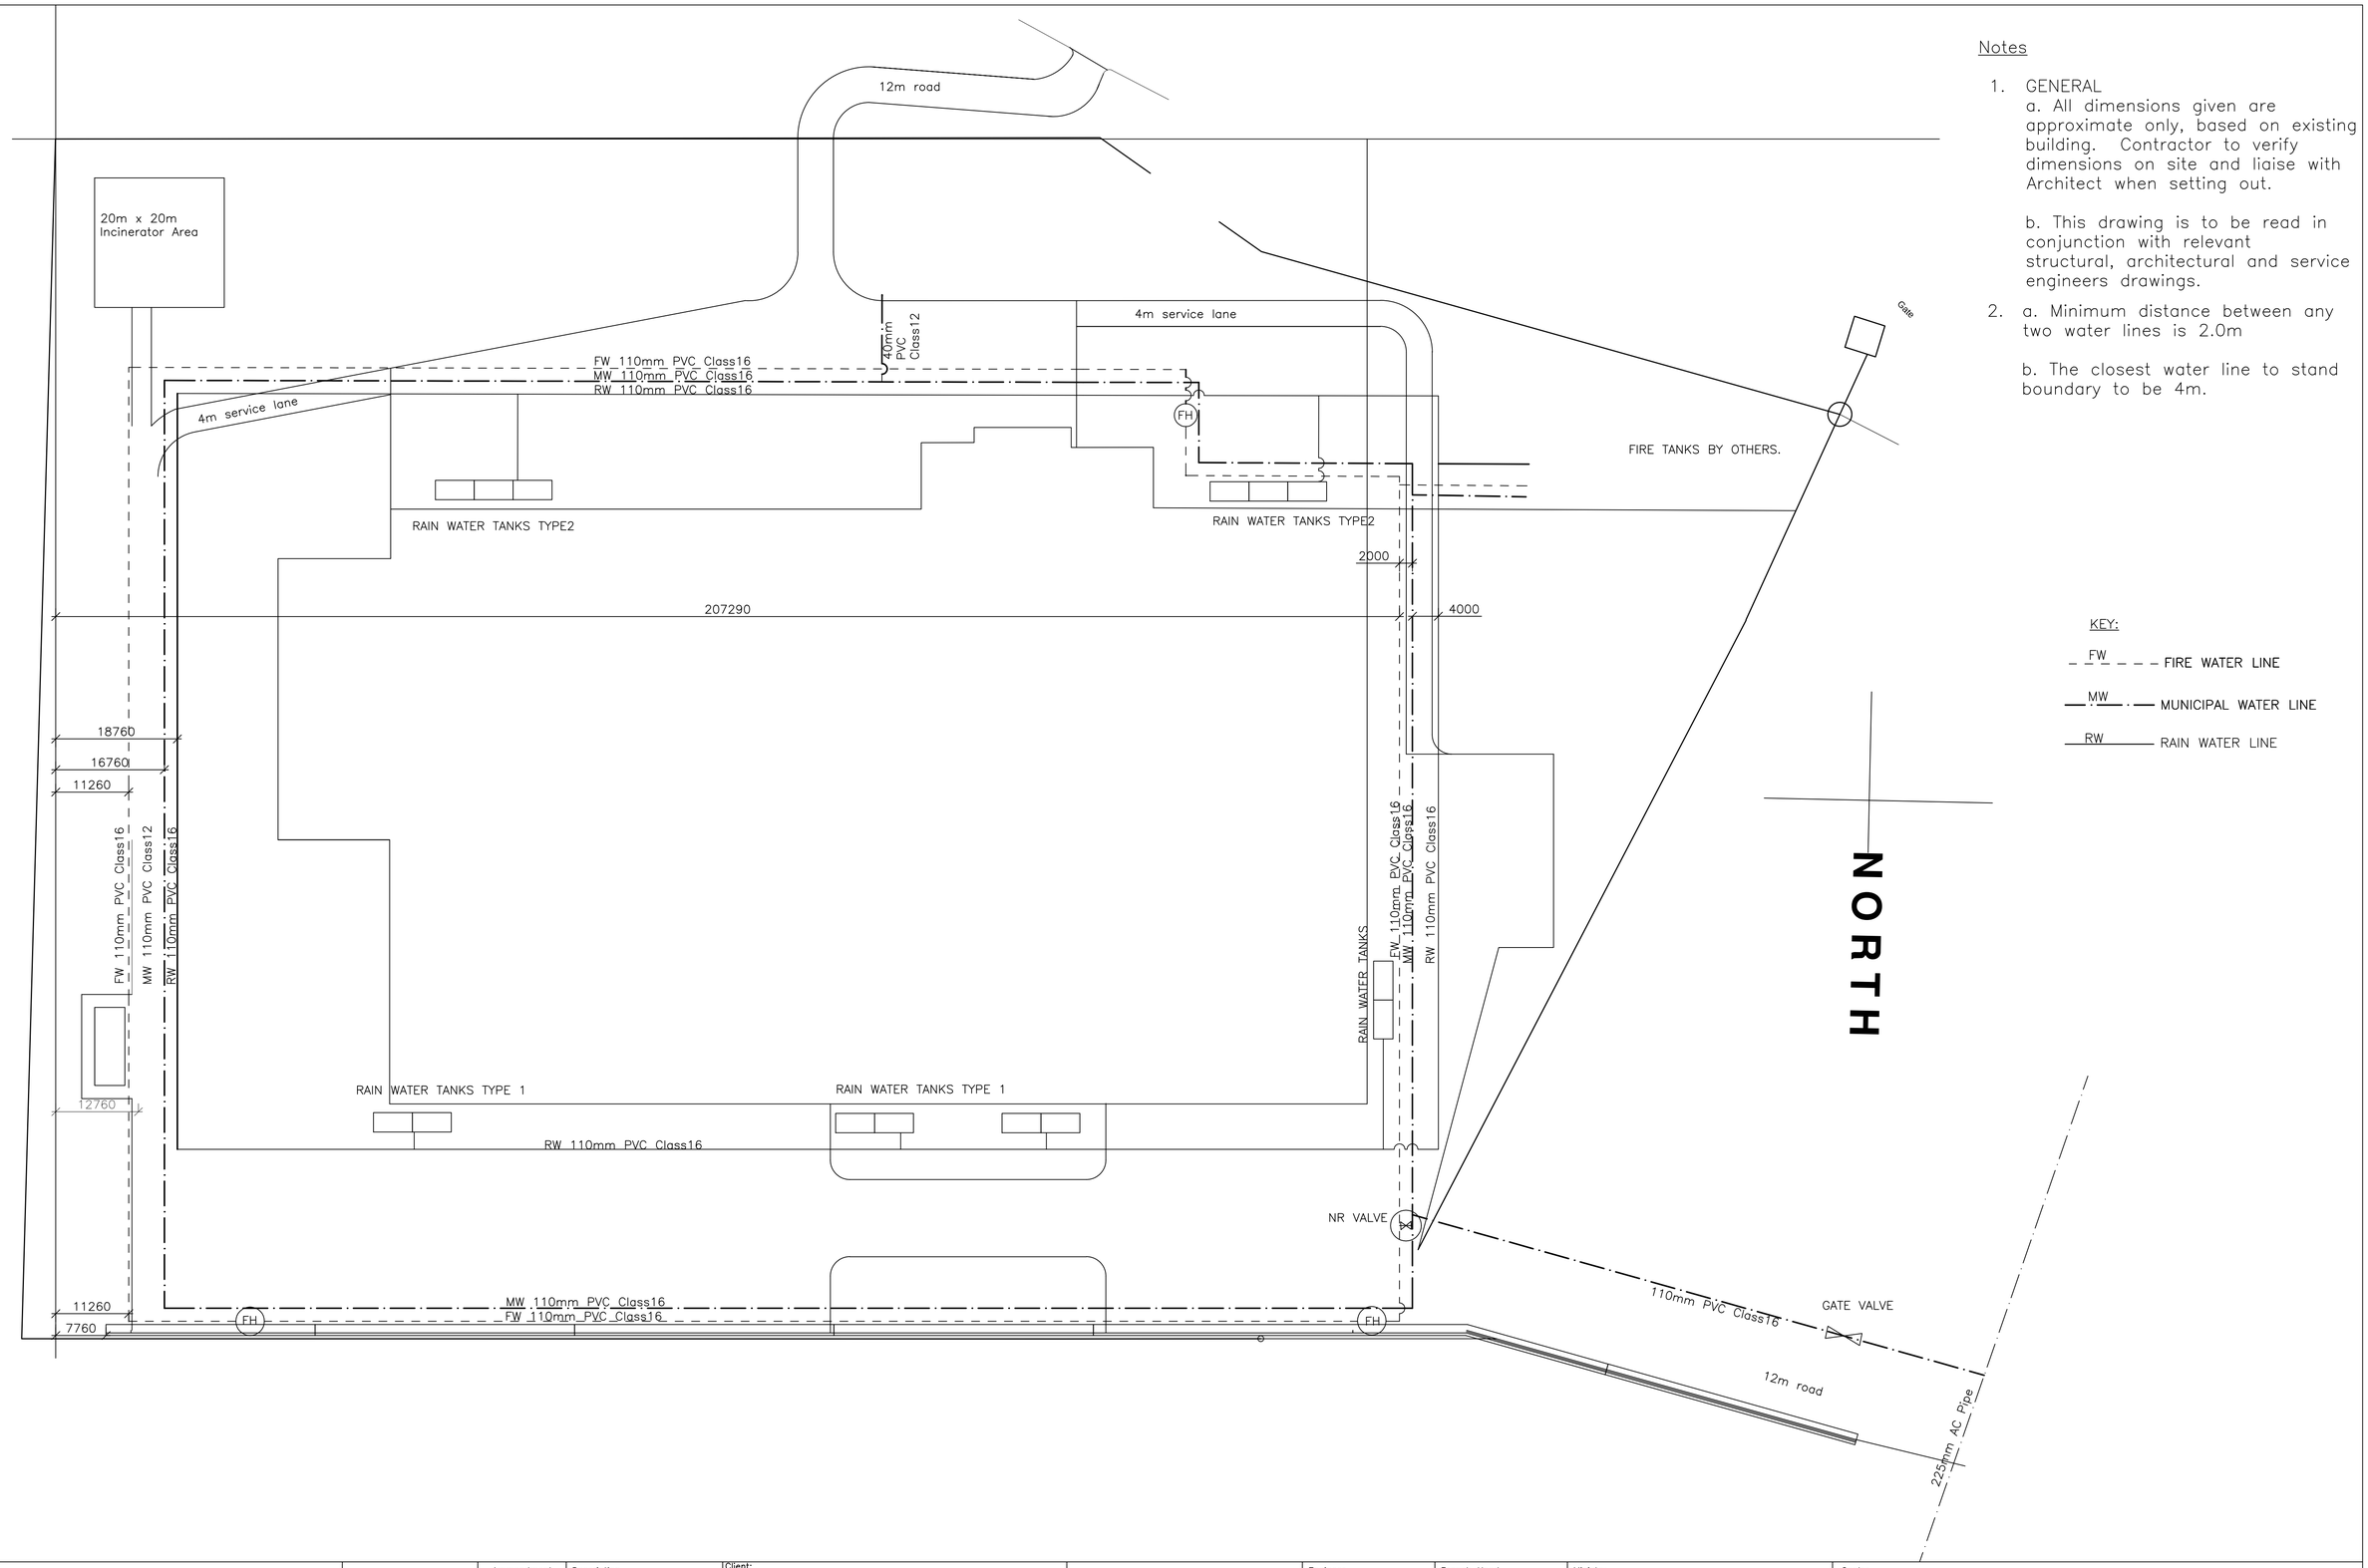

Notes

1. GENERAL
   a. All dimensions given are approximate only, based on existing building. Contractor to verify dimensions on site and liaise with Architect when setting out.

   b. This drawing is to be read in conjunction with relevant structural, architectural and service engineers drawings.
2. a. Minimum distance between any two water lines is 2.0m

   b. The closest water line to stand boundary to be 4m.

KEY:

FW — — — FIRE WATER LINE

MW — · — MUNICIPAL WATER LINE

RW ——— RAIN WATER LINE

No. 14 Fereday Drive
Eastlea, HARARE
P O Box UA 287 Union Avenue
HARARE
Zimbabwe

CGM Consulting Engineers (Pvt) Ltd

Tel: +263-4-747122/255,778801
Fax: +263-4-747824
Cell: 0772 545893 / 0774 164142
admin@cgmengineers.co.zw

Drawing No. 1601 C103-1

Revision —

Ammendment			Description
Lttr.	Date	Init.	

Micro-Film Drg. No.

Client: NatPharm — Access to Affordable Quality Medicines

MINISTRY OF LOCAL GOVERNMENT, PUBLIC WORKS AND NATIONAL HOUSING, MAKOMBE BUILDING, PRIVATE BAG 7706,CAUSEWAY, HARARE

TELEPHONE 704561

Engineer	CGM	Branch Head	Mr. Njome
Designed	CGM	Scale	1:500 on A1
Drawn	CGM	Date	February 2016
Checked	CGM	File Ref.	

Ministry Department	Health and Child Care	Centre	Harare
Title	Proposed NatPharm Distribution Centre on Stand 3163, Southerton, Lobengula Road		
Description	Water Reticulation Layout		
Stock Dwg. No.	G.P. No.	Proj No.	Amidt Lttr. —