


Borehole with concrete Apron, Wall and Drainage Channel

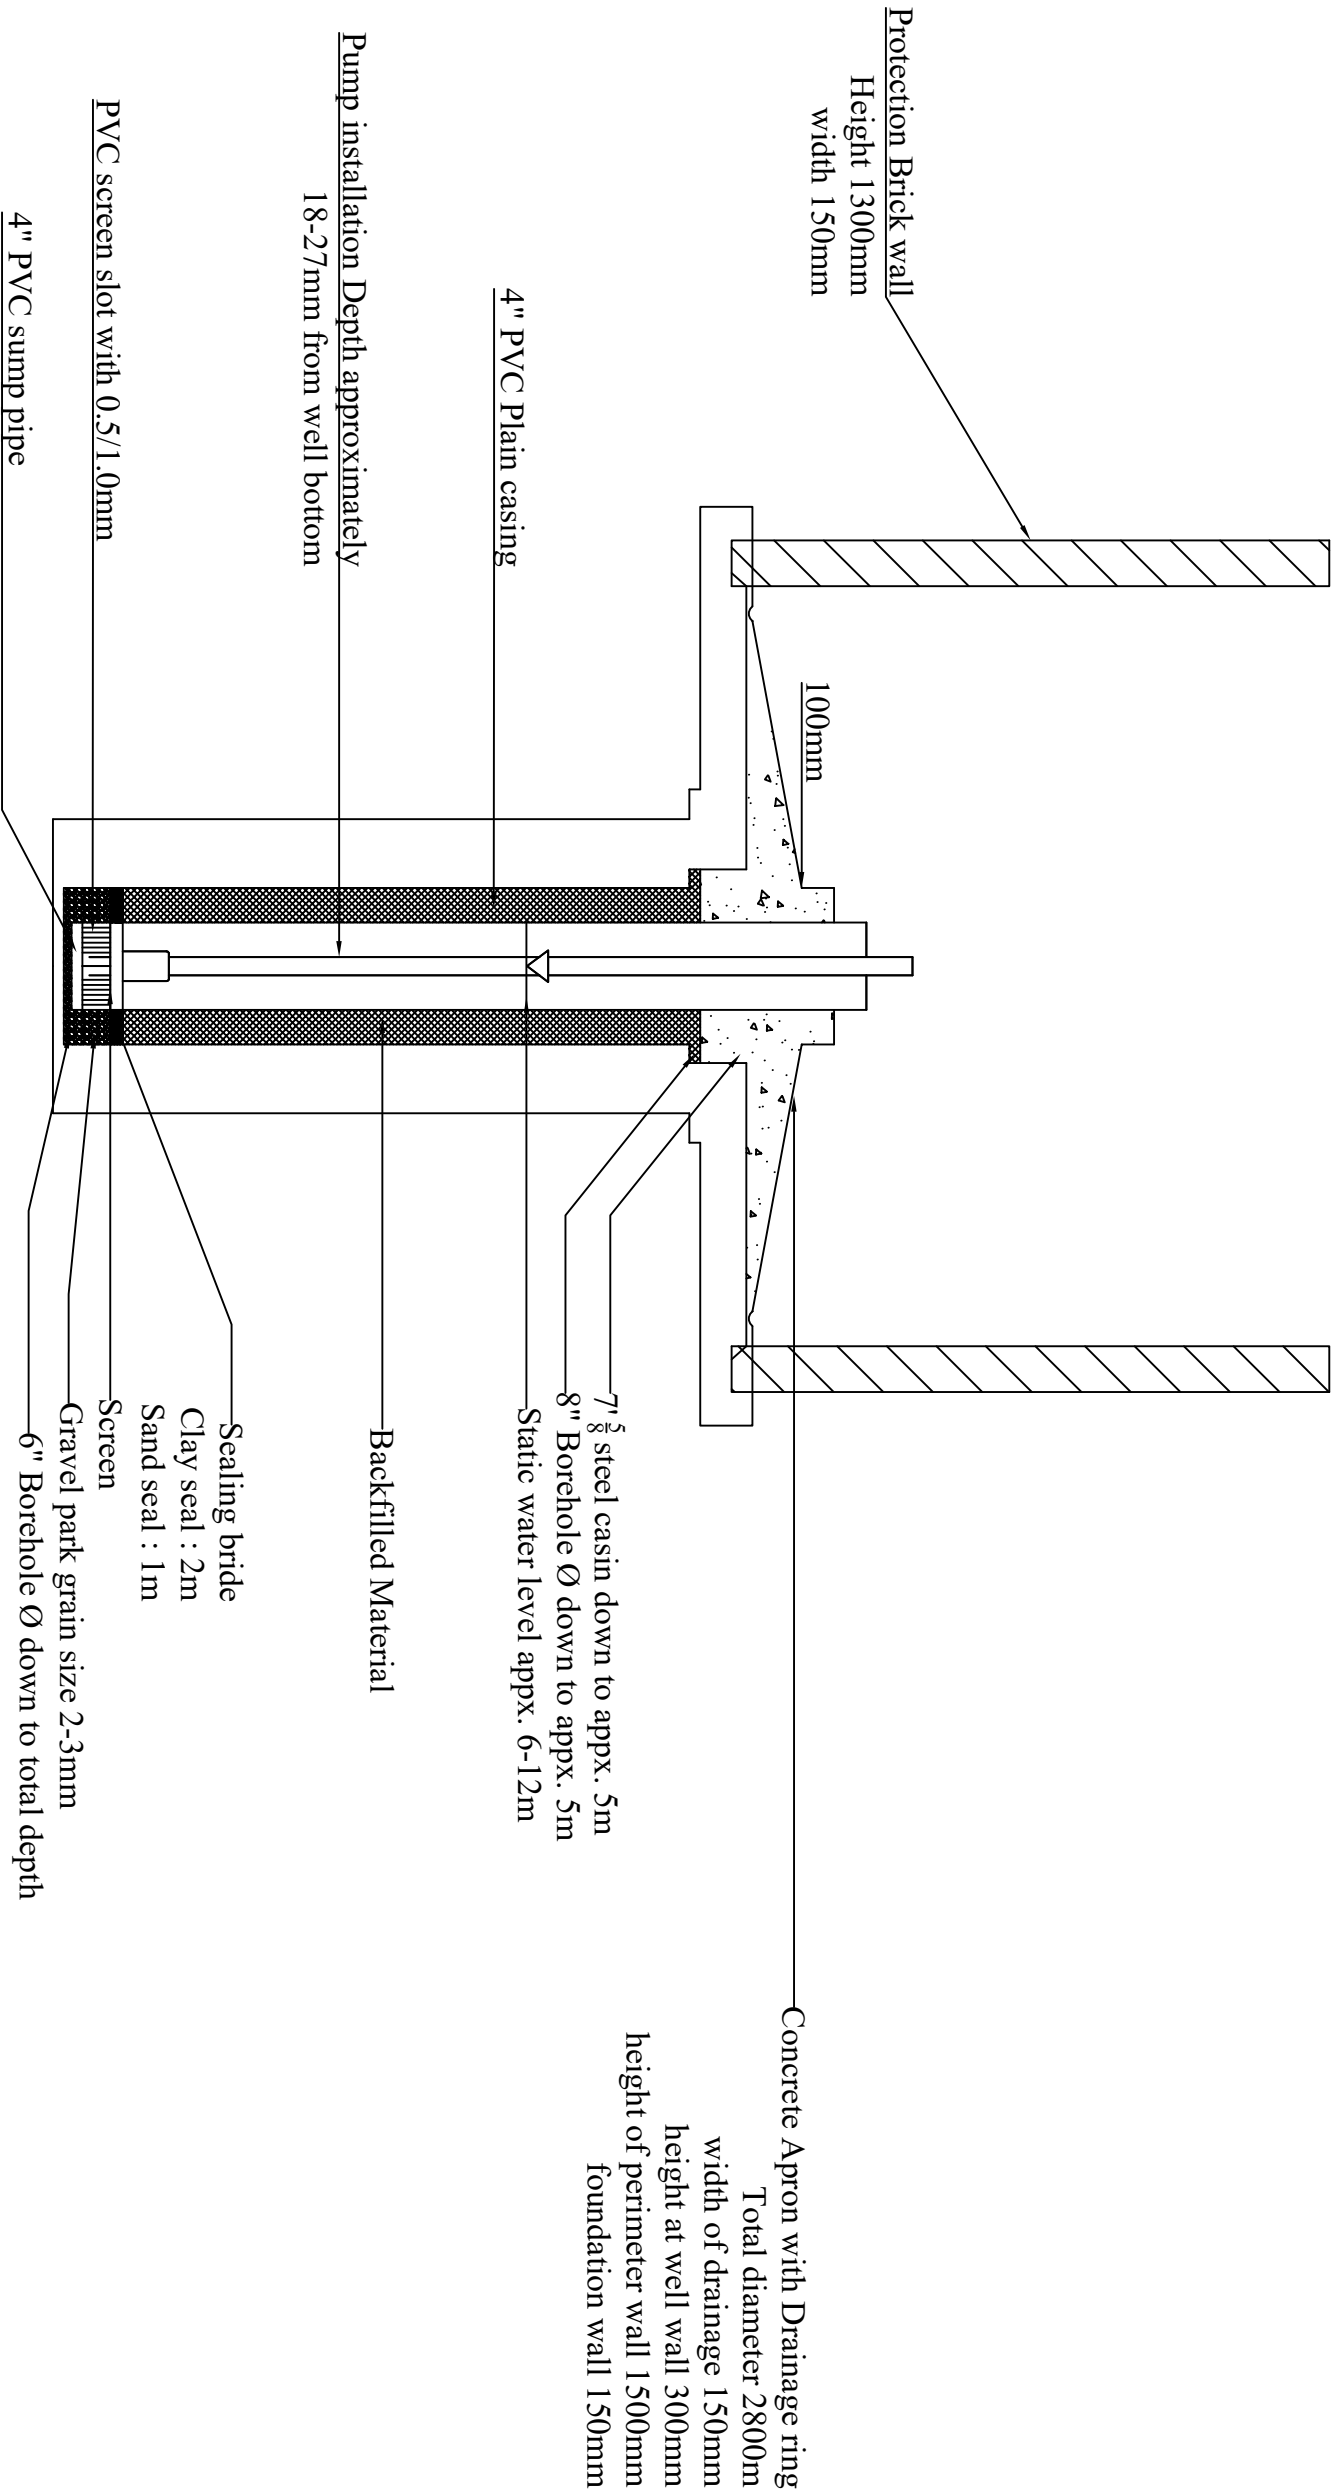

NOTE

1. All block wall thickness = 225mm except otherwise stated.
2. Cover to reinforcement must not be less than 25mm.
3. All lap length should be 45D.

DESIGN CONSULTANT

Ing Sahr J. N. Mbagu

Technical and Architectural design
Engineers/AutoCAD technicians

Drawn by: Ing Aroun Rashid Willson

Checked by: Ing Sahr J. N. Mbagu

PROJECT

PROPOSED CONSTRUCTION OF
SOLAR POWER BOREHOLE
WITH WATER TANKTOWER

Location

FORT LOKO

CLIENT

UNDP/SLCS

DRAWING DESCRIPTION

BOREHOLE

Scale: 1:100

Date: APRIL 2020

Drawing Number Revision

PTB03