


Borehole with concrete Apron, Wall and Drainage Channel

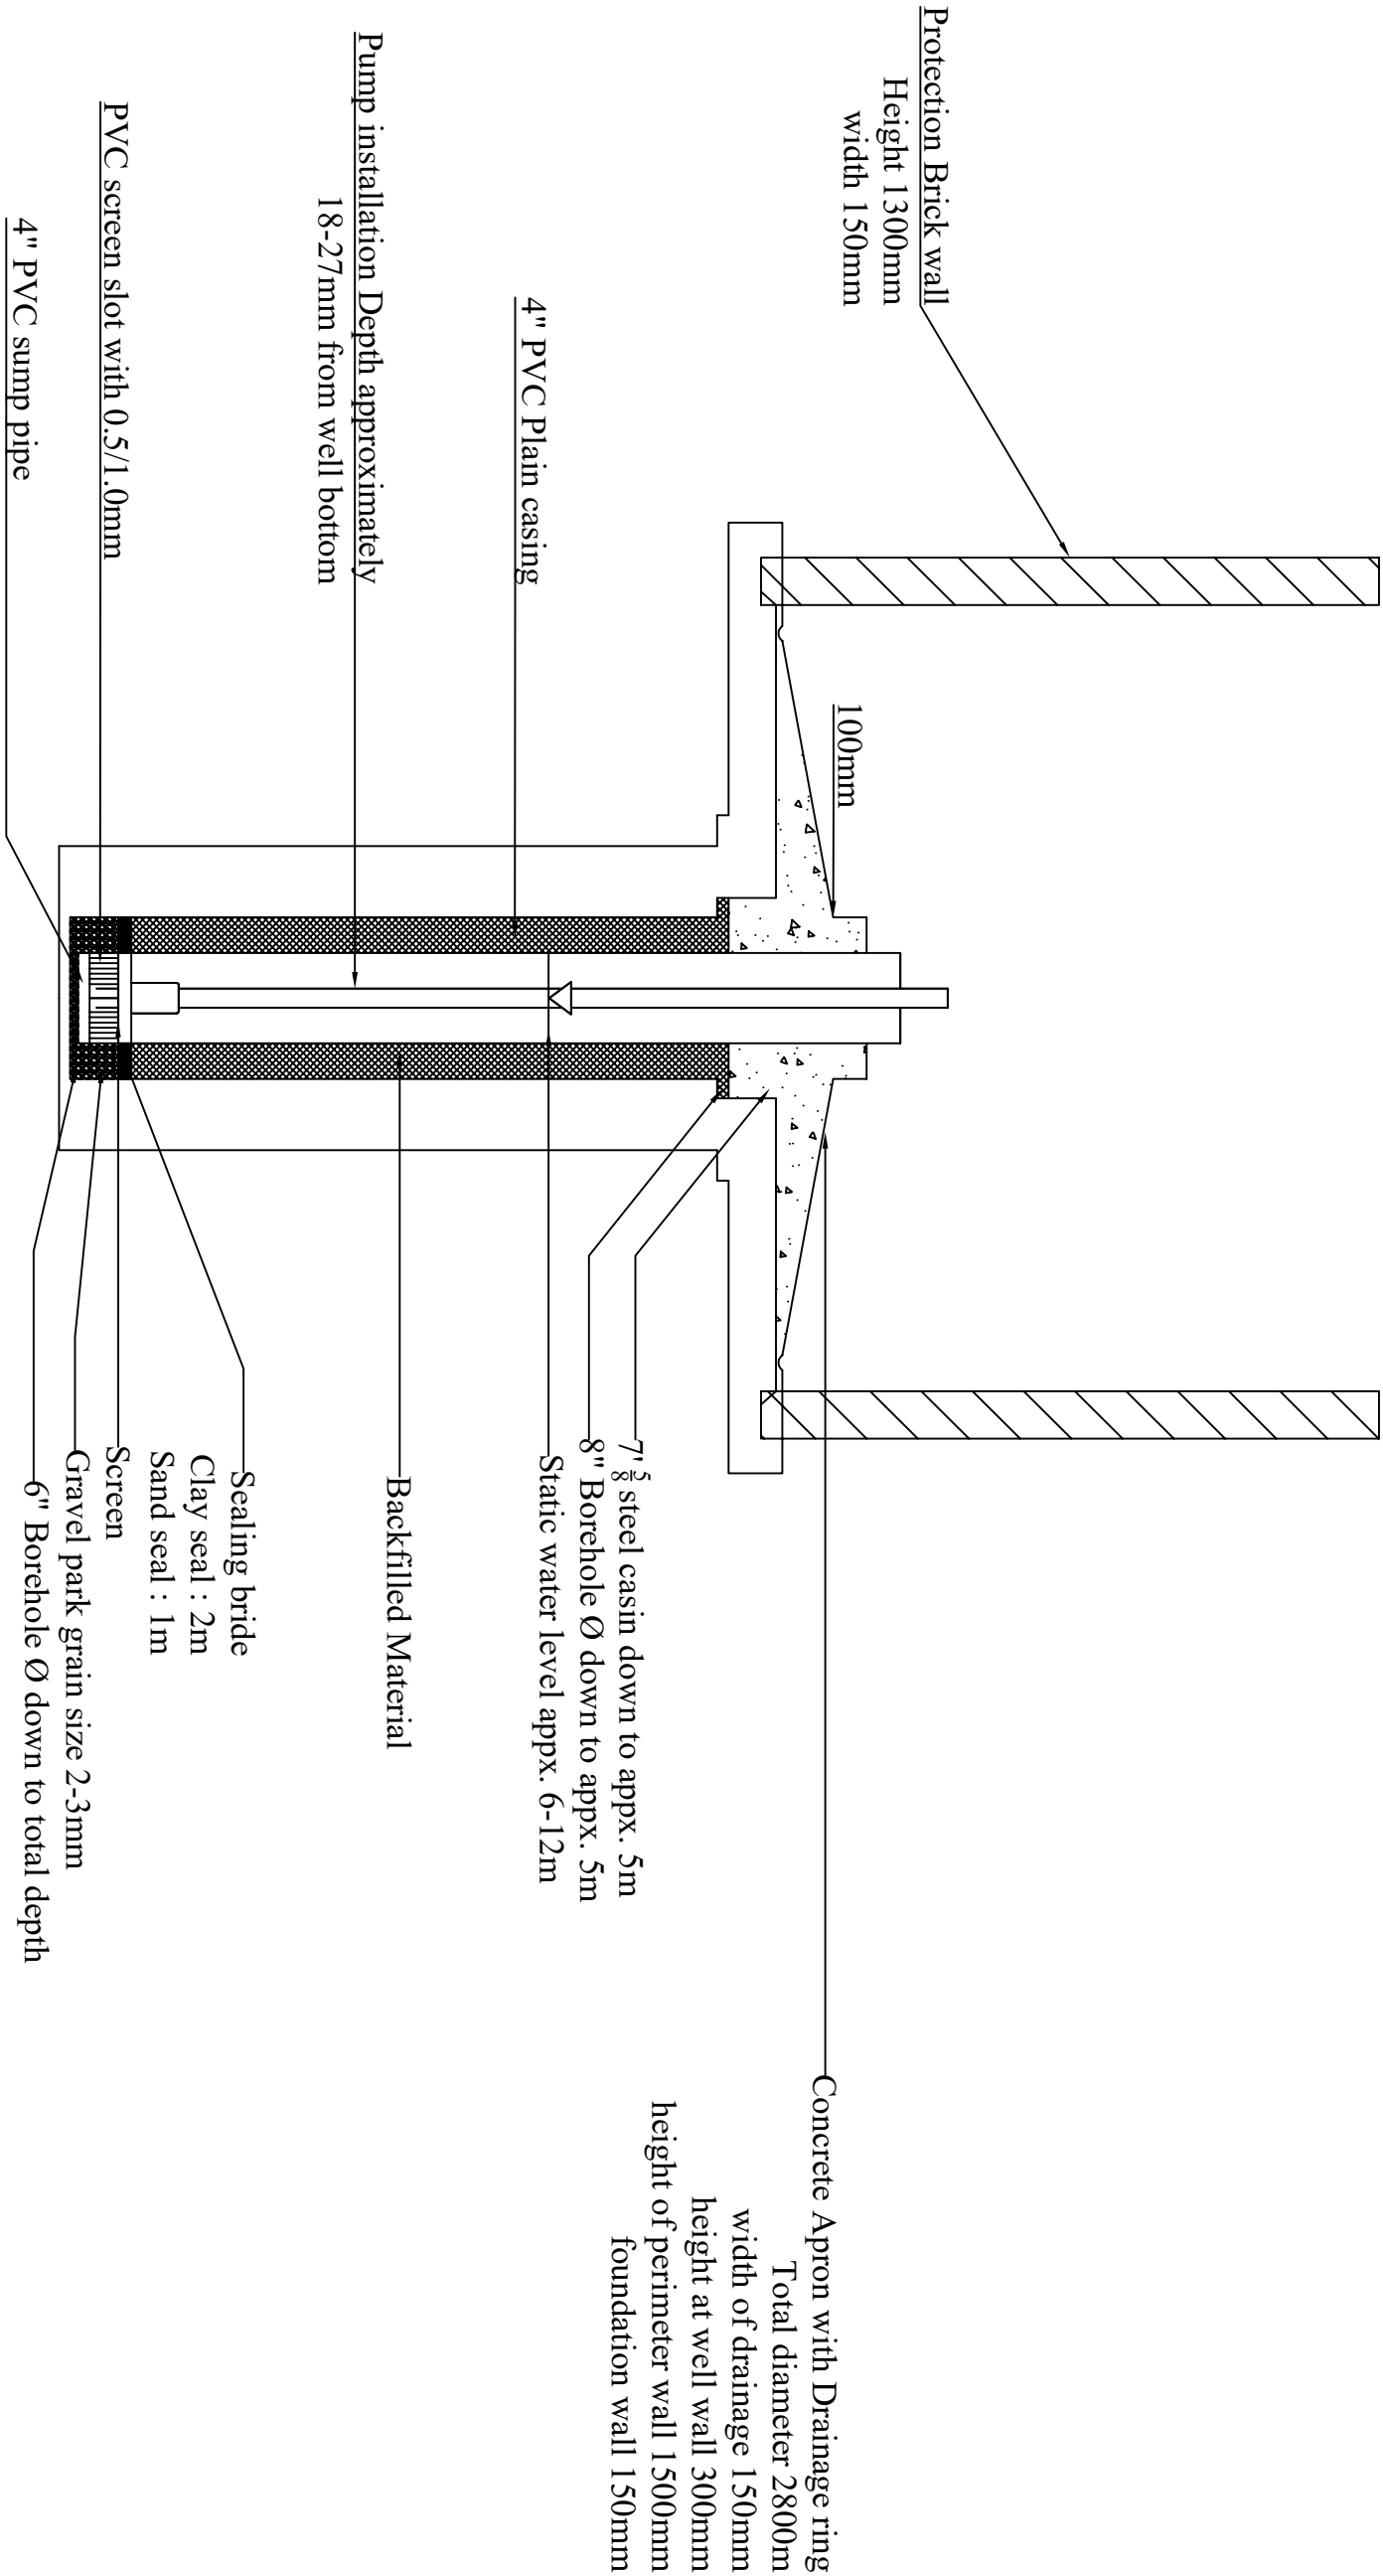

NOTE

1. All block wall thickness = 225mm except otherwise stated.
2. Cover to reinforcement must not be less than 25mm.
3. All lap length should be 45D.

DESIGN CONSULTANT

Ing Sahr J. N. Mbrap

Technical and Architectural design
Engineers/AutoCAD technicians

Draun by: Ing Aroun Rashid Wilson

Checked by: Ing Sahr J. N. Mbrap

PROJECT

PROPOSED CONSTRUCTION OF
SOLAR POWER BOREHOLE
WITH WATER TANKTOWER

Location

BO

CLIENT

UNDP/SLCS

DRAWING
DESCRIPTION

BOREHOLE

Scale: 1:100

Date: APRIL 2020

Drawing Number

PTB03

Revision