

STRUCTURAL TECHNICAL REPORT

On the basic Static and Dynamic calculations of the Object:

Construction of Joint School , "Ramazan Karaj",Nikel

LOCATION : Nikel, Municipality KRUJE

CLIENT: UNDP ALBANIA

Designer : Edison Drishti

Lic. K. 1566/3

Tirane 2020

CONSTRUCTIVE TECHNICAL REPORT

1. CODES AND REFERENCES

`` Technical Design Condition for Antiseismic Constructions **KTP-N.2-89**``

(ACADEMY OF SCIENCES, Seismological Center)

`` Technical design conditions `` , Volume II, (**KTP-6,7,8,9-1978**)

``**Eurocode 2** : Design of Concrete Structures FINAL DRAFT prEN 1992-1-2``, December 2003)

``**Eurocode 8** : Design of Structures for Earthquake Resistance FINAL DRAFT prEN 1998-1``, December 2003).

2. MATERIALS

► The type of concrete provided in the project for the foundations (reinforced concrete connecting beam type) and for all other superstructure elements (columns, reinforced concrete walls, slabs, and beams) is C30 / 37

► The steel used in the facility is imported **S 500** with flow limit $\sigma_{rrj} = 500$ MPa. This steel type is provided for all types of fittings used in the facility.

► Brick type M-t 150, Mortar type M-II 50.

► The computational resistances for concrete and steel are obtained by reducing the characteristic resistances according to the class of concrete (or steel) used with the relevant safety factor as follows:

Concrete C30/37 ($\gamma_c=1.5$)

Concrete Properties (EC2 EN1992-1-1:2004, 3.1)										
Class	fck (MPa)	fck,c (MPa)	fctm (MPa)	fctk0.05 (MPa)	fctm0.95 (MPa)	fcy,fl (MPa)	fyck (MPa)	Ec (GPa)	Gc (GPa)	w (kN/m3)
C30/37	30.00	37.00	2.90	2.00	3.80	7.80	0.45	33	14	25

Steel S500 ($\gamma_s=1.15$) The computational resistance $F_{yd} = 430$ MPa

Reinforcing Steel (EC2 EN1992-1-1:2004, 3.2)					
Reinforcing steel Class	fyk (MPa)	ftk,c (MPa)	Es (GPa)	euk (%)	L (m)
S500	500.00	500.00	200.00	2.50	14.00

The determination of the concrete type as well as the determination of the protective layer was done in accordance with the degree of exposure referred to in the table below. (EN 206-1)

VLERAT LIMIT TE REKOMANDUARA PER KOMPOZIMIN DHE PERBERJEN E BETONIT

KLASAT E EKSPOZIMIT																		
	ASNJ E RREZI K KORR UDIMI	KORROZIONI I SHKAKTUAR NGA KARBONIZIMI				KORRODIMET NGA KLOURET						NGRIRJA DHE SHKRIRJA				AMBIENTE KIMIKISHT AGRESIVE		
						NGA UJI I DETIT			KLORURE TE TJERA TE NDRYSHME NGA UJI I DETIT									
	X0	XC1	XC2	XC3	XC4	Xs1	Xs2	Xs3	Xd1	Xd2	Xd3	Xf1	Xf2	Xf3	Xf4	Xa1	Xa2	Xa3
RAPORTI MAX a/c		0.65	0.60	0.55	0.50	0.50	0.45	0.45	0.55	0.55	0.45	0.55	0.55	0.50	0.45	0.55	0.50	0.45
KLASA MIN E REZISTEN CES	C 12/15	C ²⁰ / ₂₅	C ²⁵ / ₃₀	C ³⁰ / ₃₇	C ³⁰ / ₃₇	C ³⁰ / ₃₇	C ³⁵ / ₄₅	C ³⁵ / ₄₅	C ³⁰ / ₃₇	C ³⁰ / ₃₇	C ³⁵ / ₄₅	C ³⁰ / ₃₇	C ²⁵ / ₃₀	C ³⁰ / ₃₇	C ³⁰ / ₃₇	C ³⁰ / ₃₇	C ³⁰ / ₃₇	C ³⁵ / ₄₅
PERBAJ TJA MIN E CEMENTOS (KG/M3)		260	280	280	300	300	320	340	300	300	320	300	300	320	340	300	320	360
PERBAJ TJA MIN E AJRIT %													4.0 ^a	4.0 ^a	4.0 ^a			
KERKESA TE TJERA												AGREGATE SIPAS EN 12620 ME REZISTENCE TE MJAFTUESHME NE NGRIRJE/SHKRIRJE				CIMENTO REZISTENTE NGA SULFATET		

A) KUR BETONI NUK PERMBAN AJER TE SHITUAR, PERFORMANCE E TIJ DUHET KONFIRMUAR KONFORM SIPAS NJE METODE TE PROVES PERKATESE PER NJE BETON I CILI ESHTË PROVUAR REZISTENCA NE NGRIRJE/SHKRIRJE PER KLASEN RELATIVE TE EKSPOZIMIT

B) NESE PREZENCA E SO₂4 SJELL KLASEN E EKSPOZIMIT XA2 DHE XA3, ESHTË THELBESORE TE PERDORET NJE CIMENTO REZISTENTE NG SULTATET. NQS CIMENTOJA ESHTË KLASIFIKUAR E NJE REZISTENCE TE LARTE APO TE MODERUAR NG SULTATET, CIMENTOJA DUHET TE PERDORET ME KLASË EKSPOZIMI XA2 (DHE TE NJE KLASË TE EKSPOZIMI XA1 NESE ESHTË E APLIKUESHME) DHE CIMENTOJA ME REZISTENCE TE LARTE NG SULTATET DUHET TE PERDORET ME KLASË EKSPOZIMI XA3.

KLASA	ULJA NG KONI
S1	NGA 10 DER NE 20
S2	NGA 50 DERI NE 90
S3	NGA 100 DERI NE 150
S4	NGA 160 DERI NE 210
S5	>220

KLASA E EKSPOZIMI T NE AMBIENT	SPESORI MINIMAL I SHITRESËS MBROJTËSE			
	KOHA E NEVOJSHME 50 VJET		KOHA E NEVOJSHME 100 VITE	
	C.A	C.A.P	C.A	C.A.P
X0	10	10	20	20
XC1	15	25	25	35
XC2, XC3	25	35	35	45
XC4	30	40	40	50
XS1, XD1	35	45	45	55
XS2, XD2	40	50	50	60
XS3, XD3	45	55	55	65

3. COMPUTER ANALYSIS AND CALCULATION

Static and dynamic analysis to determine the response of the structure to different types of loading of the structure was performed with the program HOLO bim V 9.32. The modeling of the structure as a whole and of each element is done on the basis of the finite element methodology (Finite Element Method - FEM) which is a rough and practical method finding wide use today in terms of the superiority created by the use of computer programs. .

The structure analysis is performed using the method of Limit state in full compliance with Eurocodes.

There are two different situation of limit state, Ultimate limit state (SLU) and Serviciability limit state (SLS)

Dynamic analysis is based on modal analysis with the reaction spectrum method. The calculated dynamic (seismic) loads are accepted as equivalent static loads and are applied in place of concentrated masses. The basis for the method of dynamic calculations with the method of reaction spectrum is the analysis of its own values and its own vectors. By this method the forms of self-oscillations and the frequencies of free oscillations are determined. The values and vectors themselves undoubtedly provide a clear and complete picture of the behavior of the structure under the action of dynamic loads. The program HOLO bim automatically requires modes with lower circular frequencies (higher periods). The maximum number of modes required by the program is conditioned by the constructor himself (in the case of the object in question $n = 9$ modes), while the floor measures of this object are considered with three degrees of freedom, of which 2 rotating and one translational according to the plan of the soleta itself. The cyclic frequency f (cycles / sec), the circular frequency ω (rad / sec) and the period T (sec) are related to each other through the relations: $T = 1 / f$ and $f = \omega / 2\pi$. The result of the analysis is the displacements, internal forces (M , Q , N ,) and the stresses σ in each element of the structure.

4. CALCULATING LOADS ON THE PROJECT

4.1 Loads acting on structures

For the building under study the actions of the following factors have been taken into account:

- **Dead Loads-DL and Live Loads-LL**

-**Wind**

-**Siesmicity**

1- Faktoret Veprues mbi Struktura (Aksionet)

Characteristic operators (loads, thermal variations, distortions, torsions, etc.) are determined in accordance with EC1. based on the following classifications:

1. Classification of actions based on the manner of their execute

a) **Direct** : which can be concentrated forces or distributed loads, can be fixed or movable.

- b) **Indirect** : which can be displacements, distortions, change of temperature, humidity, internal pressure, yielding of supports, etc.
- c) **Degradation**: which can be:
 endogenous when we have a natural change of the material of which the structure is composed or exogenous when the material loses its characteristic properties under the influence of external agents.

2. Classification of actions based on structural response

- a) **Static** : Actions that when applied to the structure do not provoke significant acceleration in the whole structure or in specific parts of it.
- b) **Pseudo Static** : dynamic actions that are presented as an equivalent static action
- c) **Dynamic**: actions that cause significant accelerations in the structure itself or in particular parts of it.

3. Classification of actions based on their variation in time

- a) **Permanent (G)** : Actions that are exercised throughout the nominal life of the structure and that the variation of their intensity over time is so easy that the actions can be considered constant over time, here are:

Structural permanent (G1)

the own weight of all the elements of the structure

the specific gravity of the terrain when it affects the structure

forces exerted by the terrain (excluding variable loads exerted on the ground)

forces exerted by water pressure (when they are configured as constant in time)

Permanent non-structural (G2)

the own weight of all non-structural elements

actions from displacements and deformations foreseen in the project

Pretensioning, compression (P)

Attraction – viscosity

Differential displacements

- b) **Variable (Q)** : actions that are exerted on a structure or on a particular element of it immediately and that result in significantly different values at times which can be:
 long-term: actions that exert a considerable intensity although not permanently but that have a not insignificant duration compared to the nominal life of the structure.
 short-term: actions that exert a considerable intensity but have a short duration compared to the nominal life of the structure
- c) **Accidental (A)**: actions that are verified in exceptional cases during the nominal life of the structure:
 in case of fire
 in case of explosion
 in case of shock or collision
- d) **Siecmic (E)**: actions that derive during earthquakes

4.2 Permanent Loads (Dead Loads-DL)

Permanent loads mean: Own weight of all structural elements (foundations, beams, columns, slabs, staircases etc.) which are automatically calculated by the program, as well as own weight of non-structural elements (floor layers, brick partition walls with bars, balcony railings, stair treads, etc.). The normalized weights of the materials taken into account in the load calculation are taken as follows:

Specific weight of concrete:	25.00 kN/m ³
Own weight of slab:	1.50 kN/m ²
Specific weight of steel:	78.00 kN/m ³
Load of tile layers:	1.50 kN/m ²
Load of perimeter walls:	3.60 kN/m ²
Stairs cladding layers:	1.30 kN/m ²
Partition wall load:	2.10 kN/m ²
Soil specific gravity:	18.00 kN/m ³

4.3 Temporary Loads (Live Loads-LL)

As temporary loads in the structure are calculated the loads of use of floors, stairs, balconies, terraces, etc., as defined in EN 1991-1-1: 2001 (Page 21-22) Table 6.2 (Table 6.2 - Imposed loads on floors, balconies and stairs in buildings) for categories C1, C3.

For all school spaces the temporary load is taken into account with a maximum value of 5 kN / m (in favor of safety).

4.4 Combination of actions (Loads)

Starting from a single load action the program generates a series of load schemes called Basic Load Conditions, which are then combined with each other for different load operations in such a way that: they result as the most unfavorable, based on the duration, frequency and low probability of simultaneous action of all loads with the most unfavorable value.

In accordance with the Eurocodes, the following load combinations are generally considered depending on the limit state ULS and ELS:

Static Combination : ULS (Basic or Fundamental Combination)

ELS (Characteristic (rare), Frequent, Almost Permanent)

Siesmic Combination : ULS

ELS

Defined as the characteristic value Q_k of a variable action, the value corresponding to the maximum value of a fragment that includes 95% of the possible cases in relation to a reference time period of this

action. In determining the combination of actions that can act simultaneously in the structure, the term Q_{kj} - indicates the variable actions in combination, while Q_{k1} - indicates the dominant variable action. Q_{k2}, Q_{k3}, \dots are given actions that can act simultaneously with what is dominant.

The variable actions Q_{kj} are combined with the coefficients ψ_{0j} , ψ_{1j} and ψ_{2j} which refer to the duration in percentage in relation to the intensity of the variable action. These are defined as follows:

$\psi_{2j} \times Q_{kj}$ - almost permanent value: determines the average value of the time distribution of the intensity of the variable action

$\psi_{1j} \times Q_{kj}$ - frequent value: determines the corresponding value of a fragment of 95% of the time distribution of the intensity of the variable action that can be exceeded only for a fraction of 5% of the reference period.

$\psi_{0j} \times Q_{kj}$ - rare value: determines the low value of the temporal distribution of the intensity of the variable action but considerable in the possibility of interaction with other variable actions

The values of the combination coefficients for residential buildings and social and industrial buildings are given in the table

Kategoria		ψ_{0j}	ψ_{1j}	ψ_{2j}
A	Ambiente Banimi	0.7	0.5	0.3
B	Zyra	0.7	0.5	0.3
C	Godina qe kane popullim	0.7	0.7	0.6
D	Godina komerciale	0.7	0.7	0.6
E	Bibloteka, arshiva, magazina, industriale	1.0	0.9	0.8
F	Parkime (auto me peshe deri 30kN)	0.7	0.7	0.6
G	Parkime (auto me peshe mbi 30kN)	0.7	0.5	0.3
H	Mbulesa	0.0	0.0	0.0
Era		0.6	0.2	0.0
Debora	kuota deri 1000m nga niveli detit	0.5	0.2	0.0
Debora	kuota mbi 1000m nga niveli detit	0.7	0.5	0.2
Temperatura		0.6	0.5	0.0

In order to perform the controls in the limit states these combinations of actions are defined

STATIC Combination

1. Basic Combination, generally used for the ultimate limit state (ULS):

$$F_d = \gamma_g \cdot G_k + \gamma_{Q1} \cdot Q_{k1} + \sum_{i=2}^n \gamma_{Qi} \cdot (\Psi_{0i} \cdot Q_{ki})$$

γ_g - amplification coefficient for the action of permanent loads

γ_{Qi} - amplification coefficient for the action of variable loads

2. Characteristic (rare) combination, generally used for the first limit state or as it is otherwise called the serviceability limit state (ELS) - non-reversible used in controls which are performed with Allowed tension (TA):

$$F_d = G_k + Q_{k1} + \sum_{i=2}^n (\Psi_{0i} \cdot Q_{ki})$$

3. Frequent Combination, generally used for reversible serviceability limit state (ELS):

$$F_d = G_k + \Psi_{11} \cdot Q_{k1} + \sum_{i=2}^n (\Psi_{2i} \cdot Q_{ki})$$

4. Almost Permanent combination, used for serviceability limit state (ELS) - in case of prolonged effect operations:

$$F_d = G_k + \sum_{i=1}^n (\Psi_{2i} \cdot Q_{ki})$$

Below we give the matrix of combination coefficients in the most general case when the structure is under the action of loads of slabs, snow, and temperature:

ULS Kombinimi Baze							
Vlerat e projektit per ngarkesat				Vlerat e kombinimit			
perm.	soleta	bora	temp	perm.	soleta	bora	temp
G_k	Q_{k1}	Q_{k2}	Q_{k3}	$\gamma_G \cdot G_k$	$\gamma_Q \cdot Q_{k1}$	$\gamma_Q \cdot Q_{k2}$	$\gamma_Q \cdot Q_{k3}$
				$\gamma_G \cdot G_k$	$\gamma_Q \cdot \Psi_{01} \cdot Q_{k1}$	$\gamma_Q \cdot \Psi_{01} \cdot Q_{k2}$	$\gamma_Q \cdot \Psi_{01} \cdot Q_{k3}$
				$\gamma_G \cdot G_k$	$\gamma_Q \cdot \Psi_{01} \cdot Q_{k1}$	$\gamma_Q \cdot \Psi_{01} \cdot Q_{k2}$	$\gamma_Q \cdot \Psi_{01} \cdot Q_{k3}$
				$\gamma_G \cdot G_k$	$\gamma_Q \cdot \Psi_{01} \cdot Q_{k1}$	$\gamma_Q \cdot \Psi_{01} \cdot Q_{k2}$	$\gamma_Q \cdot \Psi_{01} \cdot Q_{k3}$

ELS Kombinimi Rralle							
Vlerat e projektit per ngarkesat				Vlerat e kombinimit			
perm.	soleta	bora	temp	perm.	soleta	bora	temp
G_k	Q_{k1}	Q_{k2}	Q_{k3}	G_k	Q_{k1}	$\Psi_{02} \cdot Q_{k2}$	$\Psi_{03} \cdot Q_{k3}$
				G_k	$\gamma_Q \cdot \Psi_{01} \cdot Q_{k1}$	Q_{k2}	$\Psi_{03} \cdot Q_{k3}$
				G_k	$\gamma_Q \cdot \Psi_{01} \cdot Q_{k1}$	$\Psi_{02} \cdot Q_{k2}$	Q_{k3}
				G_k	$\gamma_Q \cdot \Psi_{01} \cdot Q_{k1}$	$\Psi_{02} \cdot Q_{k2}$	$\Psi_{03} \cdot Q_{k3}$

ELS Kombinimi Shpeshte							
Vlerat e projektit per ngarkesat				Vlerat e kombinimit			
perm.	soleta	bora	temp	perm.	Sherbimi	bora	temp
G_k	Q_{k1}	Q_{k2}	Q_{k3}	G_k	$\Psi_{11} \cdot Q_{k1}$	$\Psi_{22} \cdot Q_{k2}$	0
				G_k	$\Psi_{21} \cdot Q_{k1}$	$\Psi_{12} \cdot Q_{k2}$	0
				G_k	$\Psi_{21} \cdot Q_{k1}$	$\Psi_{22} \cdot Q_{k2}$	$\Psi_{12} \cdot Q_{k3}$
				G_k	$\Psi_{21} \cdot Q_{k1}$	$\Psi_{22} \cdot Q_{k2}$	0

ULS Kombinimi Gati Permanent							
Vlerat e projektit per ngarkesat				Vlerat e kombinimit			
perm.	soleta	bora	temp	perm.	Sherbimi	bora	temp
G_k	Q_{k1}	Q_{k2}	Q_{k3}	G_k	$\Psi_{21} \cdot Q_{k1}$	$\Psi_{22} \cdot Q_{k2}$	$\gamma_Q \cdot Q_{k3}$

SIESMIC Combination

In the case of seismic combinations compared to static ones, variable actions are considered in both limit states through their almost permanent values and neither of them is considered dominant. It is only the shape of the seismic spectrum that makes the difference, so what differs from ULS to ELS is the value of the seismic action.

The general form of seismic combination required to evaluate the effect of seismic action and all other accompanying actions is

$$F_d = G_k + \sum_{i=1}^n (\Psi_{2i} \cdot Q_{ki}) \pm E_k$$

Below we are giving the combination matrix belonging to ULS and ELS in the presence of seismicity. For seismic ultimate limit state (usually called ULS-Seismic) and for any direction of seismic action (Ex, Ey) given the double (+, -) eccentricity as well as the two possible directions of displacement of the center of mass (ex, ey) four combinations will be obtained.

For each of these four combinations should be considered four possible combinations due to the simultaneous presence of seismic action in both directions.

In this way 16 elementary combinations are obtained for each direction of seismic action and in total we have 32 combinations for the seismic boundary condition.

Kombinimi I Ngarkesave						Ngarkesat Elementare					
Perm	Variabel	Veprimi Sizmik				G	$\Sigma \Psi_{2j} * Q_{kj}$	Ex	ey	Ey	ex
G _k	$\Sigma \Psi_{2j} * Q_{kj}$	Ex	ey	0.3*E _y	+ e _x	1.0	1.0	1.0	1.0	0.3	0.3
					- e _x	1.0	1.0	1.0	1.0	0.3	-0.3
				-0.3*E _y	+ e _x	1.0	1.0	1.0	1.0	-0.3	0.3
					- e _x	1.0	1.0	1.0	1.0	-0.3	-0.3
			-ey	0.3*E _y	+ e _x	1.0	1.0	1.0	-1.0	0.3	0.3
					- e _x	1.0	1.0	1.0	-1.0	0.3	-0.3
				-0.3*E _y	+ e _x	1.0	1.0	1.0	-1.0	-0.3	0.3
					- e _x	1.0	1.0	1.0	-1.0	-0.3	-0.3
		- Ex	ey	0.3*E _y	+ e _x	1.0	1.0	-1.0	1.0	0.3	0.3
					- e _x	1.0	1.0	-1.0	1.0	0.3	-0.3
				-0.3*E _y	+ e _x	1.0	1.0	-1.0	1.0	-0.3	0.3
					- e _x	1.0	1.0	-1.0	1.0	-0.3	-0.3
			-ey	0.3*E _y	+ e _x	1.0	1.0	-1.0	-1.0	0.3	0.3
					- e _x	1.0	1.0	-1.0	-1.0	0.3	-0.3
				-0.3*E _y	+ e _x	1.0	1.0	-1.0	-1.0	-0.3	0.3
					- e _x	1.0	1.0	-1.0	-1.0	-0.3	-0.3

Kombinimi I Ngarkesave						Ngarkesat Elementare					
Perm	Variabel	Veprimi Sizmik				G	$\Sigma \Psi_{2j} * Q_{kj}$	Ex	ey	Ey	ex
G _k	$\Sigma \Psi_{2j} * Q_{kj}$	Ey	ex	0.3*E _x	+ e _y	1.0	1.0	1.0	1.0	0.3	0.3
					- e _y	1.0	1.0	1.0	1.0	0.3	-0.3
				-0.3*E _x	+ e _y	1.0	1.0	1.0	1.0	-0.3	0.3
					- e _y	1.0	1.0	1.0	1.0	-0.3	-0.3
			-ex	0.3*E _x	+ e _y	1.0	1.0	1.0	-1.0	0.3	0.3
					- e _y	1.0	1.0	1.0	-1.0	0.3	-0.3
				-0.3*E _x	+ e _y	1.0	1.0	1.0	-1.0	-0.3	0.3
					- e _y	1.0	1.0	1.0	-1.0	-0.3	-0.3
		- Ey	ex	0.3*E _x	+ e _y	1.0	1.0	-1.0	1.0	0.3	0.3
					- e _y	1.0	1.0	-1.0	1.0	0.3	-0.3
				-0.3*E _x	+ e _y	1.0	1.0	-1.0	1.0	-0.3	0.3
					- e _y	1.0	1.0	-1.0	1.0	-0.3	-0.3
			-ex	0.3*E _x	+ e _y	1.0	1.0	-1.0	-1.0	0.3	0.3
					- e _y	1.0	1.0	-1.0	-1.0	0.3	-0.3
				-0.3*E _x	+ e _y	1.0	1.0	-1.0	-1.0	-0.3	0.3
					- e _y	1.0	1.0	-1.0	-1.0	-0.3	-0.3

5. SEISMIC CONSIDERATIONS

5.1 Siesmic parameters

Siesmic Zone: III ($\alpha_{gR}=0.26$)
 Ground Type: D
 Building importance Class: III
 Seismic action directions: X, Y
 Elastic response spectrum: Type 1
 Ductility class: (DCM)

5.2.a Classification according to the type of structural system [EC8 §5.2.2.1] (Section 1)

From the calculations made the building is classified

as **Frame system** in direction x-x

as **Frame system** in direction y-y

$V_{x/y}$ Sher resistance in direction X-X / Y-Y

	V_x	V_y
37	14.92	22.11
53	26.35	7.77
7	28.83	8.13
25	15.26	19.44
41	15.13	17.37
29	9.51	23.76
56	56.10	17.44
59	32.43	22.02
52	24.48	18.58
23	15.13	22.13
21	12.47	40.03
3	27.64	8.41
49	9.85	24.87
35	12.20	40.09
15	8.50	24.73
2	24.28	19.79
1	11.47	24.70
58	34.05	29.91
36	20.56	30.59
42	17.28	24.49
22	20.86	30.57
57	29.73	30.12
50	22.84	19.82
55	29.26	15.00
43	11.27	26.67
40	21.06	26.34
38	21.21	28.38

28	18.49	25.59
24	21.51	28.41
26	21.39	26.32
27	15.32	18.09
6	26.21	17.29
39	15.05	19.43
5	28.02	7.78
4	25.98	18.60
54	24.55	17.62
51	26.02	8.40

Direction X-X :

Further checks will be omitted due to the absence of walls.

Direction Y-Y :Data:

V_f = 810.79 kN (86.15% V_t) shear resistance of frames

V_w = 130.32 kN (13.85% V_t) shear resistance of walls

V_t = 941.11 kN total shear resistance of structure

Frame systemAcceptance criterion:


$V_f > 65\% V_t$

Checks:

86 > 65%

Results:

System accepted: YES

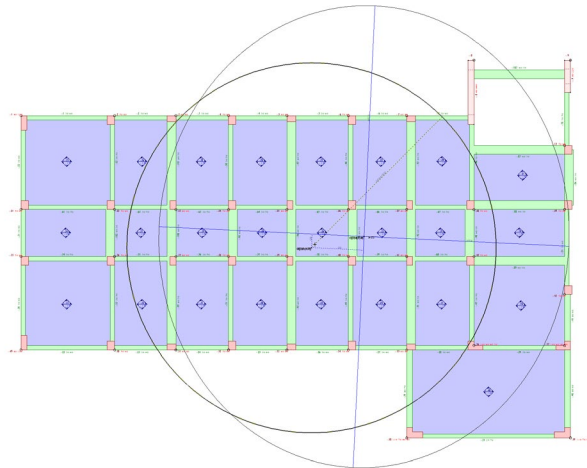**5.2.b Classification according to the type of structural system [EC8 §5.2.2.1] (Section 2)**

From the calculations made the building is classified

as **Frame system** in direction x-x

as **Frame system** in direction y-y

$V_{x/y}$ Sher resistance in direction X-X / Y-Y

	V_x	V_y
30	17.00	17.12
11	27.23	15.24
57	12.67	26.45
43	17.99	24.48
15	13.91	25.27
12	28.88	6.90
45	29.08	15.40
33	23.40	25.83
14	11.67	20.55
46	30.92	13.57
61	1.16	1.84
59	1.42	20.92
32	16.74	17.07
29	14.04	22.92
19	23.02	25.81
60	0.99	1.60
63	0.38	15.38
47	27.08	16.66
44	31.64	6.59
20	14.17	33.93
13	25.31	16.45
10	29.27	5.85
34	14.48	34.05
31	24.18	23.58
17	23.76	23.62
16	16.74	16.91
62	2.47	27.90
18	16.48	17.23
48	13.03	20.17

Direction X-X :

Further checks will be omitted due to the absence of walls.

Direction Y-Y :

Data:

V_f =539.27 kN (94.31% V_t) shear resistance of frames

V_w =32.53 kN (5.69% V_t) shear resistance of walls

V_t =571.80 kN total shear resistance of structure

Frame system

Acceptance criterion:


$V_f > 65\% V_t$

Checks:

86 > 65%

Results:

System accepted: YES

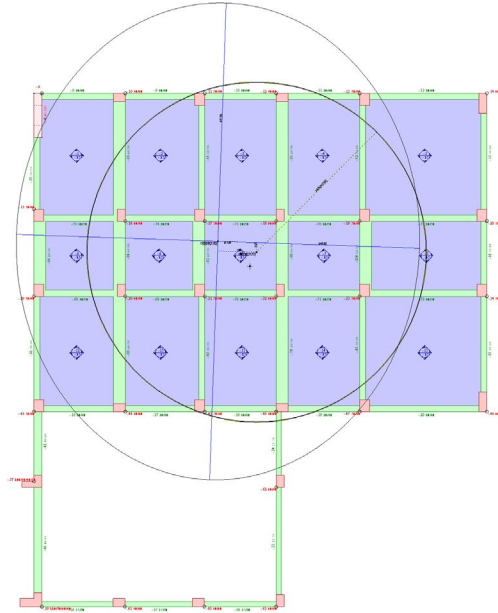

6. REGULATION CRITERIA

Section 1

6.1.a Regularity in the plan [EC8 §4.2.3.2]

The building is not considered regular in the plan

6.2.a Regularity in the height [EC8 §4.2.3.3]

The building is not considered regular in height

Section 2

6.1.b Regularity in the plan [EC8 §4.2.3.2]

The building is considered regular in the plan

6.2.b Regularity in the height [EC8 §4.2.3.3]

The building is not considered regular in height

7. BEHAVIOUR FACTOR CALCULATION [EC8 §5.2.2.2]

For both sections

Symbols:

q	behaviour factor
q_o	basic value of the behaviour factor
k_w	factor reflecting the prevailing failure mode in structural systems with walls
α_1	multiplier of horizontal design seismic action at formation of first plastic hinge in the system
α_u	multiplier of horizontal seismic design action at formation of global plastic mechanism

Data:

Building Category	Torsional flexible system
Ductility Class	DCM
Regularity in plan	NO
Regularity in elevation	NO

	α_u/α_1	α_{qo}	q_o	k_w	q
Direction X-X	1.30	3.00	2.76	1.00	2.76
Direction Y-Y	1.30	3.00	2.76	1.00	2.76

Results:Behaviour factor q : 2.76**8. DESING SPECTRUM DEFINITION [EC8 §3.2.2]****For both sections**Symbols:

α_{gR}	reference peak ground acceleration on type A ground
γ_i	importance factor of the building
q	behavior factor
S	soil factor obtained from geotechnical data (<i>table 3.2 dhe 3.3 EN 1988-1</i>)
T	vibration period of a linear single degree of freedom system
ξ	viscous damping ratio on %
β	lower bound factor for the horizontal design spectrum
$S_d(T)$	design spectrum
g	gravity accleration

Data :

γ_i	1.20 (III)
ξ	5 %
β	0.20


Spectrum : Type 1 ($M_s > 5.5$)

Ground type: D

	α_{gr} (III)	q	S	T_B (s)	T_C (s)	T_D (s)
horizontal	0.25	3.12	1.35	0.20	0.80	2.00
vertical	0.23	1.50	1.00	0.05	0.15	1.00

Results: S_d/g

	0	T_B	T_C	T_D	4
horizontal	0.27	0.37	0.37	0.15	0.06
vertical	0.18	0.24	0.24	0.05	0.05

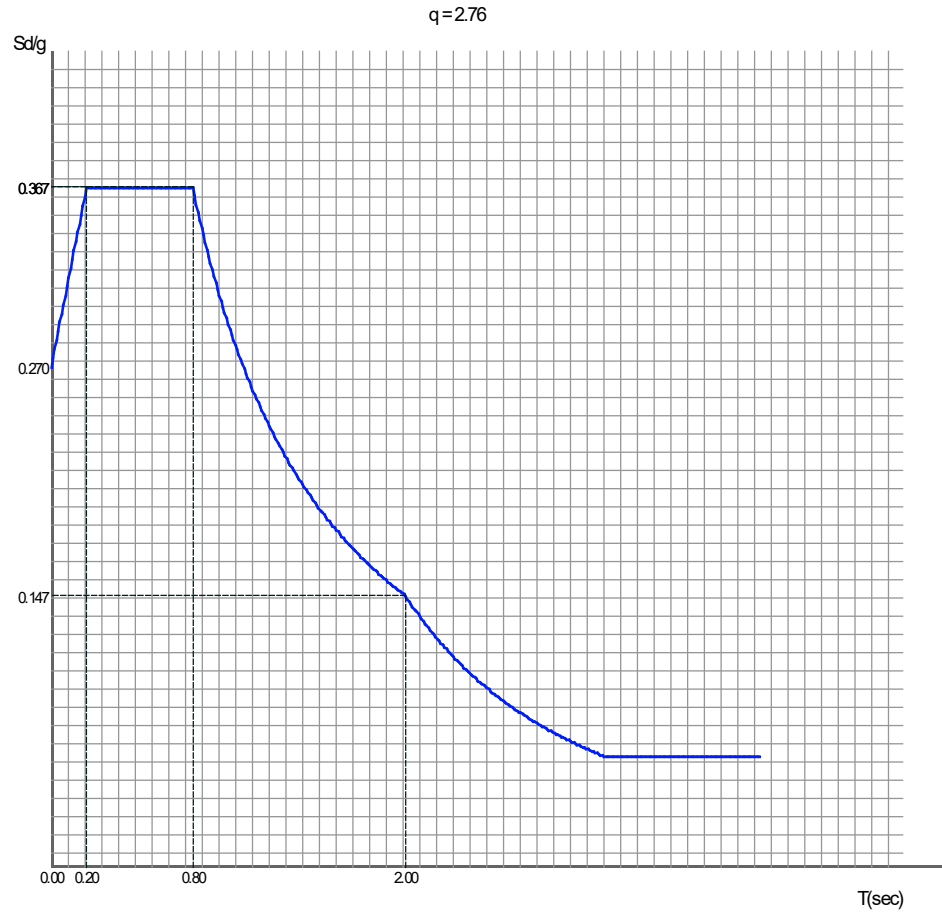

9. MODAL RESPONSE SPECTRUM ANALYSIS [EC8 §4.3.3.3]

9.1.a Eigenvalue analysis Section 1

Modal Shape Table:

Shape	Ω (rad/sec)	T (sec)	S_d	Ψ_x	C_x (%)	Ψ_y	C_y (%)	Ψ_z	C_z (%)
1	16.61	0.378201	3.67	-9.46	4.47	-36.90	67.98	-0.13	0.00
2	17.11	0.367191	3.67	39.74	78.88	-11.34	6.42	0.01	0.00
3	21.11	0.297618	3.67	7.05	2.48	14.83	10.99	0.22	0.00
4	53.51	0.117425	3.27	-14.87	11.04	1.15	0.07	-0.03	0.00
5	58.30	0.107765	3.22	1.02	0.05	10.89	5.92	-0.27	0.00
6	81.01	0.077564	3.08	0.17	0.00	0.77	0.03	10.99	4.70
7	86.51	0.072631	3.05	-1.09	0.06	-6.56	2.15	10.37	4.18
8	91.26	0.068846	3.03	-3.54	0.62	-0.19	0.00	-12.32	5.90
9	91.93	0.068350	3.03	-1.49	0.11	0.48	0.01	-6.10	1.45
SUM					97.72		93.57		

of 90% sum of the effective modal shapes

Dir.	k		$3n^{0.5}$	$T_k \leq 0.20s$
x	9	\geq	5.20	$0.068 \leq 0.20$
y	9	\geq	5.20	$0.068 \leq 0.20$

k, is the number of modes taken into account

n, is the number of storeys above the foundation or the top of a rigid basement

T_k , is the period of vibration of mode k

$$a_{CM} = 3.4974$$

$$\text{Verification: } \Sigma(M) = 2098.4520, \Sigma(V) = 6181.3845, a = 2.9457$$

9.1.b Eigenvalue analysis Section 2

Modal Shape Table:

Shape	Ω (rad/sec)	T (sec)	S_d	Ψ_x	C_x (%)	Ψ_y	C_y (%)	Ψ_z	C_z (%)
1	16.92	0.371285	3.67	31.56	81.56	-7.02	4.03	-0.14	0.00
2	17.46	0.359806	3.67	-6.80	3.78	-30.64	76.89	0.10	0.00
3	21.87	0.287347	3.67	-2.24	0.41	-6.94	3.94	0.08	0.00
4	36.97	0.169963	3.52	0.52	0.02	2.48	0.51	-0.04	0.00
5	37.96	0.165501	3.50	1.13	0.11	1.09	0.10	0.02	0.00
6	41.66	0.150831	3.43	-2.45	0.49	0.97	0.08	-0.01	0.00
7	52.84	0.118902	3.28	-10.42	8.89	0.03	0.00	0.04	0.00
8	55.12	0.113983	3.25	0.44	0.02	0.06	0.00	-0.01	0.00
9	59.49	0.105616	3.21	0.30	0.01	-10.89	9.72	0.22	0.00
SUM					95.29		95.27		

of 90% sum of the effective modal shapes

Dir.	k		$3n^{0.5}$	$T_k \leq 0.20s$
x	9	\geq	5.20	$0.106 \leq 0.20$
y	9	\geq	5.20	$0.106 \leq 0.20$

k , is the number of modes taken into account

n , is the number of storeys above the foundation or the top of a rigid basement


T_k , is the period of vibration of mode k

$$a_{CM} = 3.378$$

$$\text{Verification: } \Sigma(M) = 1281.4186, \Sigma(V) = 3884.8373, a = 3.0317$$

9.2 Calculation of seismic accelerations and forces


Section 1

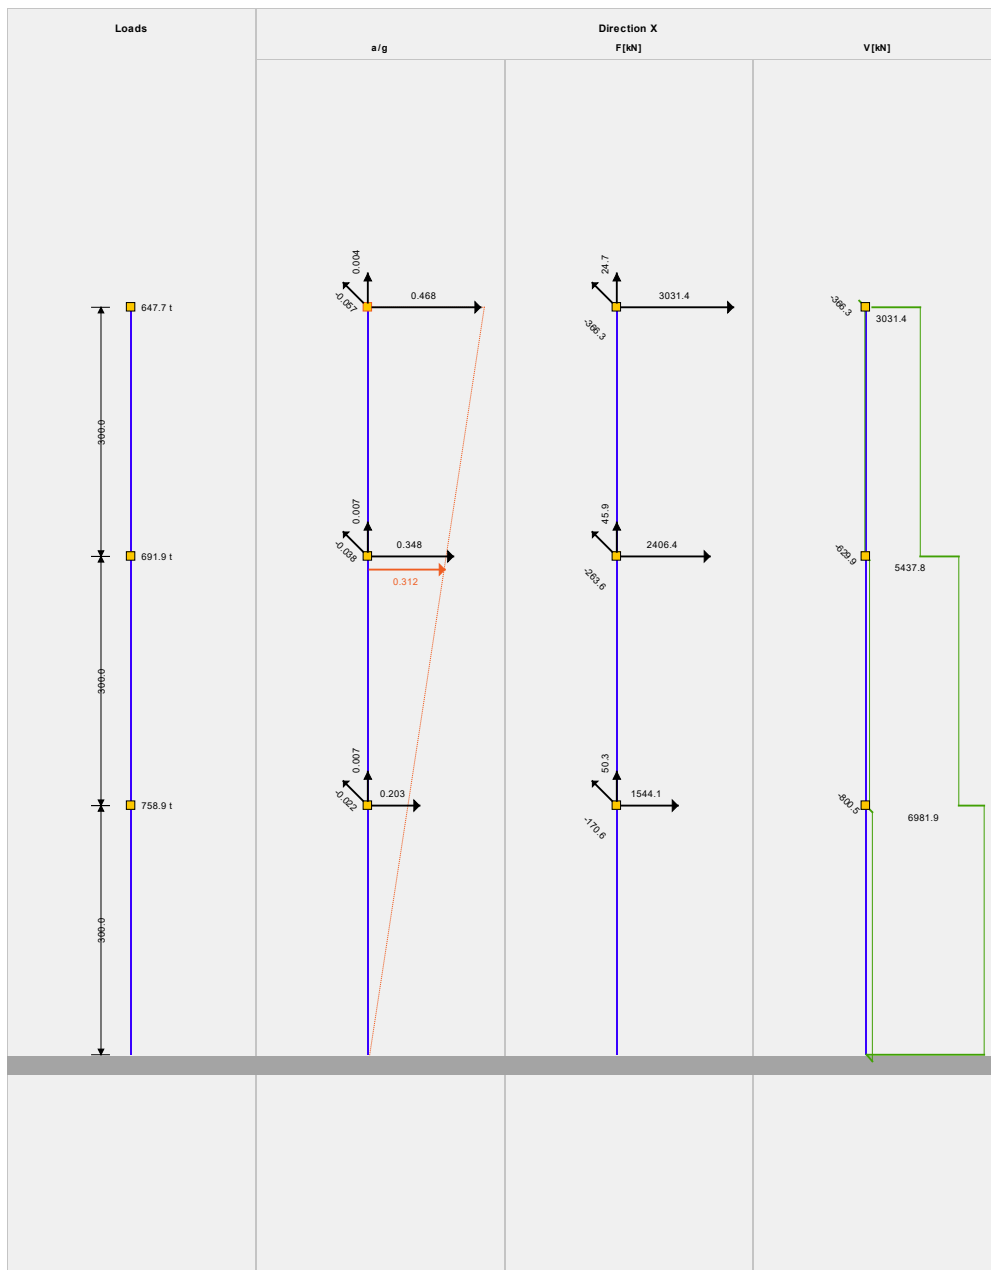




Section 2



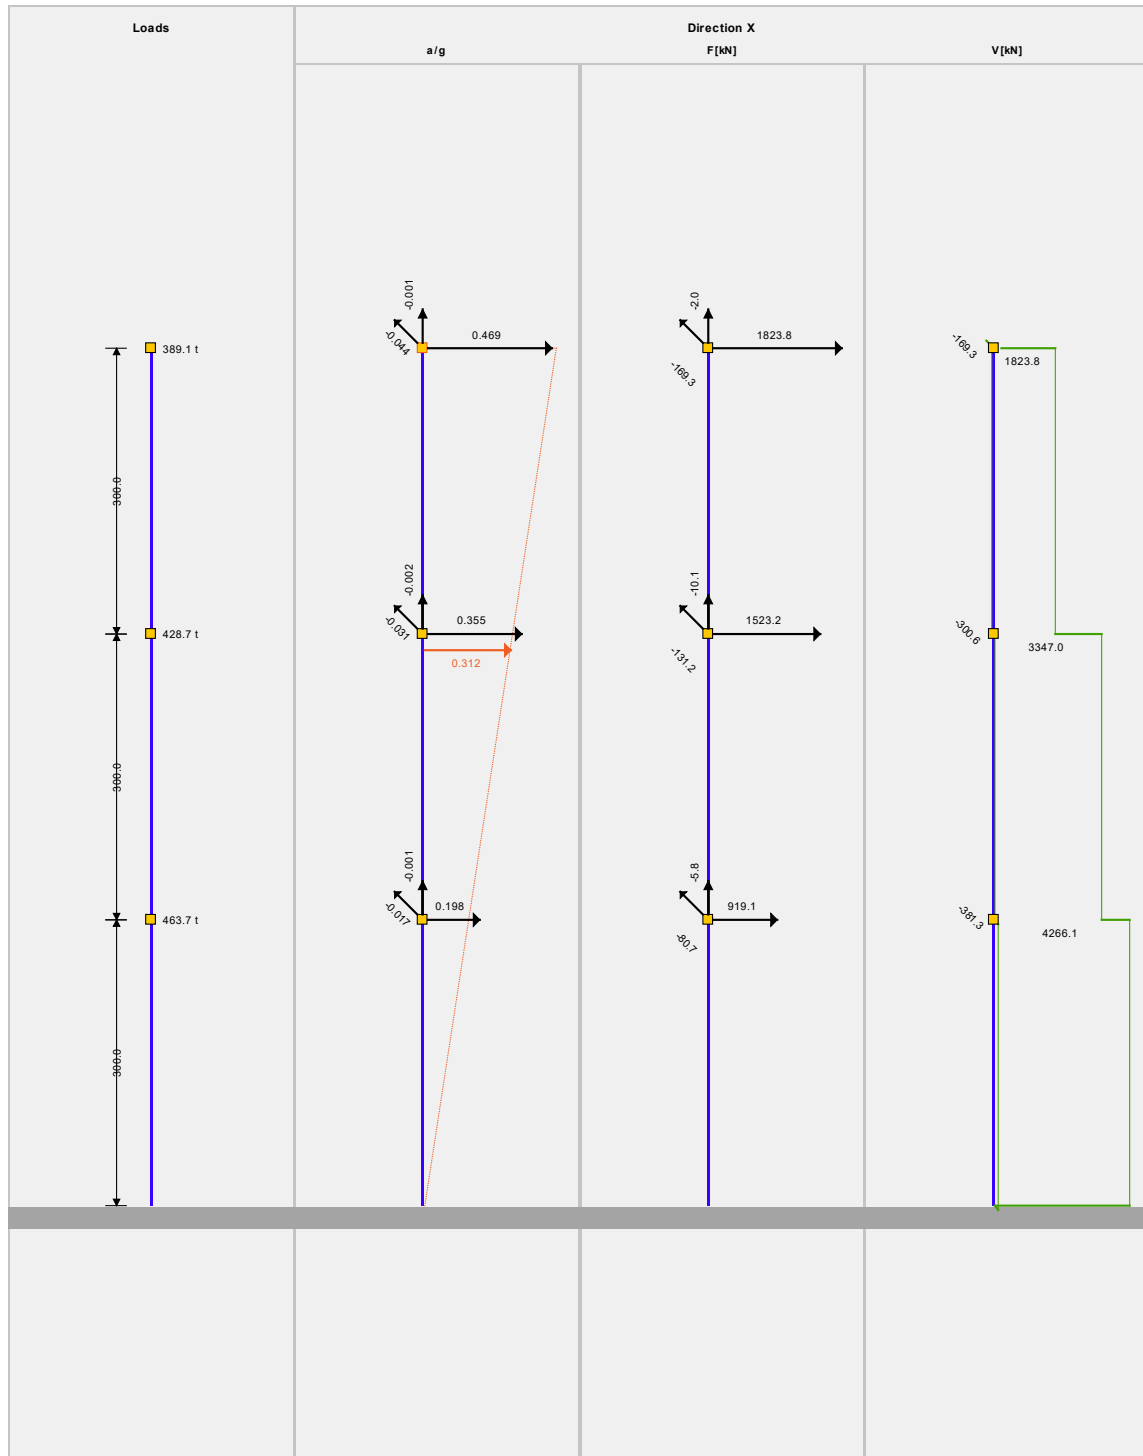

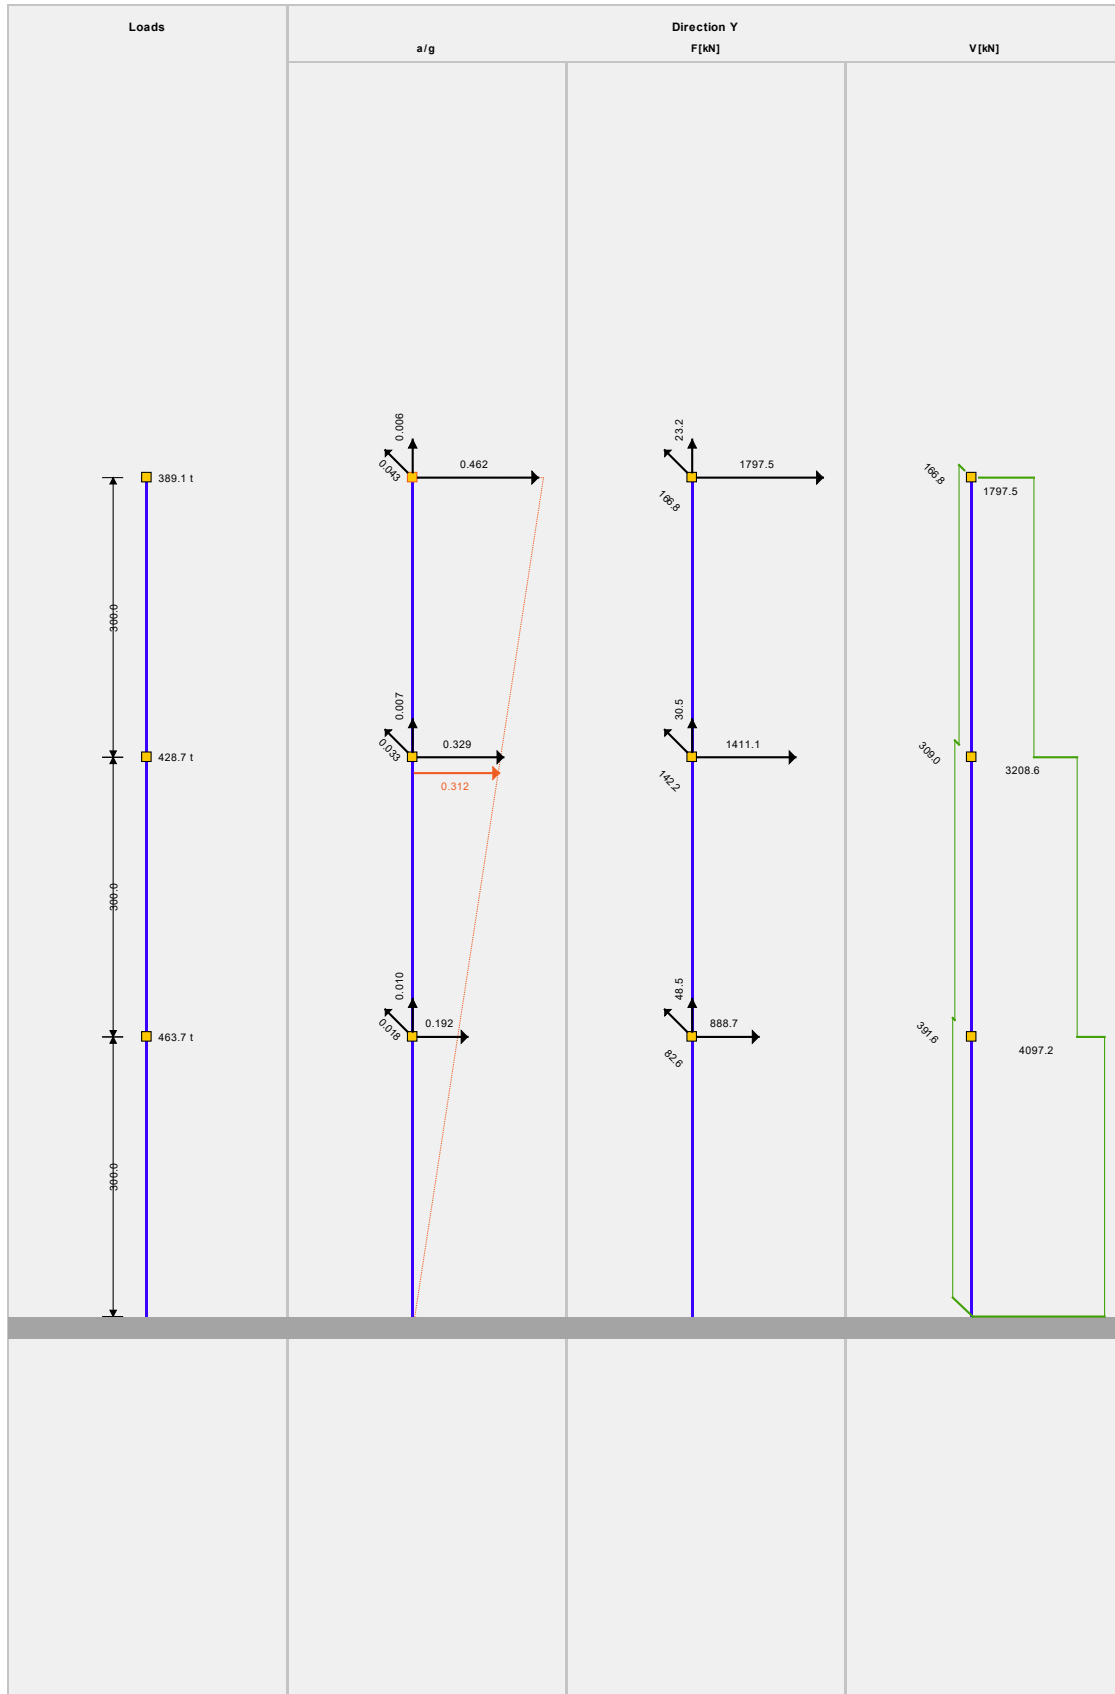

The elements of the structure are also checked in accordance with the allowable deformations caused in them by the action of normative loads. In these combinations the load combination coefficients are accepted as units.

The effect of accidental torsion is included in the calculation of the building being automatically incorporated into the level of seismic forces. The eccentricity of the action of seismic forces for each floor is accepted 5% of the dimension of the building perpendicular to the seismic direction in the study.

10. FOUNDATIONS

The design of the foundations is done in harmony with the structure that will support it from above, in accordance with the geotechnical conditions of the terrain as well as the general requirements of the building.

The basic control criterion according to the limit state combines two important problems: on the one hand we must refer to the resistance of the materials we will use for the foundation structure and on the other hand we must consider the double valence of the terrain, which integrates with the structure can take on a function as both resistive and stressful. To consider the above norms set out some typologies of boundary states: Limit state of Equilibrium as a rigid body (EQU), Limit state of GroundResistance (GEO) and Limit state of Structure Resistance (STR).

For ULS compliant controls the norms provide for two different design approaches defined as "Approch1" and "Approch2". In each approach there are different combinations of groups of partial coefficients for loads (A), for geotechnical parameters (M) and for global resistance (R).

"Approch2" which consists of only a combination of coefficients generally addresses less conservative results than "Approch1" which we have chosen to use in the object in question. According to this approach "Approch1" two combinations of coefficients are provided

Combination 1 (STR) : (A1 + M1 + R1)

Combination 2 (GEO) : (A2 + M2 + R2)

Combination (STR) deals with structural dimensioning and defines high limit state in determining the strength of foundation elements. By applying this combination we have load increases (by means of group A1 coefficients) and we have unchanged the global system and terrain resistances (by means of M1eR1 coefficients).

The combination (GEO) deals with the geotechnical dimensioning of the work and addresses a reduction of terrain and global resistances of the system (by means of the coefficients of the group M2e R2) leaving unchanged the loads (by means of the coefficients of the group A2). In the case of the object in question, which also has the presence of seismicity, the combination of seismic action with other loads is done by using the unit partial safety coefficients for loads, and with the coefficients (GEO) for geotechnical parameters and resistances.

11. STRUCTURE DESCRIPTION

Section 1


The building is designed with 3 floor above ground.

The floor height is as follows:

Ground Floor:	3.80 m
First Floor:	3.80 m
Second Floor:	3.80 m

The object is conceived and calculated with frames giving priority to both directions of the object to guarantee the displacements allowed by the actions of external loads, mainly seismic ones.


The picture below shows the three-dimensional view of the structure.

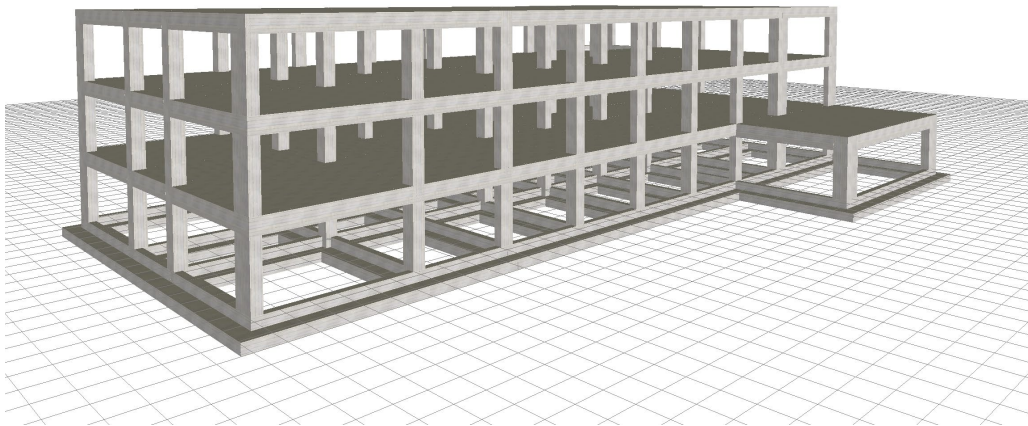

Foundations

The design of the foundations is based on the relevant geological report as well as the recommendations of this report. The foundations will be supported in the second layer, according to the study after this is reinforced with a 30 cm layer of compacted gravel. They are conceived with crossed beams with inverted T-section. The beams have a height of 120 cm, the depth needed to ensure the insertion of the building.

To reach the quota of 0.00 above the beam will be erected walls b / arms 30cm thick with a height of 102 cm. Under the foundation sole will be filled with a layer of concrete 16/20 with a thickness of 10cm, and a layer of gravel with a thickness of 30cm.

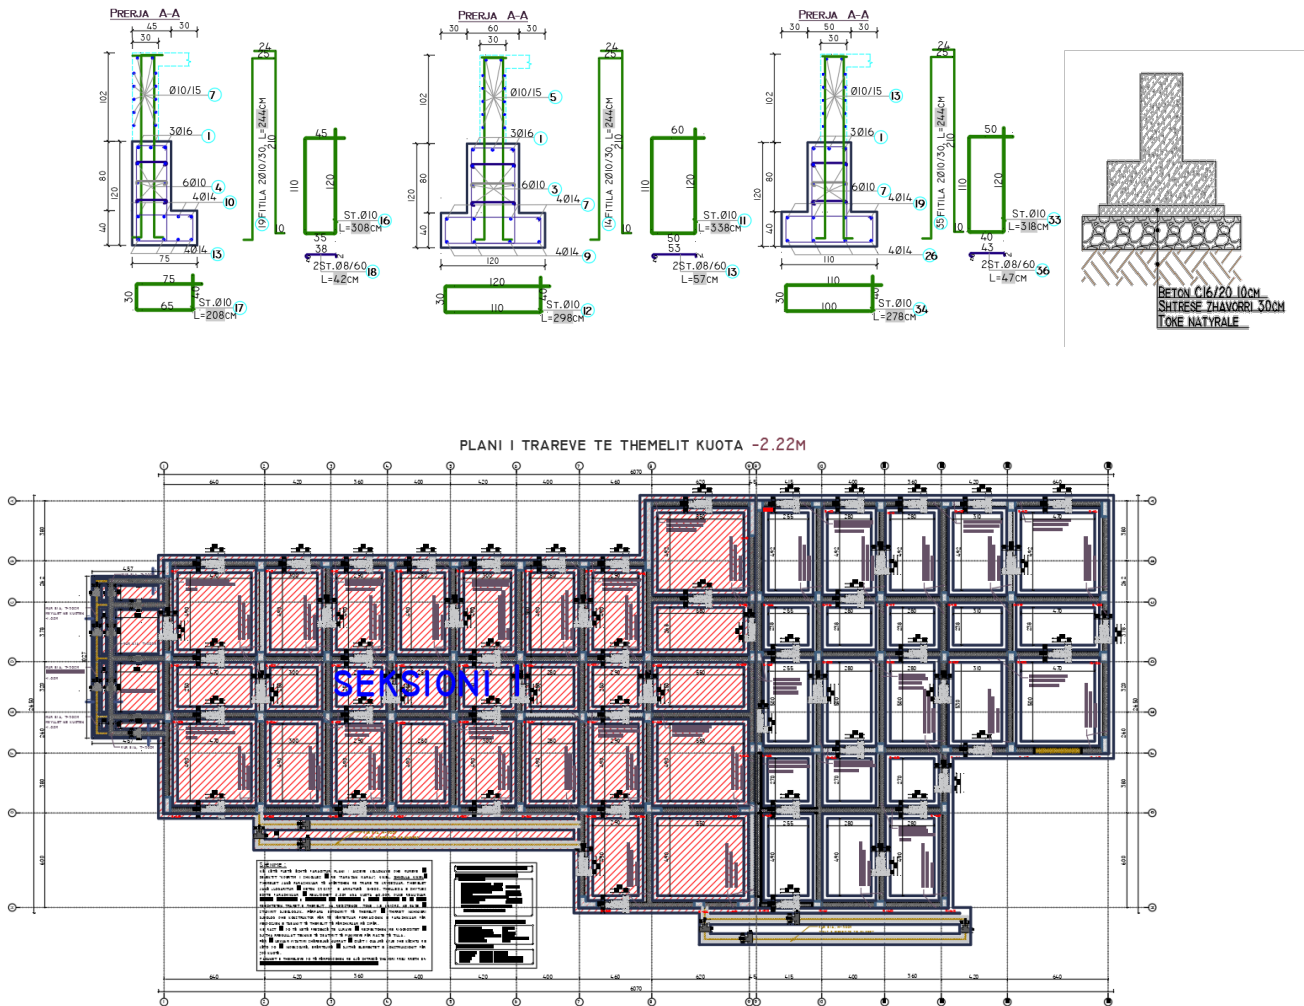




Columns

The columns have the shape of a rectangular cross section (b_{xh}=40x60cm), (b_{xh}=40x440cm), (b_{xh}=50x60cm), (b_{xh}=40x220cm), and L section (b_{xh}=40x60x100x30cm), (b_{xh}=40x70x110x40cm), with unchanging section according to the height. The reinforcement will be made with bars $\phi 12$, $\phi 14$, $\phi 16$, $\phi 18$ and $\phi 20$. The stirrups to be used will be $\phi 10$. The stirrups will be placed for the critical area every 10 cm, while for the non-critical area every 20 cm.




The horizontal structures are made of monolithic slabs with thickness $t = 15\text{cm}$, which will be reinforced with $\phi 10$ every 15cm and $\phi 12$ every 15 cm .



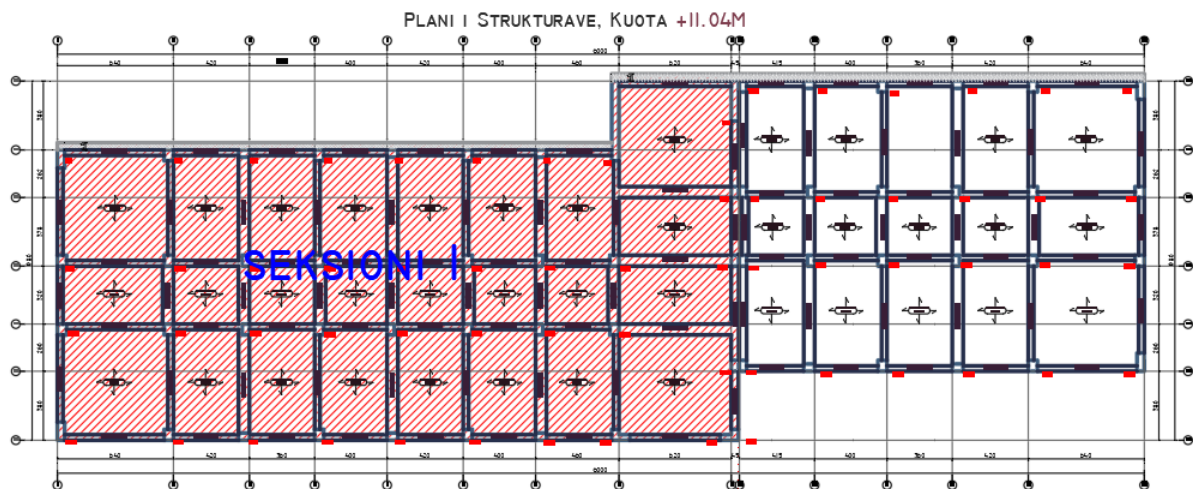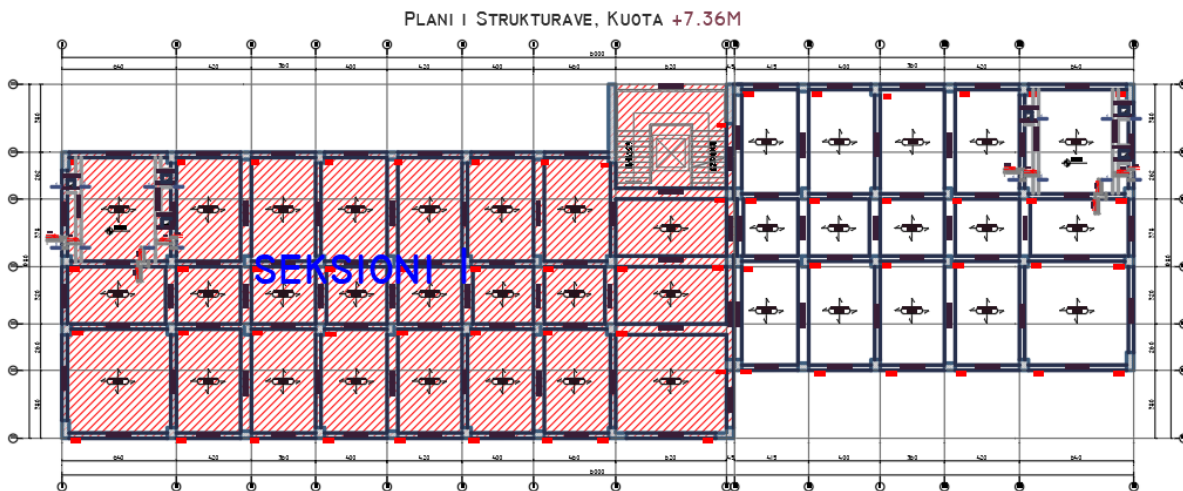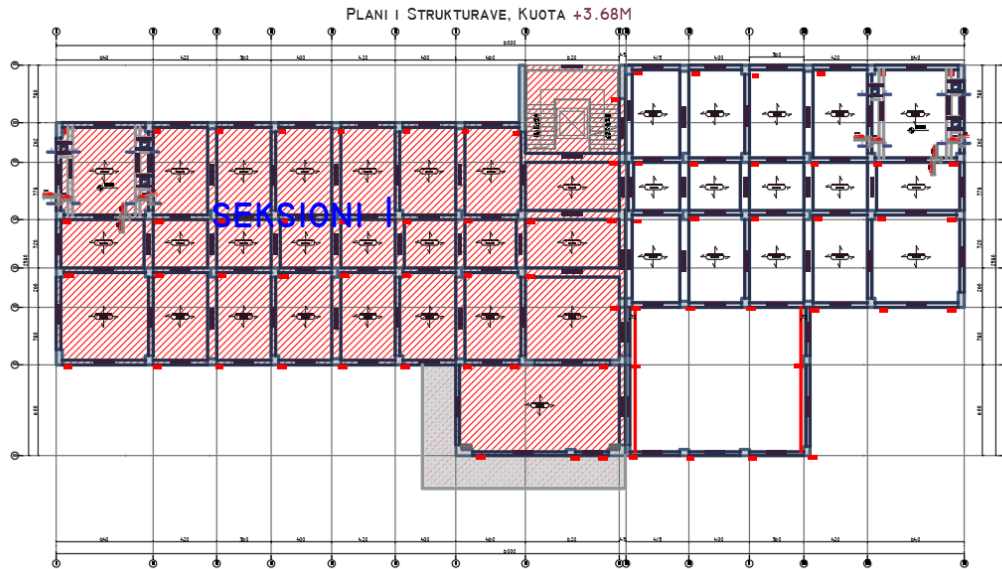

Beams

The beams of the structure will have a rectangular cross section with dimensions $b \times h = 30 \times 50 \text{ cm}$, $b \times h = 40 \times 50 \text{ cm}$, $b \times h = 25 \times 70 \text{ cm}$, $b \times h = 30 \times 60 \text{ cm}$, $b \times h = 60 \times 30 \text{ cm}$ and $b \times h = 55 \times 30 \text{ cm}$. The placement of beams in the building is conditioned by the architectural requirement to have a flat ceiling surface in all spaces.

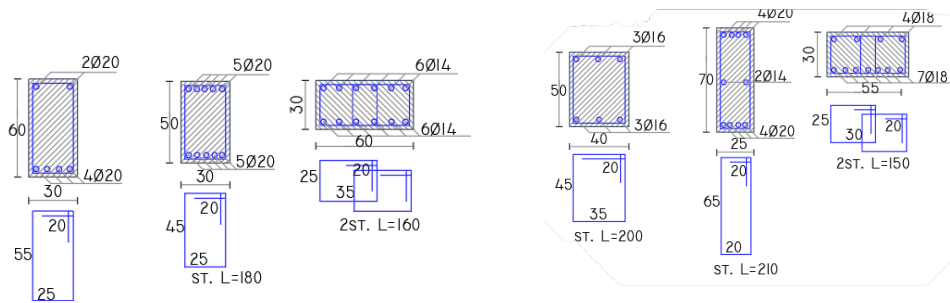

In the calculation of beams are placed trapezoidal or triangular loads coming from the soles as well as uniform loads coming from the walls. The brick masonry in the building is provided with a thickness of 20 and 30 cm made with horizontal holes (lightened bricks). In the calculation scheme, the masonry load is accepted and evenly distributed in the floor with an intensity of 150 daN / m^2 . This allows the possibility of placing it in any place of the solet even if the layout of the premises is changed.

Section 2

The building is designed with 3 floor above ground.

The floor height is as follows:

Ground Floor:	3.80 m
First Floor:	3.80 m
Second Floor:	3.80 m


The object is conceived and calculated with frames giving priority to both directions of the object to guarantee the displacements allowed by the actions of external loads, mainly seismic ones.

The picture below shows the three-dimensional view of the structure.

Foundations


The design of the foundations is based on the relevant geological report as well as the recommendations of this report. The foundations will be supported in the second layer, according to the study after this is reinforced with a 30 cm layer of compacted gravel. They are conceived with crossed beams with inverted T-section. The beams have a height of 120 cm, the depth needed to ensure the insertion of the building.

To reach the quota of 0.00 above the beam will be erected walls b / arms 30cm thick with a height of 102 cm. Under the foundation sole will be filled with a layer of concrete 16/20 with a thickness of 10cm, and a layer of gravel with a thickness of 30cm.

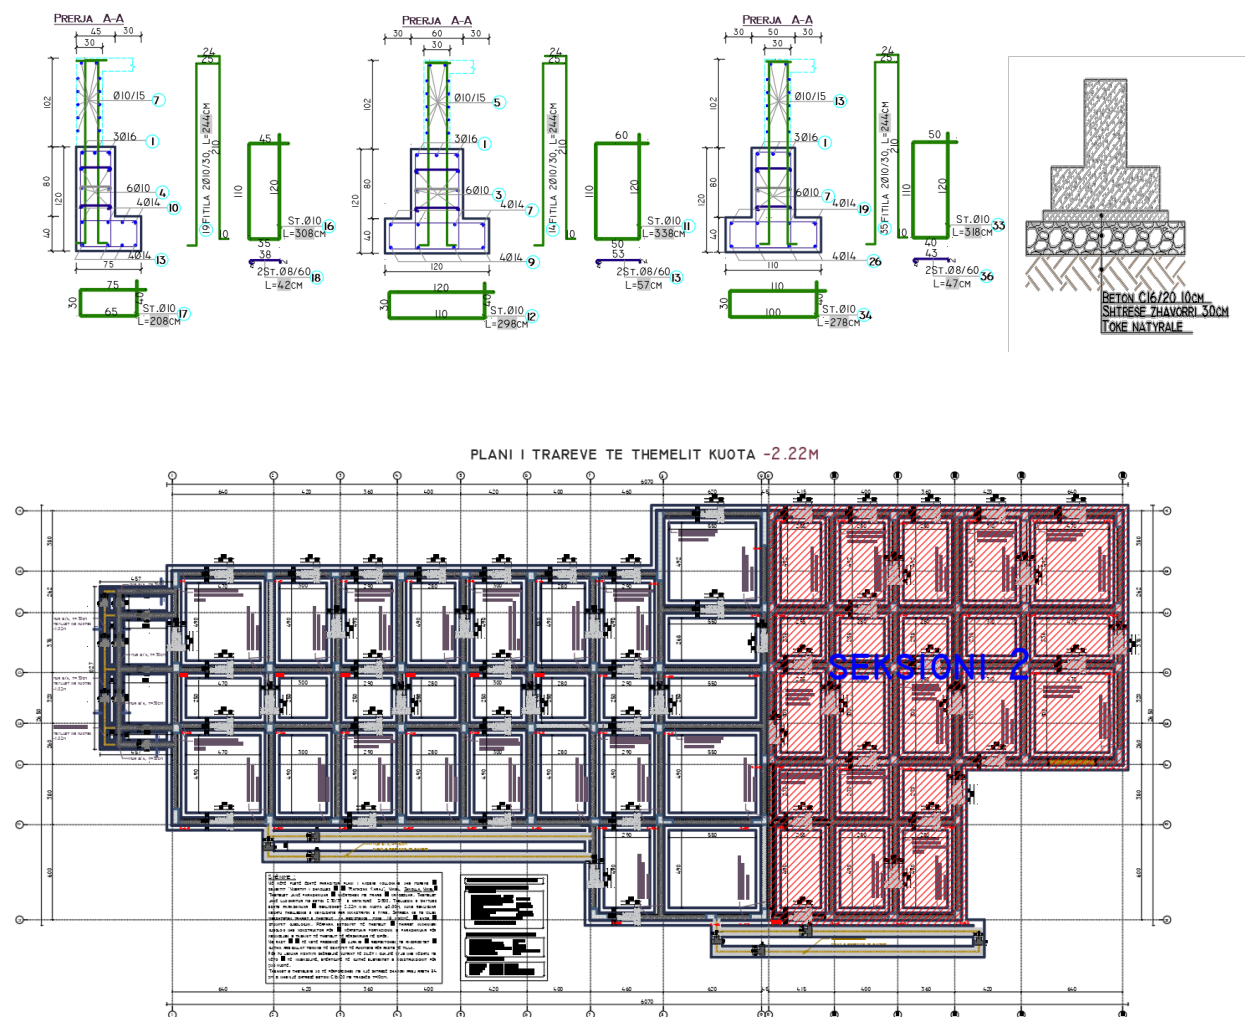


Columns




The columns have the shape of a rectangular cross section (b_{xh}=40x60cm),(b_{xh}=40x440cm),(b_{xh}=50x60cm),(b_{xh}=40x220cm),(b_{xh}=25x70),(b_{xh}=25x60) and section(b_{xh}=40x60x100x30cm),(b_{xh}=40x70x110x40cm), with unchanging section according to the height. The reinforcement will be made with bars $\phi 12$, $\phi 14$, $\phi 16$, $\phi 18$ and $\phi 20$. The stirrups to be used will be $\phi 10$. The stirrups will be placed for the critical area every 10 cm, while for the non-critical area every 20 cm.

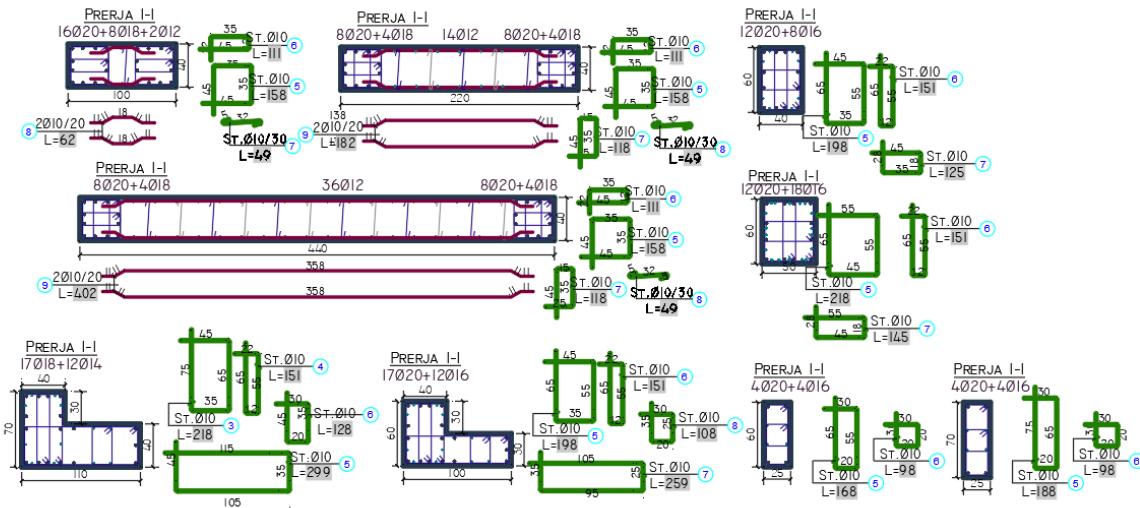

Slabs


The horizontal structures are made of monolithic slabs with thickness $t = 15\text{cm}$, which will be reinforced with $\phi 10$ every 15cm and $\phi 12$ every 15 cm.

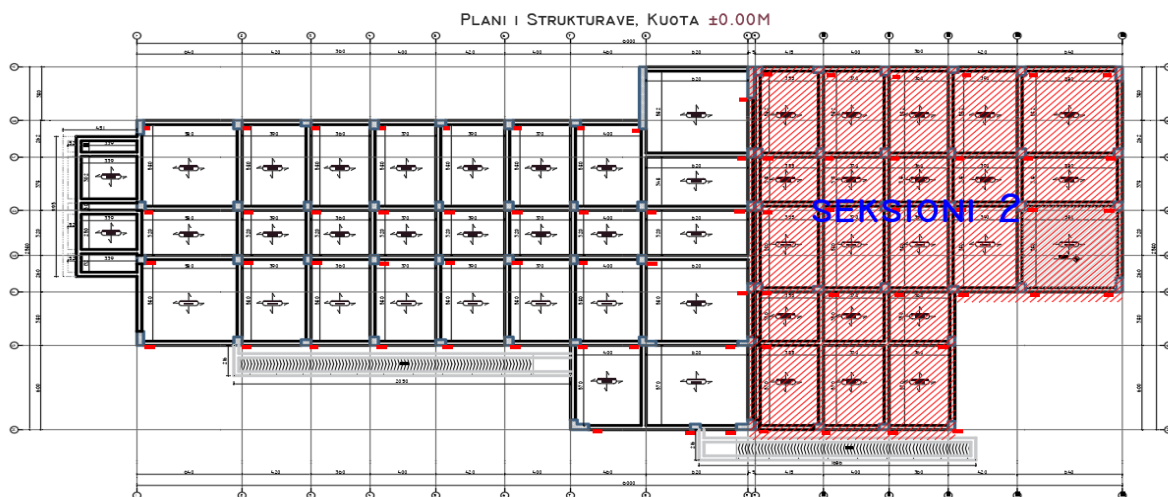

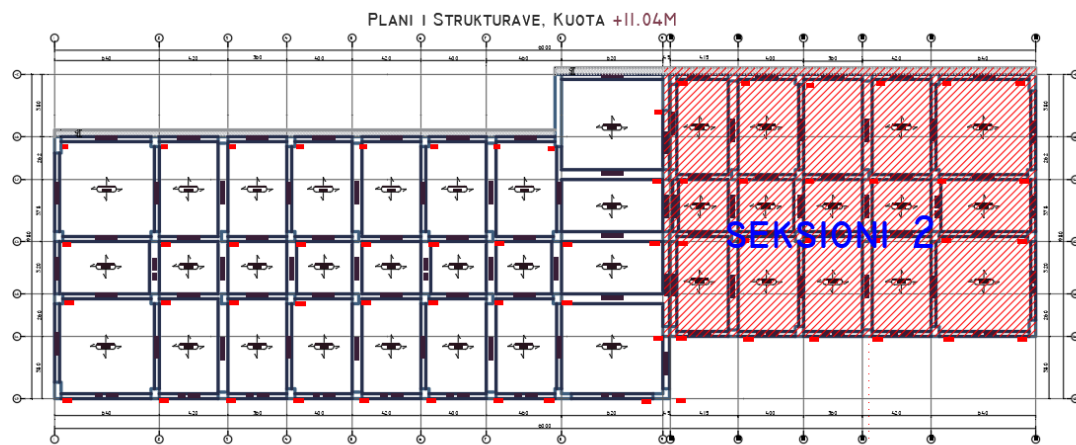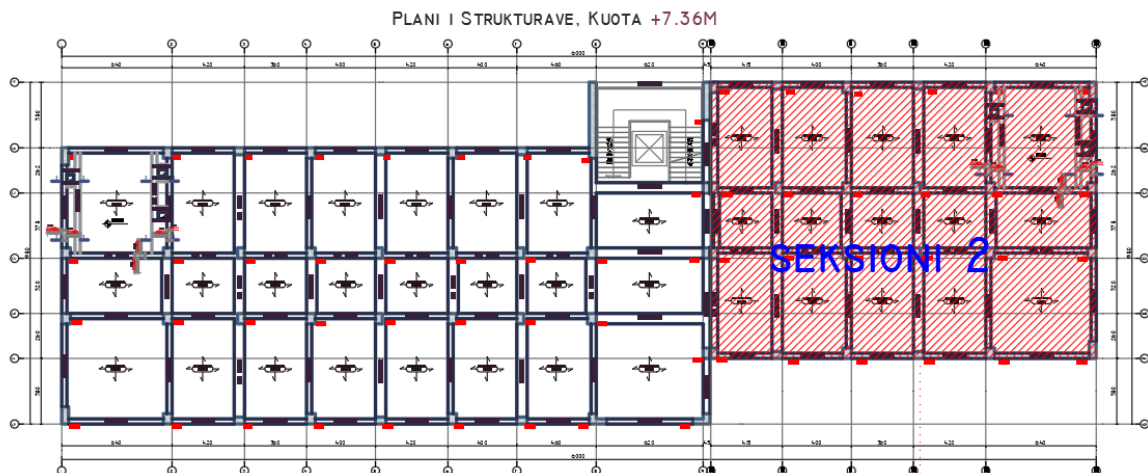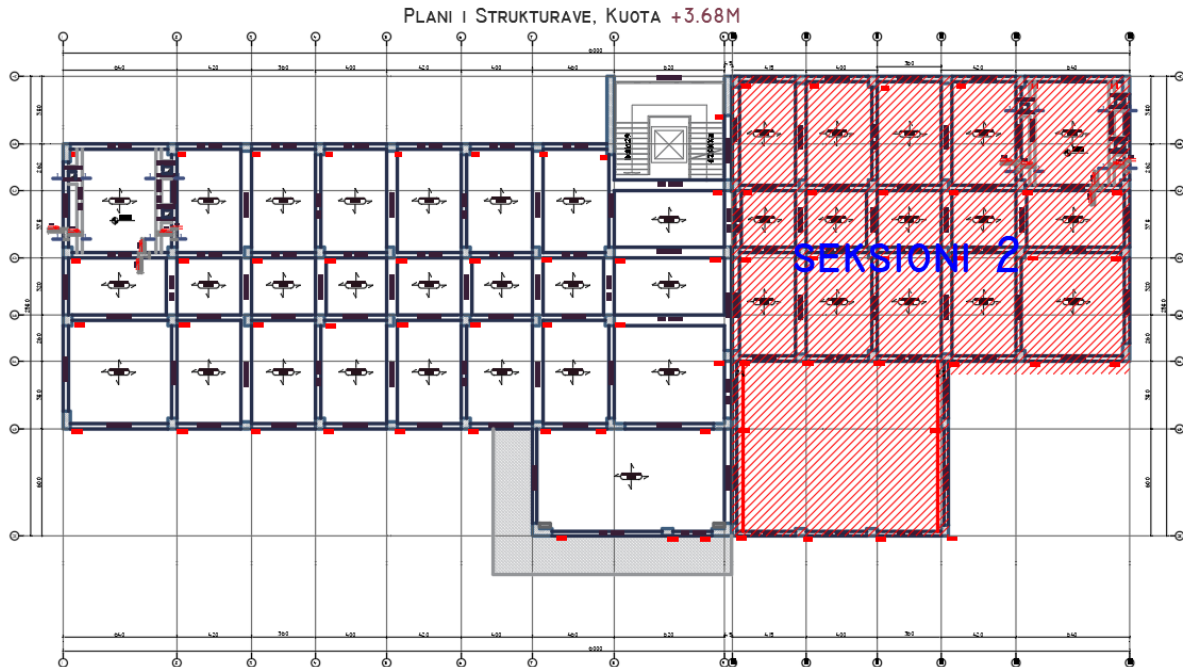


Beams

The beams of the structure will have a rectangular cross section with dimensions $b \times h = 30 \times 50 \text{ cm}$, $b \times h = 40 \times 50 \text{ cm}$, $b \times h = 25 \times 70 \text{ cm}$, $b \times h = 30 \times 60 \text{ cm}$, $b \times h = 60 \times 30 \text{ cm}$, $b \times h = 25 \times 50$ and $b \times h = 55 \times 30 \text{ cm}$. The placement of beams in the building is conditioned by the architectural requirement to have a flat ceiling surface in all spaces.

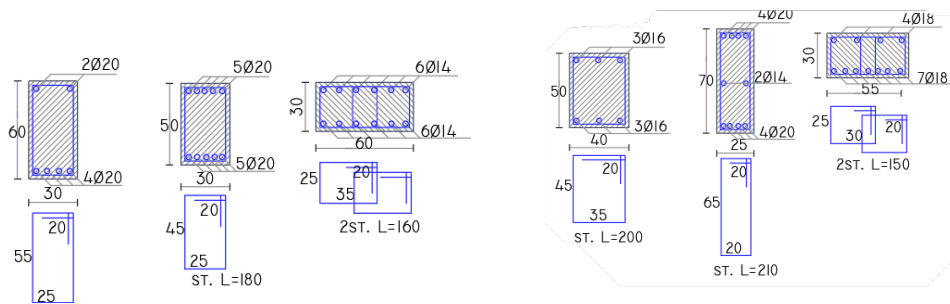

In the calculation of beams are placed trapezoidal or triangular loads coming from the soles as well as uniform loads coming from the walls. The brick masonry in the building is provided with a thickness of 20 and 30 cm made with horizontal holes (lightened bricks). In the calculation scheme, the masonry load is accepted and evenly distributed in the floor with an intensity of 150 daN / m^2 . This allows the possibility of placing it in any place of the solet even if the layout of the premises is changed.

12. RESULTS

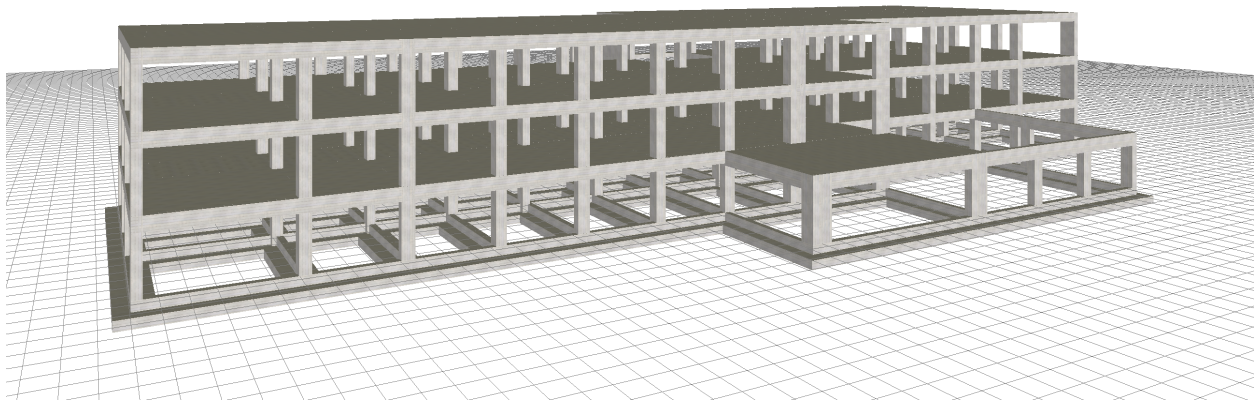

The results of the calculations as well as the controls of the structural elements (slabs, beams, columns, walls, foundations) are given on the attached CD. Based on the results of dimensioning of the elements, their reinforcement was done as well as the detailing of each element in particular.

Designer . Eng. Edison DRISHTI

Tiranë, 2020