

Annex 2 - Pictures and Floor Plans for Illustration:



Fig. 1 - Well site ready for fencing



Fig 2 Example of well headwork to be replaced

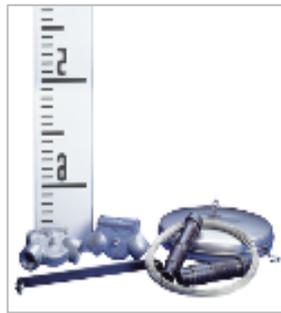


Fig. 3 - Level Indicator Example



Fig. 4 -Example of Filter Skid



Fig. 5 - Example of buildings for WTP and Chlorine Store



Fig. 6 - Example of Pontoon



Fig. 7 – Example of four float pontoon on left and boom arm on right




Fig 8 - Fedor Tank



Fig. 9 - Example of kitset shed (Typhoon rating required)

Fig. 10:

FLOW & PIPE LINE DIAGRAMATIC FROM QUARRY POND TO WTP TO FEDOR TANK

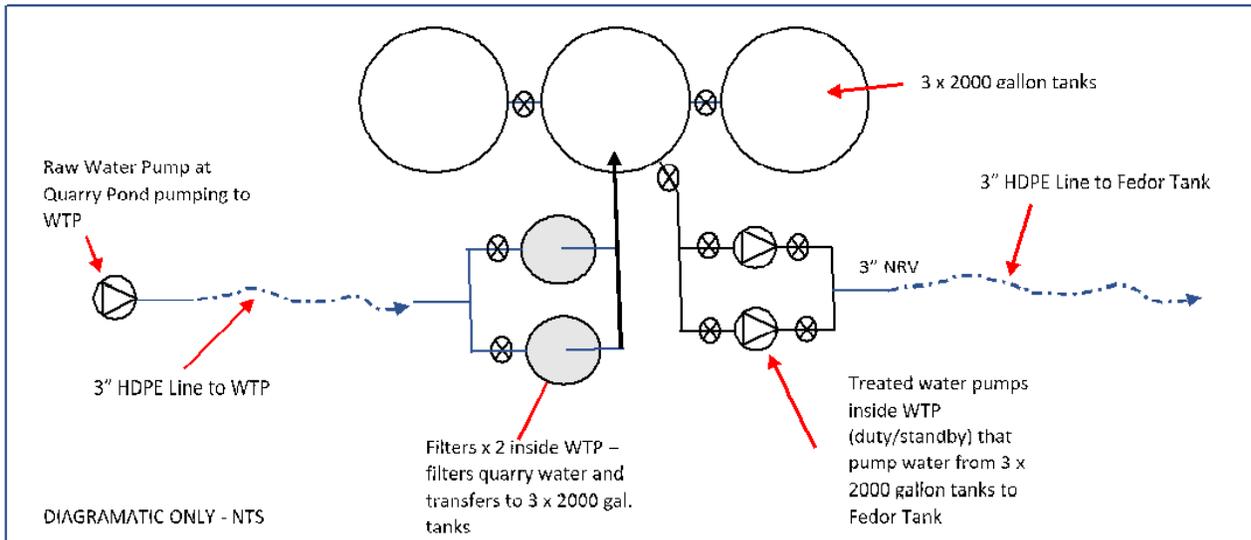

Building Floor Plans

All building shall have 6" thick reinforced concrete bases and 4" thick reinforced concrete roofs with 1' overhang.

Roof will slope with front wall height being 8' high and rear wall being 7' high.

Dimensions are approximate only and based on concrete block 16" long x 4" wide.

Fig. 11 - Item (S.No.2) Concrete block chlorine shed at Well No. 1

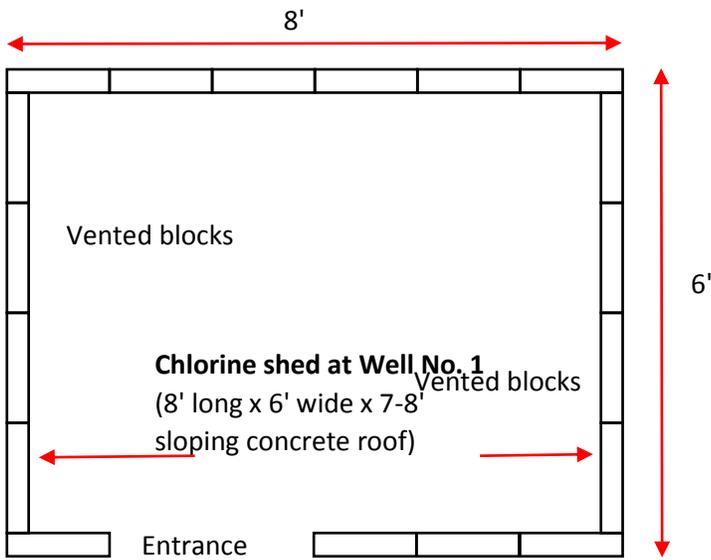


Fig.12 - Item (S.No. 2) Concrete block Chlorine store


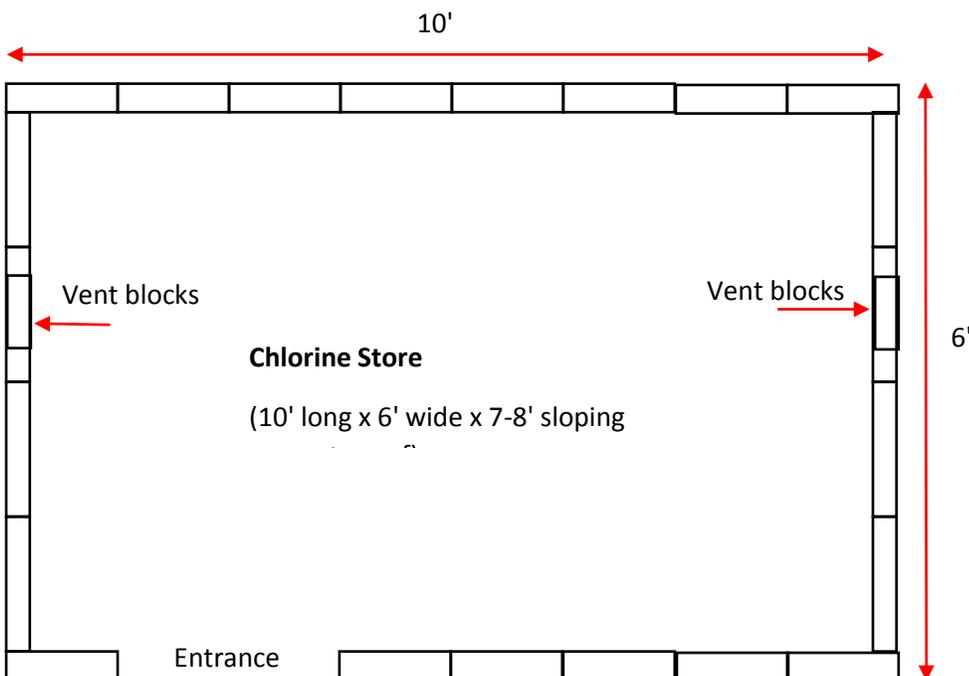


Fig. 13 - Item (S.No. 2) Concrete block WTP Building

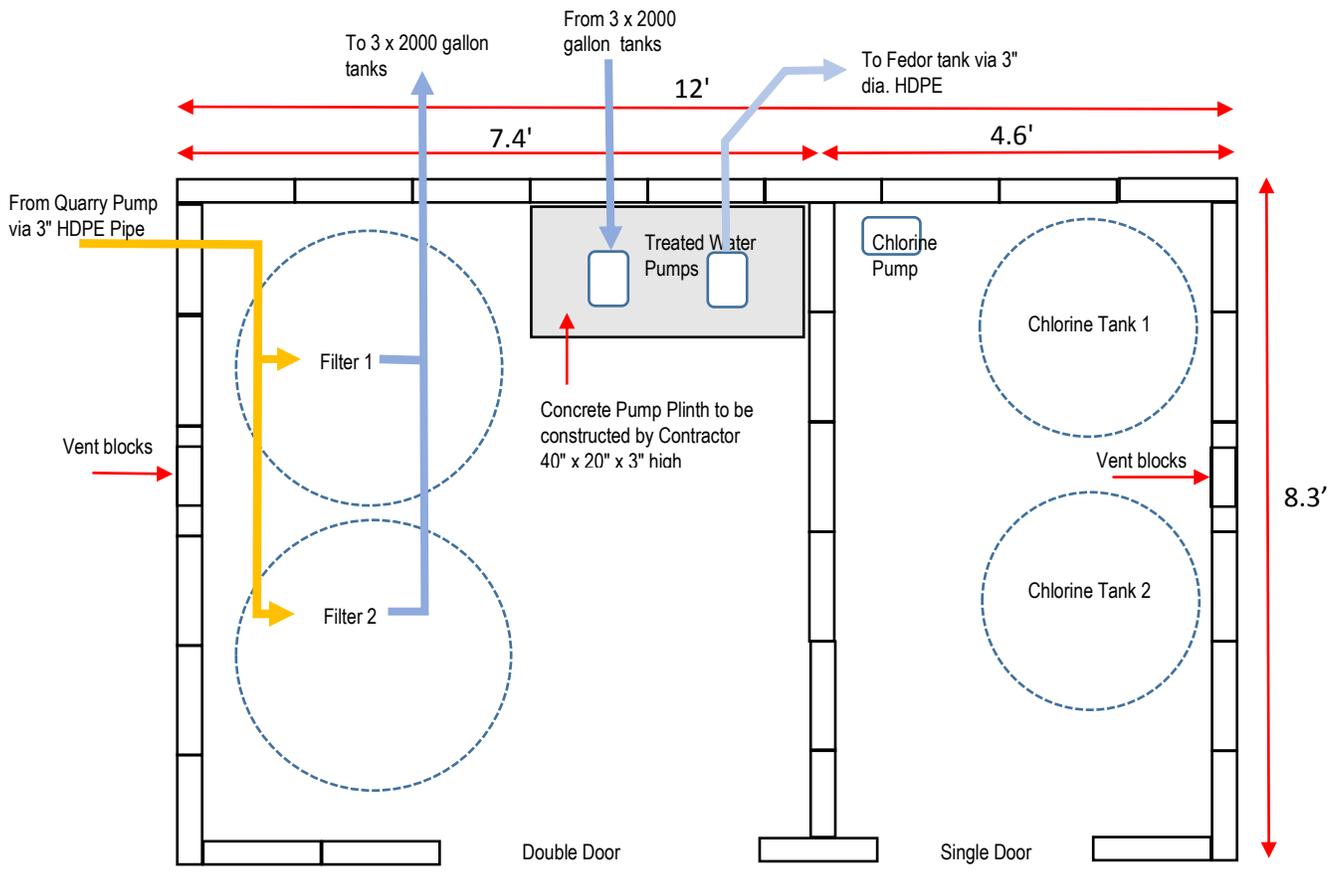

WTP BUILDING (12' long x 8.3' wide x 7-8' sloping concrete roof)

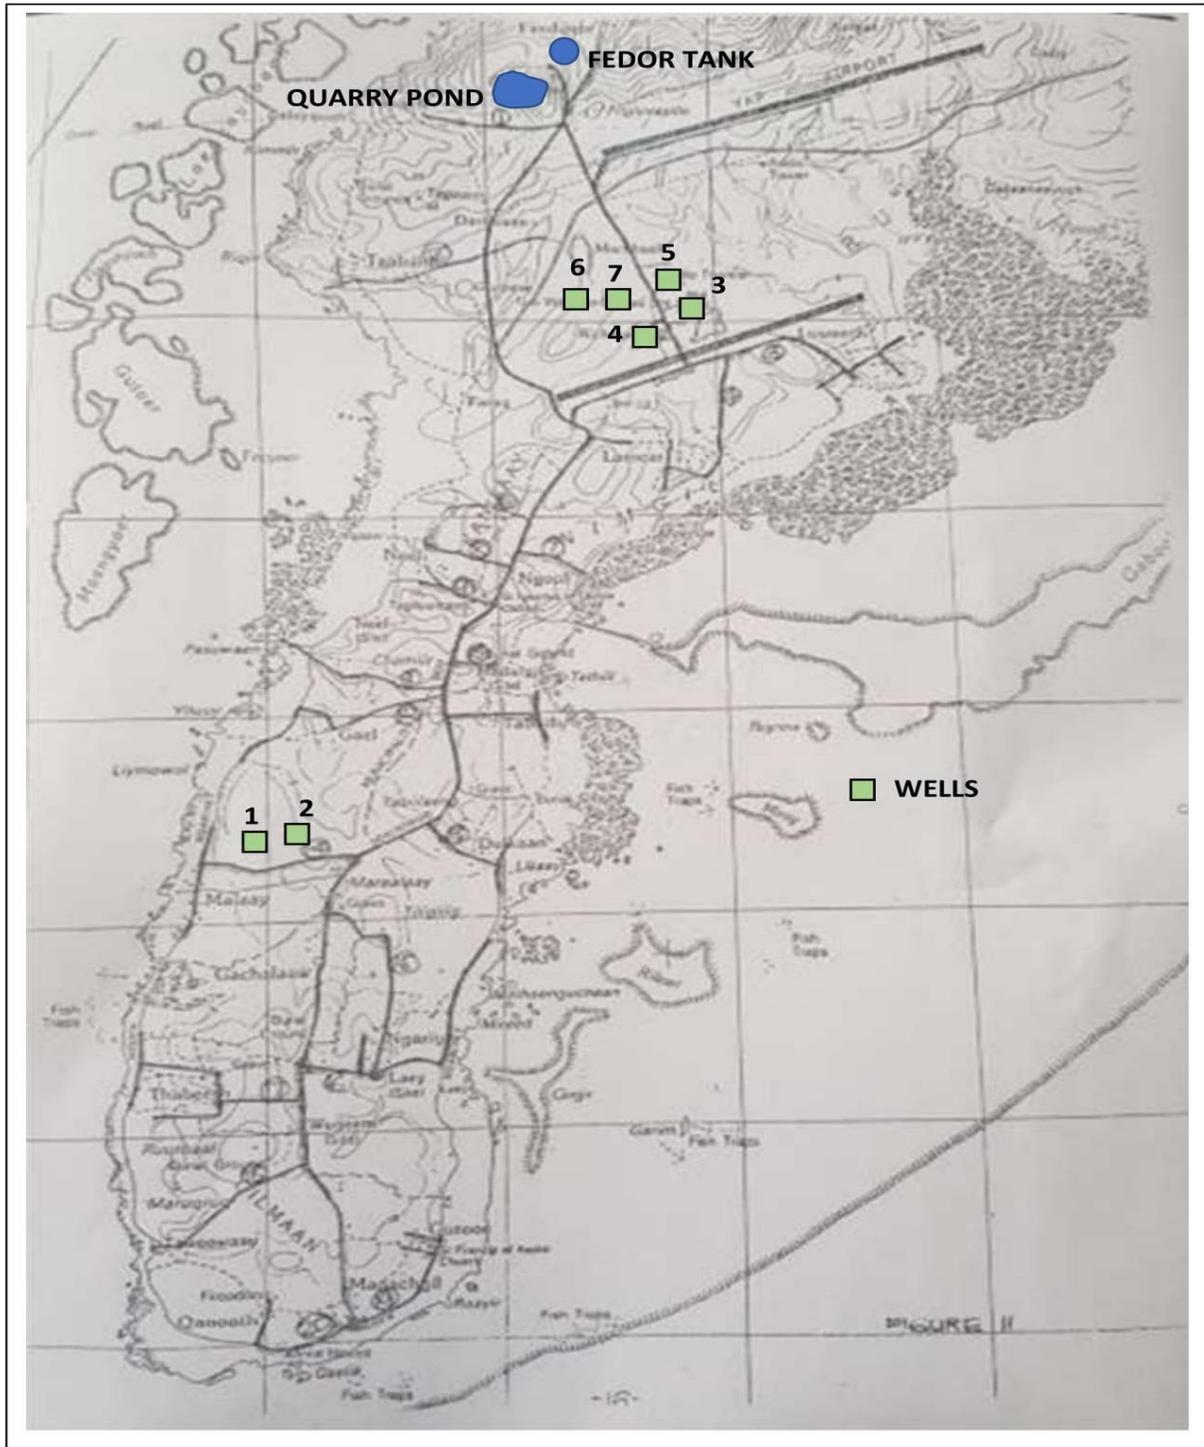


Fig. 14 - Map showing location of Tube Wells