
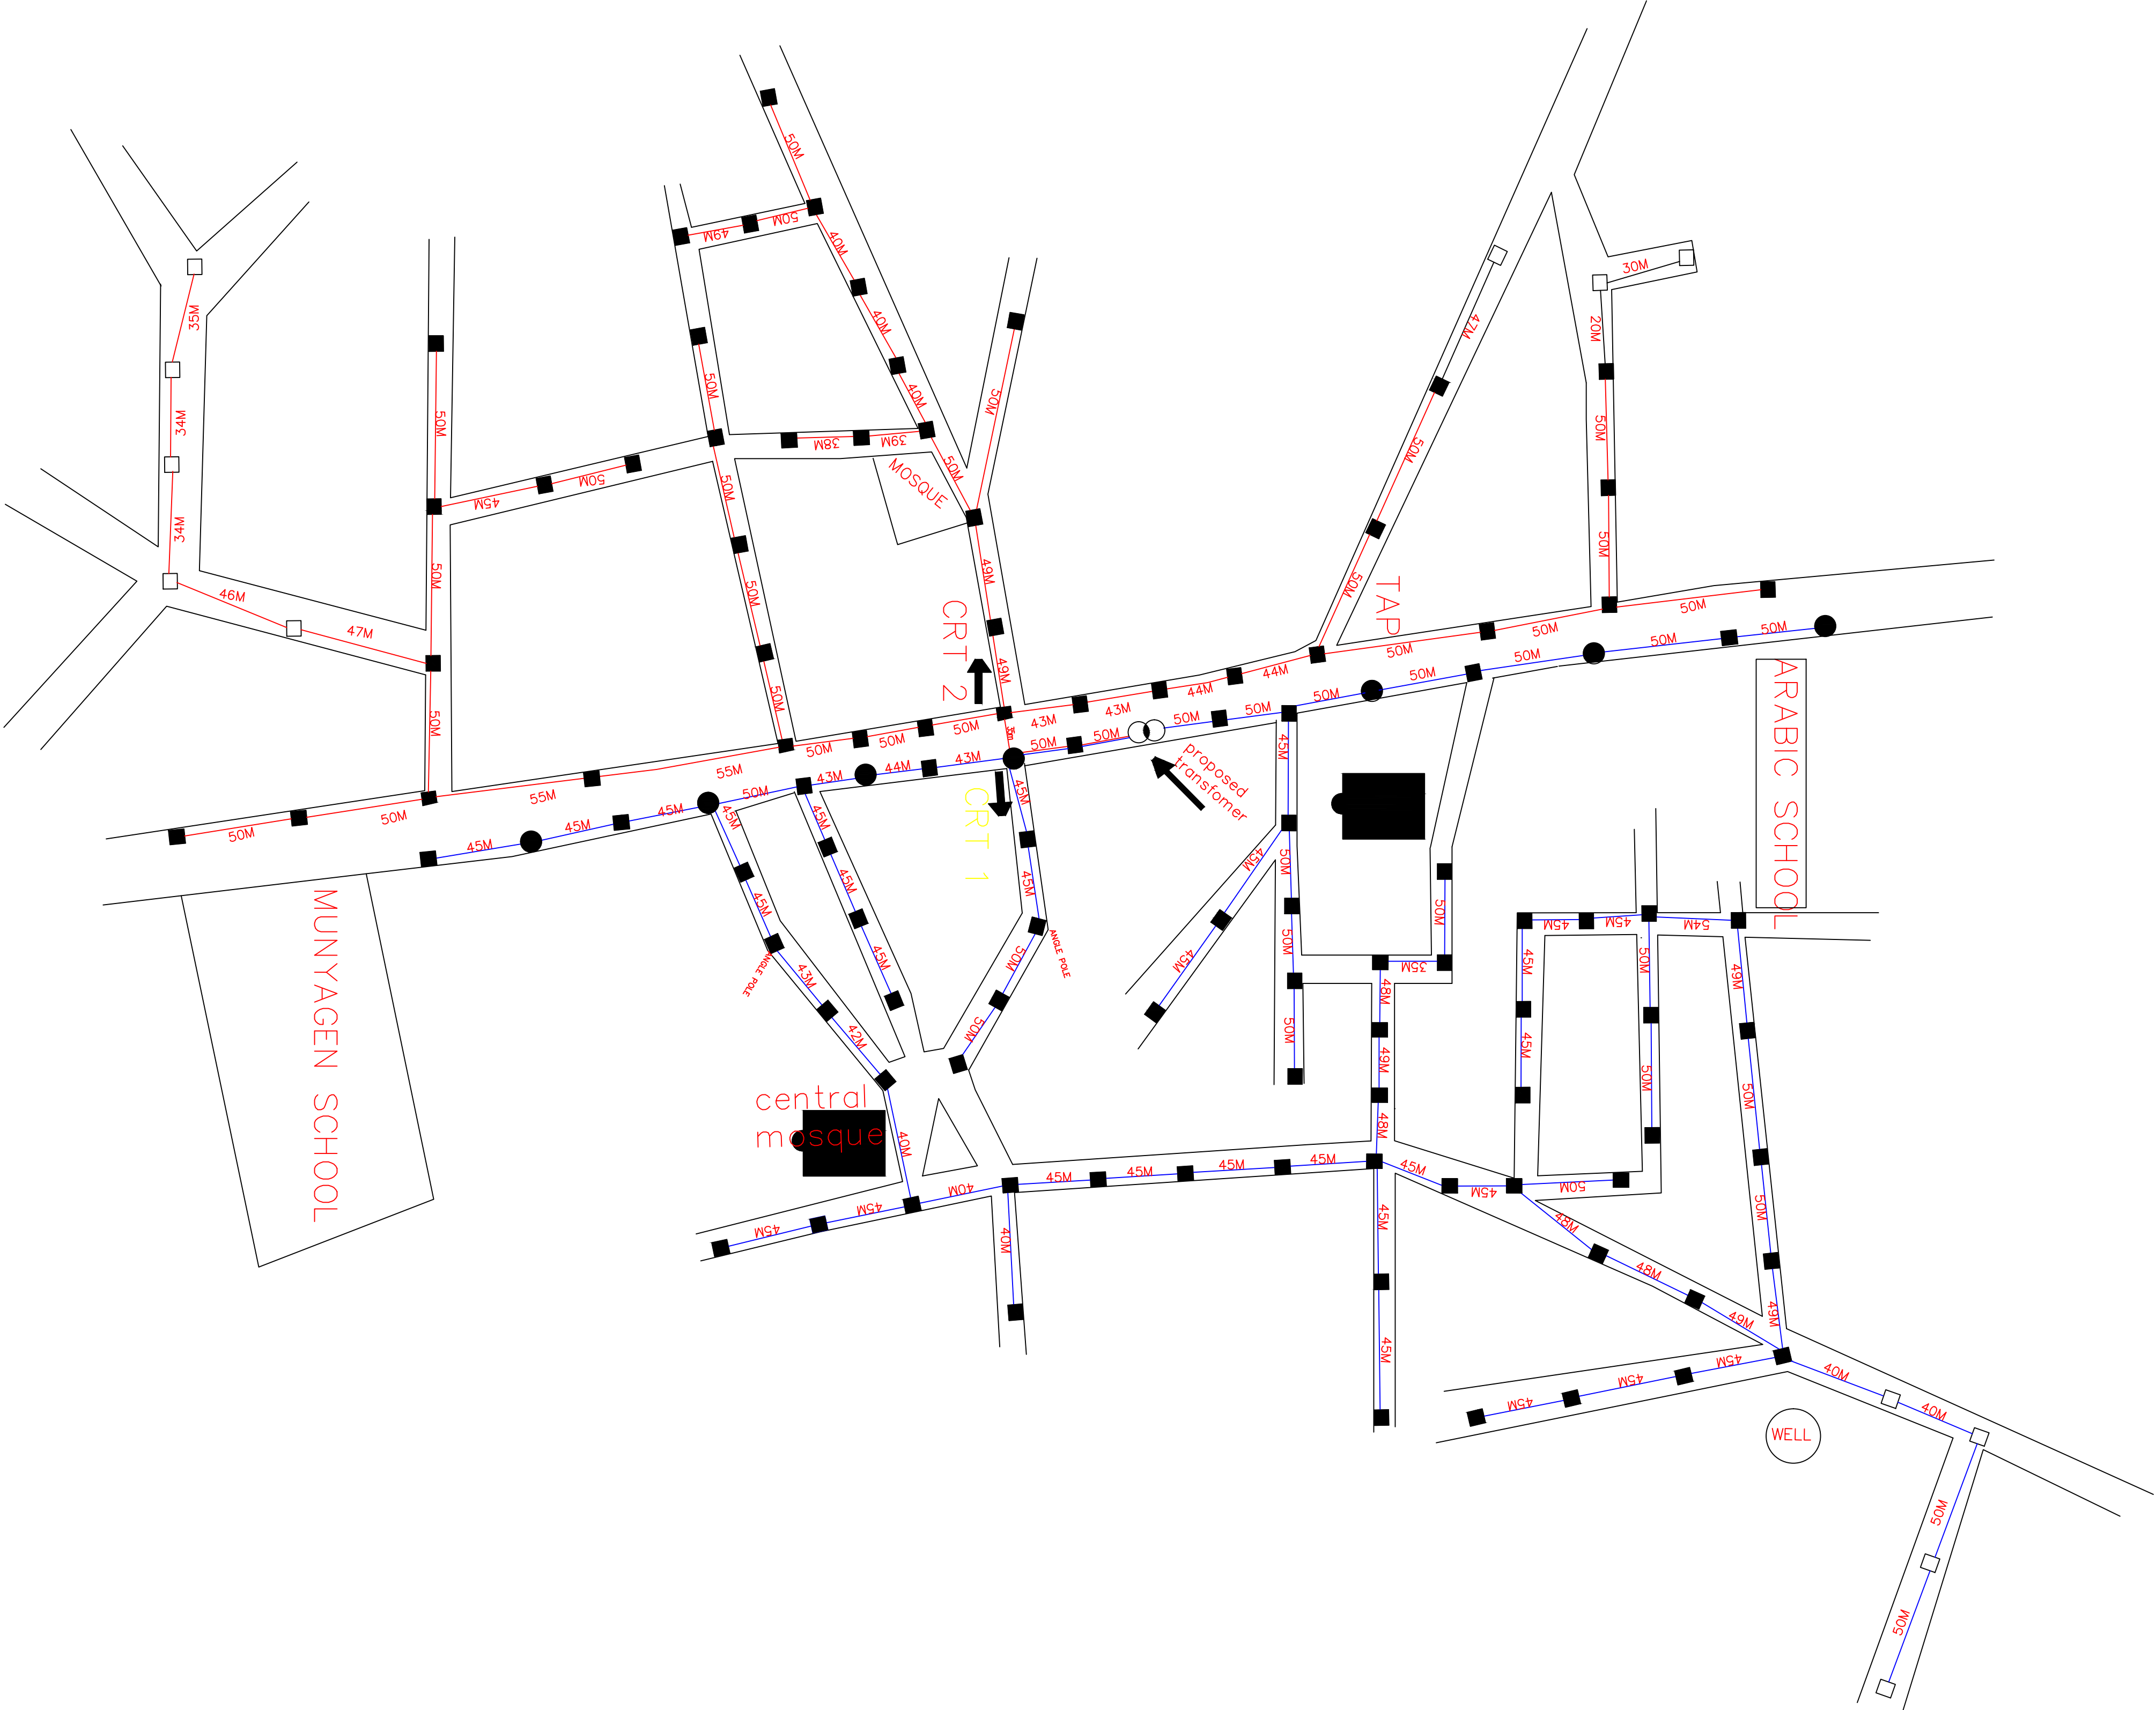



MUNYAGEN VILLAGE (NUIMI)

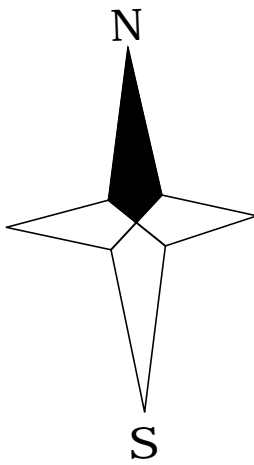

MATERIALS	
TOTAL 4X50+ 1X16sq.mm =	1,258m
TOTAL 4X35+ 1X16sq.mm =	4,258m
32" POLE = 7	TOTAL LV POLE = 12
28" POLE = 5	
TOTAL EARTHING POINTS =	
NUMBER OF TRANSFORMER = 1	
TRIMMING = 1	

Legend	Description
	Proposed MV pole
	Proposed LV steel pole
	Proposed pole mounted transformer
	Proposed 4x70+ 1x16sq.mm
	Proposed 30kV line
	Proposed pole earthing

SURVEYED BY: MUHAMMED SABALLY, YASSIN CEESAY, OUSMAN JATTA	<div>CLIENT</div> <div></div> <div>NATIONAL WATER AND ELECTRICITY COMPANY LTD. (NAWEC)</div>	PROJECT CONSULTANCY SERVICES FOR DESIGN, SUPERVISION AND TENDERING OF THE PACD UNDP PROJECT AT NORTH BANK REGION, THE GAMBIA
DESIGNED BY : YASSIN CEESAY		
CHECKED BY: Assan Colley		TITLE PROPOSED LV NETWORK OF 100KVA DISTRIBUTION TRANSFORMER AT MUNYAGEN VILLAGE, NUIMI (NBR)