



SITA NUNKU, NIUMI

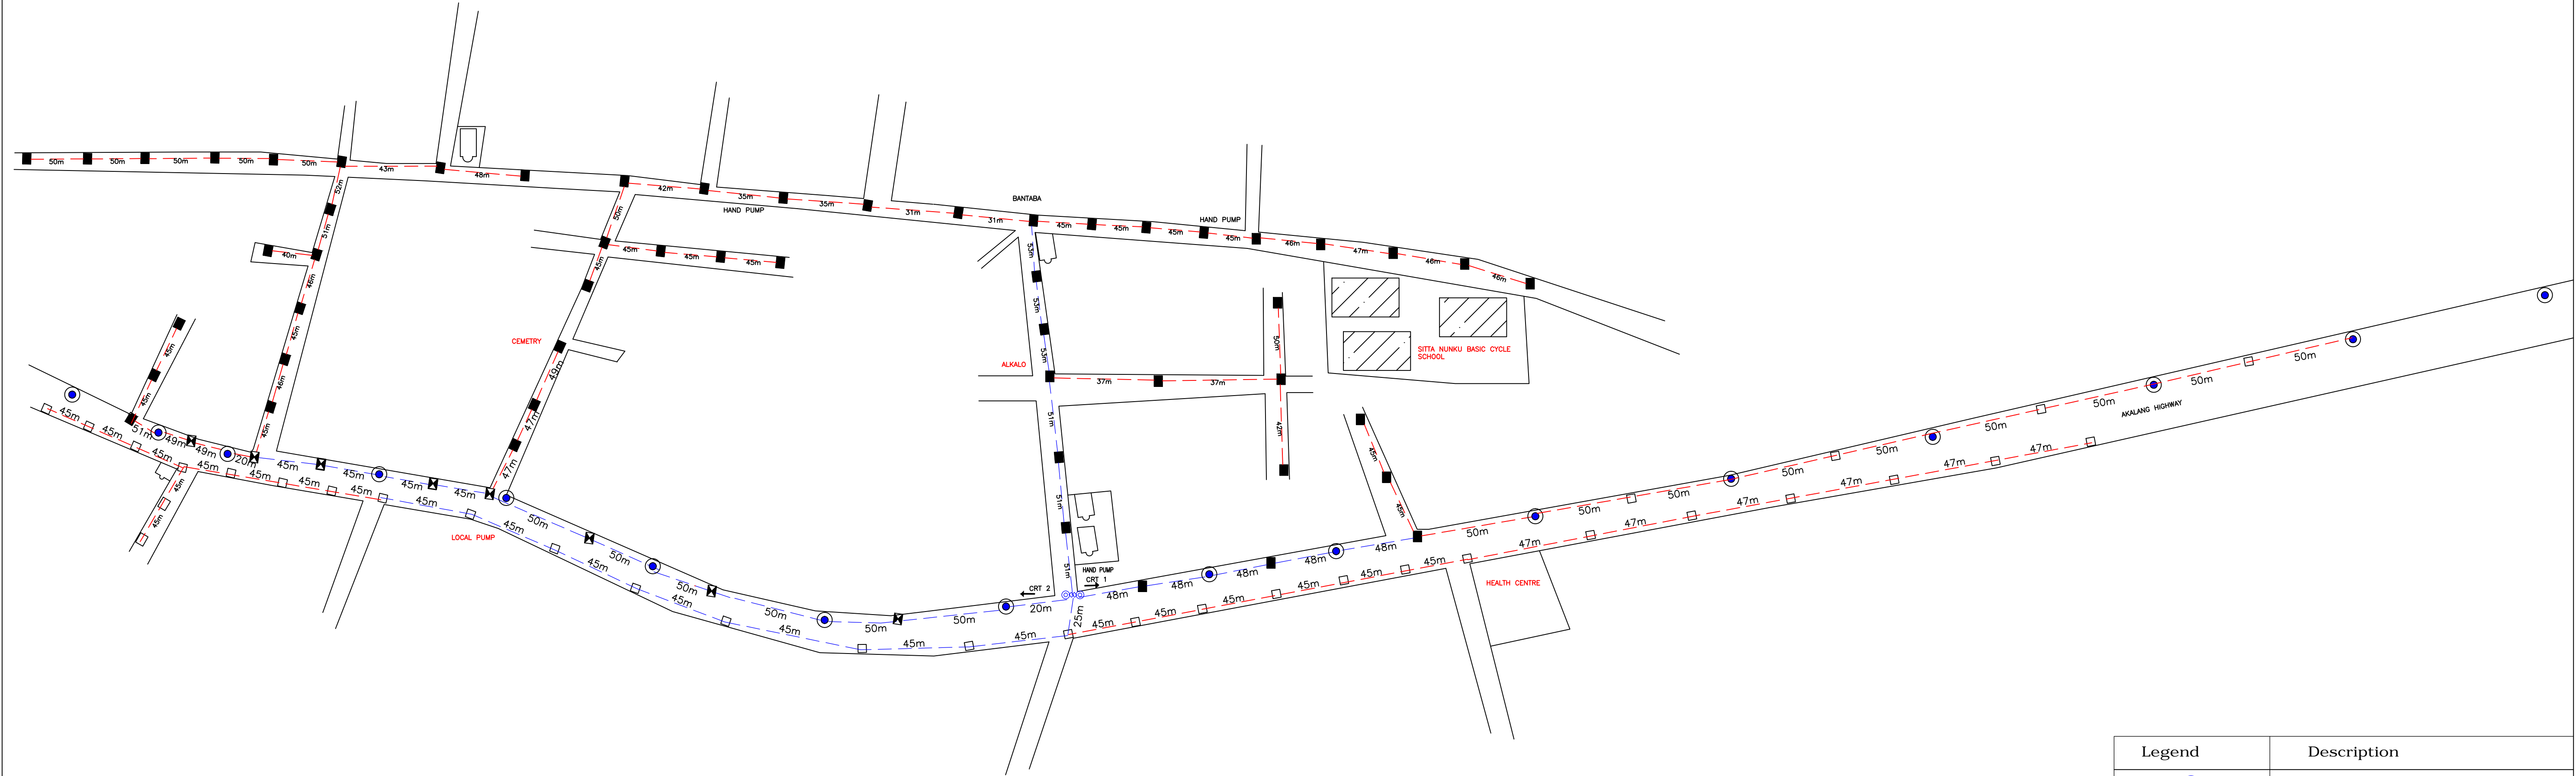

MATERIALS	
TOTAL 4X50+ 1X16sq.mm =	960m
TOTAL 4X35+ 1X16sq.mm =	2589m
28' POLE =	33
TOTAL EARTHING POINTS =	7
NUMBER OF TRANSFORMER =	1
TRIMMING =	1

Legend	Description
	Existing MV pole
	EXISTING LV pole
	Proposed LV pole
	Proposed pole mounted transformer
	Proposed 4x70+ 1x16sq.mm
	Proposed 30kV line
	Proposed pole earthing

<div>SURVEYED BY: Muhammed Sabally, Yassin Ceesay &amp; Ousman Jatta.</div> <div>DESIGNED BY : Muhammed Sabally</div> <div>CHECKED BY: Assan Colley</div> <div>APPROVED BY: Alhagie S Cham</div> <div>DATE: 7th August, 2020.</div>	<div>CLIENT</div> <div></div> <div>NATIONAL WATER AND ELECTRICITY COMPANY LTD. (NAWEC)</div>	<div>PROJECT</div> <div>THE PACD UNDP. CONSULTANCY SERVICES FOR DESIGN, TENDERING, SUPERVISION OF NORTH BANK REGION , THE GAMBIA.</div>
		<div>TITLE</div> <div>PROPOSED LV NETWORK OF 100KVA DISTRIBUTION TRANSFORMER AT SITA NUNKU VILLAGE, NIUMI</div>