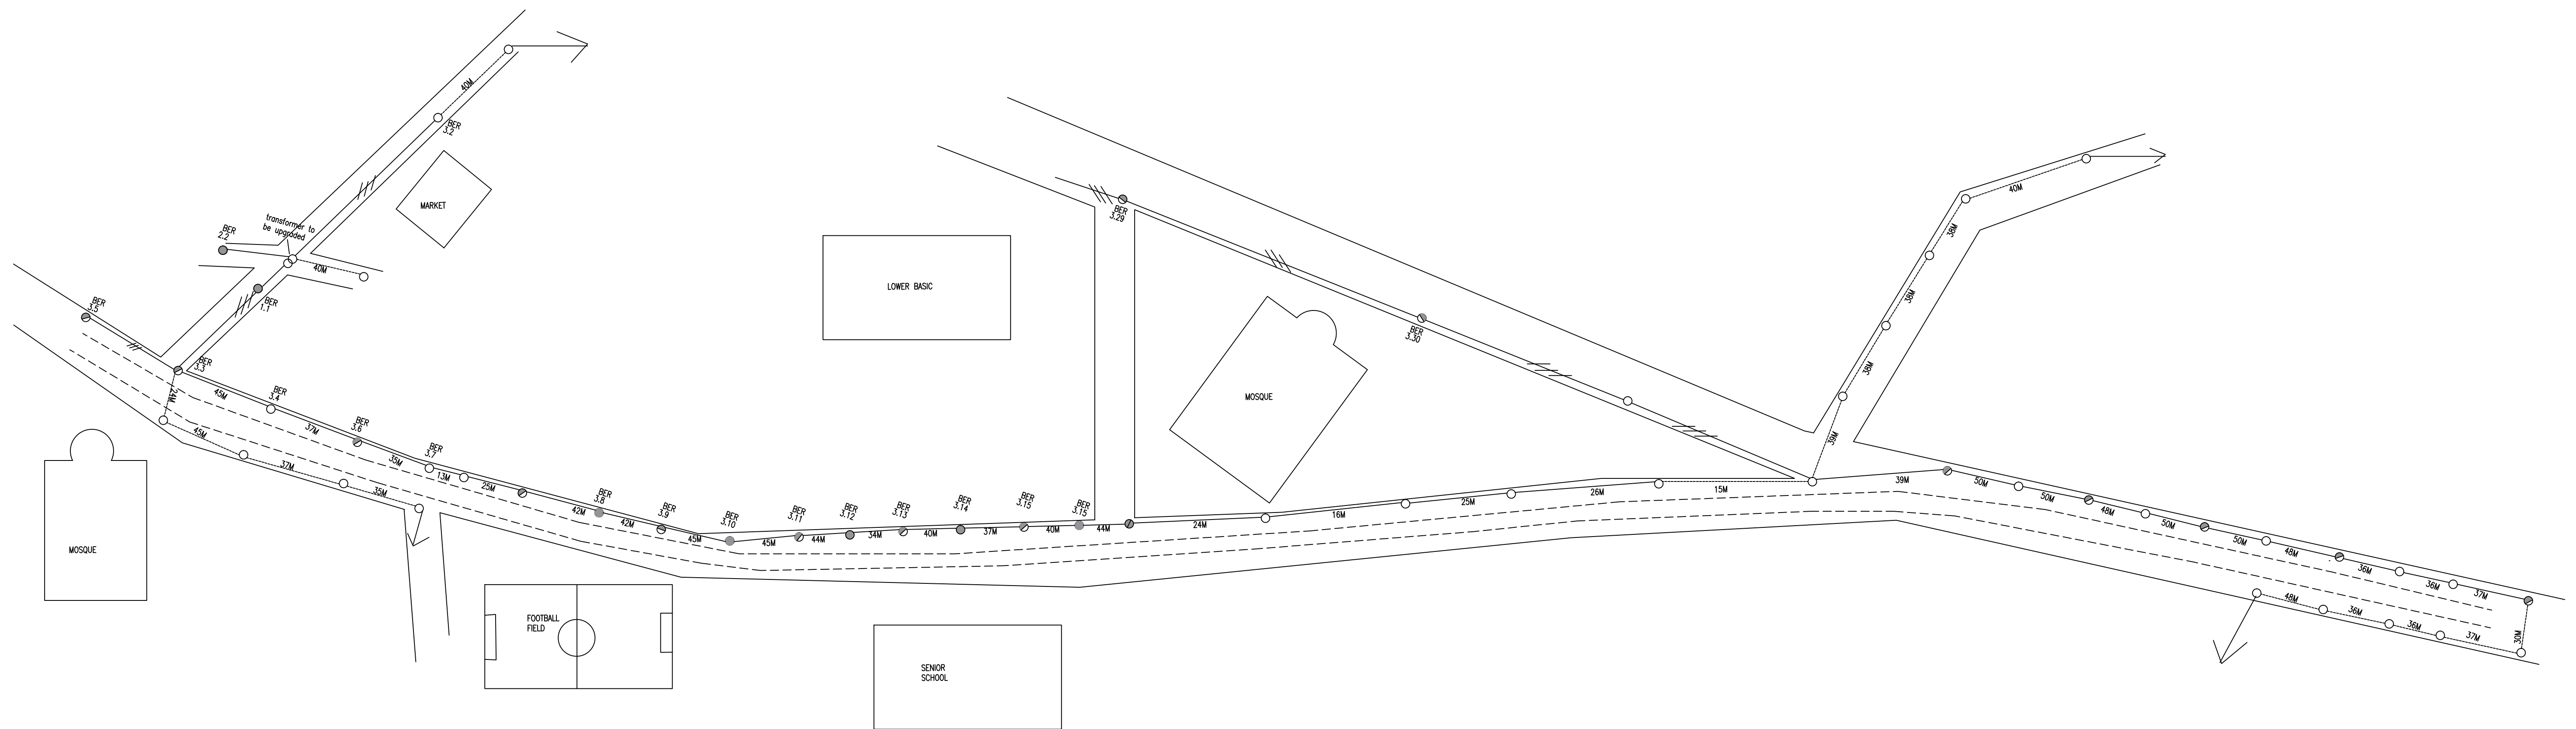










PROPOSED TRANS. TO BE 250KVA & LV NETWORK EXTENSION AT NUIMI BERENDING EXTENSION



MATERIALS			
TOTAL 4X70+1X16sq.mm = 1525M			
CTR1	CTR2	CTR3	CTR4
0	0	0	0
32' POLE = 7 28' POLE = 9			
TOTAL LV POLE = 17			
TOTAL EARTHING POINTS = 4			
NUMBER OF TRANSFORMER = 1			
NUMBER OF TRANSFORMER = 0			

Legend	Description
	Existing MV pole
	Proposed LV pole
	Existing LV pole
	Proposed pole mounted transformer
	Proposed 4x70+ 1x16sq.mm
	Proposed 30kV line
	Proposed pole earthing

SURVEYED BY: Bubacarr Camara,Edrisa ndow & Muhammed Sabally.	<div>CLIENT</div> <div>  <div>NATIONAL WATER AND ELECTRICITY COMPANY LTD. (NAWEC)</div> </div>	PROJECT	THE CONSULTANCY SERVICES FOR THE UNDP SOMA FEEDER I NORTH BANK REGION , THE GAMBIA
DESIGNED BY :Bubacarr camara		TITLE	PROPOSED TRANS. TO BE 250KVA & LV NETWORK EXTENSION AT NUIMI BERENDING EXTENSION
CHECKED BY: Assan Colley			
APPROVED BY: Alhagie S Cham			
DATE: 25th August, 2020.			