




NOTES

- 1 This drawing shall be read in conjunction with other relevant engineering and architectural drawings.
- 2 standard and specifications shall apply
- 3Wiring shall be in PVC conduits concealed under plaster with zamefa cables.
- 4Any omissions or errors to be reported to the project engineer before any corrective measures are taken
- 5 All Distribution Boards shall be flush mounted.
- 6 Sockets wiring shall be in PVC conduits concealed under plaster connected to 2.5mm2 zamefa cables
- 7Earthing installation shall be installed atleast 1m away from the Building

REPUBLIC OF ZAMBIA

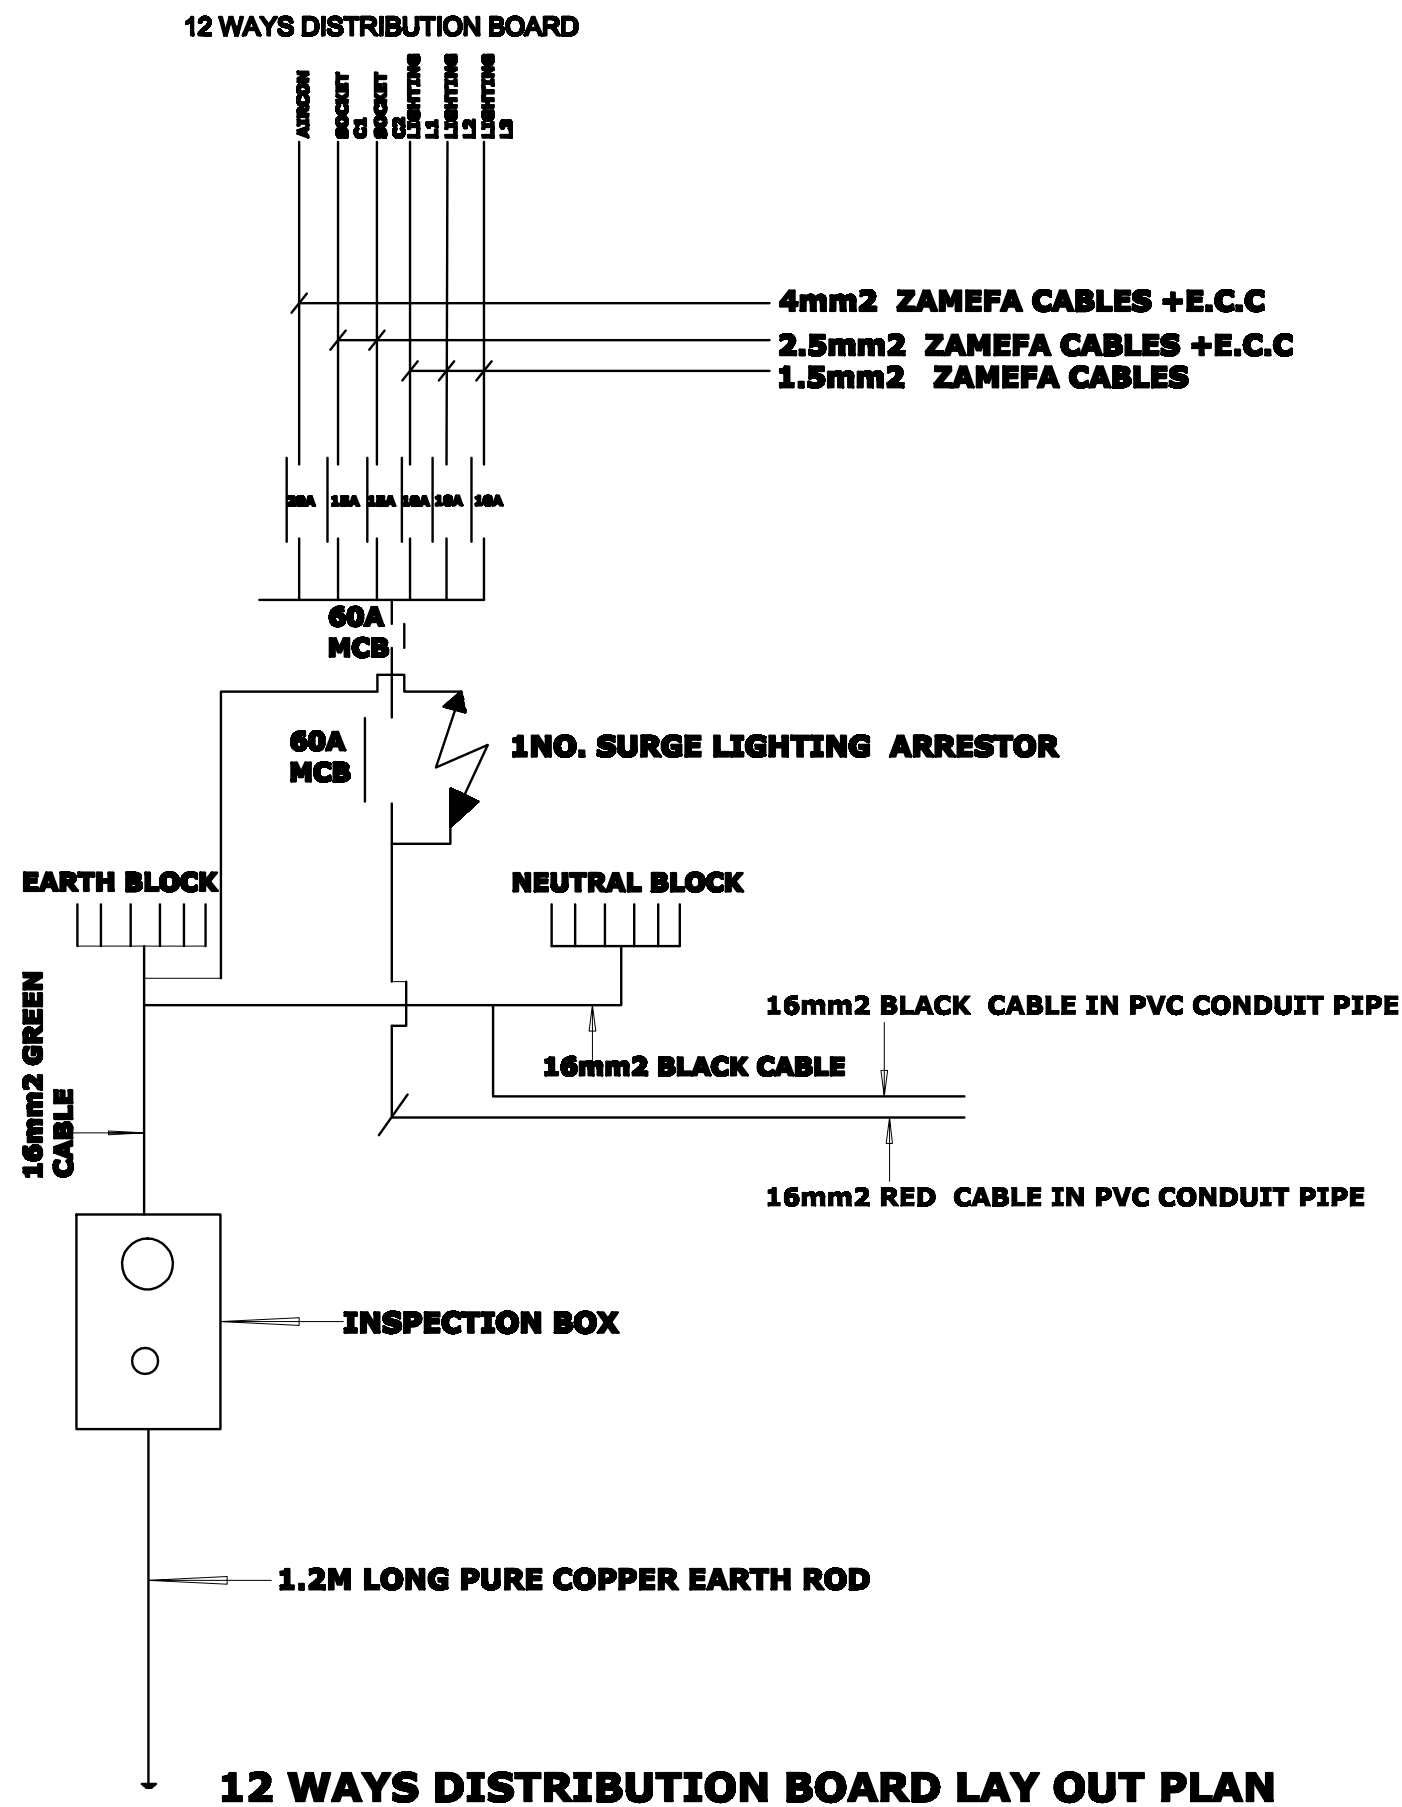

MINISTRY OF HOUSING
AND INFRASTRUCTURE
DEVELOPMENT

DEP. OF PUBLIC
INFRASTRUCTURE
P.O. BOX 110094,
SOLWEZI

PROJECT TITLE :
PROPOSED CONSTRUCTION OF
MEHEBA POLICE POST &
ASSOCIATED EXTERNAL WORKS
IN
MEHEBA RESETTLEMENT
SCHEME-KALUMBILA DISTRICT,
NORTHWESTERN PROVINCE

CLIENT:
OFFICE OF THE
VICE PRESIDENT
DEPARTMENT OF RESETTLEMENT
P.O.BOX 110082,SOLWEZI
NORTHWESTERN PROVINCE
SITE: MAHEBA-KALUMBILA

SPONSOR:
UNITED NATIONS DEVELOPMENT PROGRAM
(UNDP)

DRAWING TITLE
ELECTRICAL DISTRIBUTION LAYOUT

DRAWN BY:
M.J.MWIINGA

CHECKED BY:
ENG PAUL C LUSAKA

REF #: DPI-ENG-377-012

SCALE: AS SHOWN

DATE: SEPTEMBER 2020