



0	l Bereitster
Symbol	Description
	Projector 70 W
M	Manual break glass
	Single fluorescent
	Socket Switch13(A)
(S)	Smoke detectore
	Sub Distribution
	Main Board
B	Fire alarm bell
	LED Spot Light
•	Ceiling Fan
∞	Exhaust fan
F.A.C.P	Fire alarm control pane

Ground Floor

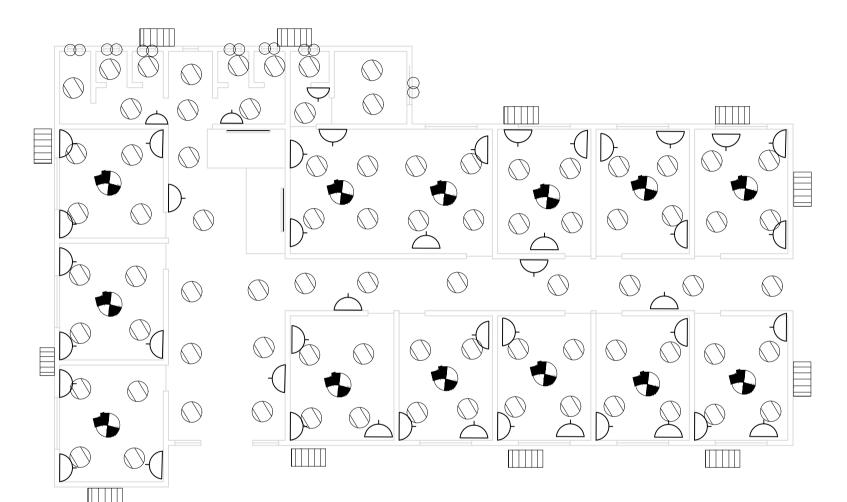


Symbol	Description
	Projector 70 W
M	Manual break glass
	Single fluorescent
	Socket Switch13(A)
(s)	Smoke detectore
	Sub Distribution
	Main Board
B	Fire alarm bell
	LED Spot Light
	Ceiling Fan
\bigcirc	Exhaust fan
F.A.C.P	Fire alarm control pane

First Floor

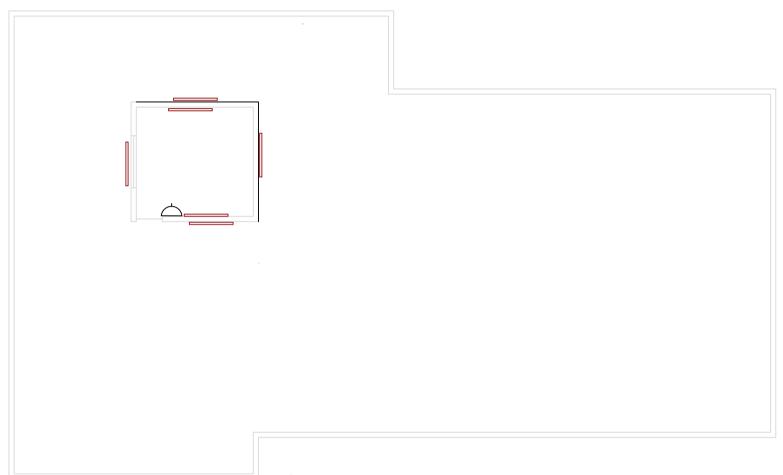


Symbol	Description
	Projector 70 W
M	Manual break glass
	Single fluorescent
	Socket Switch13(A)
(v)	Smoke detectore
	Sub Distribution
	Main Board
B	Fire alarm bell
	LED Spot Light
•	Ceiling Fan
\bigcirc	Exhaust fan
F.A.C.P	Fire alarm control pane


Secund Floor

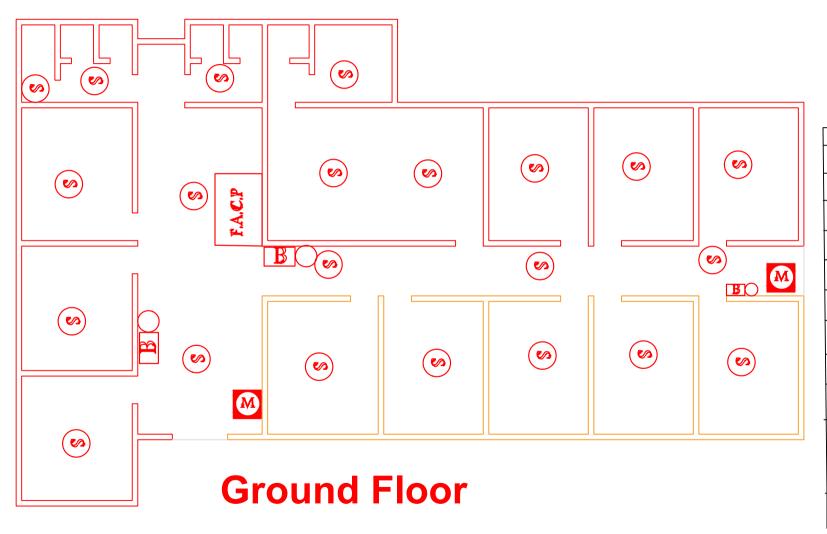

	Manual break glass
Symbol	Description
	Projector 70 W
M	Manual break glass
	Single fluorescent
	Socket Switch13(A)
(N)	Smoke detectore
	Sub Distribution
	Main Board
B	Fire alarm bell
	LED Spot Light
•	Ceiling Fan
∞	Exhaust fan
F.A.C.P	Fire alarm control panel

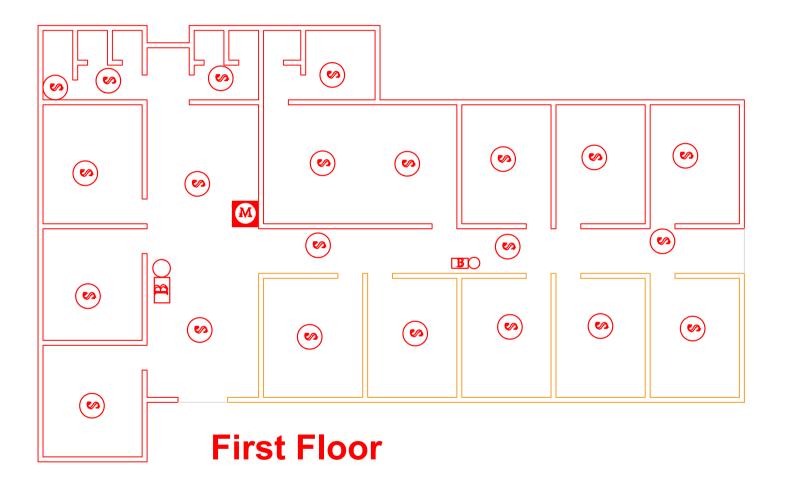

Symbol	Description
	Projector 70 W
₩	Manual break glass
	Single fluorescent
	Socket Switch13(A)
(S)	Smoke detectore
	Sub Distribution
	Main Board
B	Fire alarm bell
	LED Spot Light
•	Ceiling Fan
$\overline{\omega}$	Exhaust fan
F.A.C.P	Fire alarm control panel

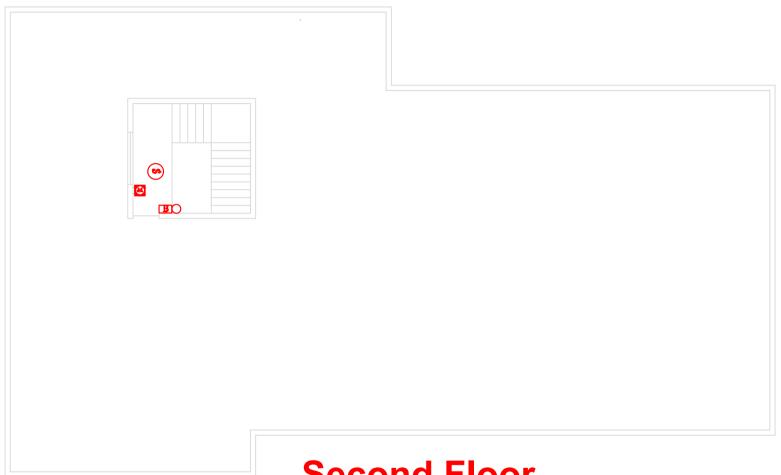

Symbol	Description
	Projector 70 W
M	Manual break glass
	Single fluorescent
	Socket Switch13(A)
(N)	Smoke detectore
	Sub Distribution
	Main Board
B	Fire alarm bell
	LED Spot Light
	Ceiling Fan
	Exhaust fan
F.A.C.P	Fire alarm control pane

Second Floor