



LEGEND

<input type="checkbox"/> T	Heat Detector. X denotes address.
<input type="checkbox"/> X	Optical Smoke Detector. X denotes address.

- Notes:**
- Existing smoke detection addresses shall be reused for the new changing room and corridor. Any smoke or heat detectors located within void shall remain.
 - The Contractor shall liaise with the Client building services team and follow all procedures and protocols in place to minimise disruption of Fire Alarm service during the works.
 - The Contractor shall ensure that the same type of smoke and heat detectors are used for the new changing rooms.

0.0	09.12.2020	First Issue	EE	KA	FP
Rev.	Date/	Description/ Beskrivelse	Pppl.	Chkd	Appd.




ARUP

Axel Towers, Axeltorv 2K 3rd Floor 1609 Copenhagen V
Tel: +45 3377 0760
www.arup.com

Client: *Bygherre*
UN Common Services

Project Title: *Sag*
**UN City Changing Rooms
Refurbishment**

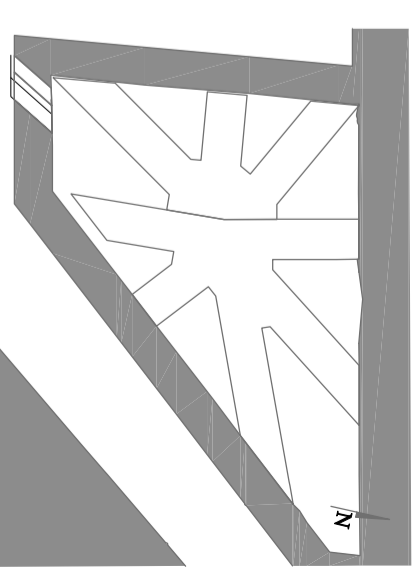

Drawing Title: *Emne*
**ELECTRICAL, FIRE ALARM AND
DETECTION LAYOUT BASEMENT
(B)**

Scale at A3/
1:50

Role
Engineer

Suitability
Issue for Tender

Arup Job No: *Sagsnummer*
279110

Rev
0.0

Name: *Tegningsnummer*
CHA-ARUP-ZZ-00-DR-E-2003

Plan
1 : 50