

- Notes:**
1. The Contractor shall ensure sufficient ventilation capacity to supply the changing rooms with 10 Air Changes, without comprising ventilation in other rooms.
 2. The Contractor shall ensure proper balancing of the ventilation systems K6-VE11_BRSSO3 and K6-VE11_BRSSO3 as per the specifications and scope of works.

0.0	09.12.2020	First Issue	EE	KAA	FP
Rev.	Date/	Description/ Beskrivelse	Pppl.	Chkd	Appd.




ARUP

Axel Towers, Axeltorv 2K 3rd Floor, 1609 Copenhagen V
Tel: +45 3377 0760
www.arup.com

Client: Bygherre
UN Common Services

Project Title: Sæg
**UN City Changing Rooms
Refurbishment**

Key Plan: Oversigtsplan

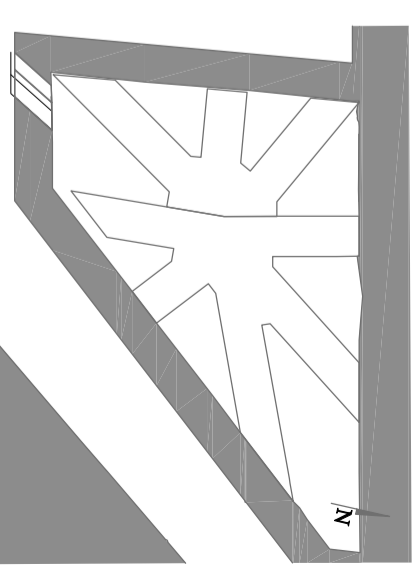

Drawing Title: *Emne*
**MECHANICAL, VENTILATION
LAYOUT BASEMENT (B)**

Scale at A3/
1:50

Role
Engineer

Suitability
Issue for Tender

Arup Job No: Sægnummer

279110

Rev
0.0

Name: Tegningsnummer

CHA-ARUP-ZZ-00-DR-M-2002

Plan
1 : 50